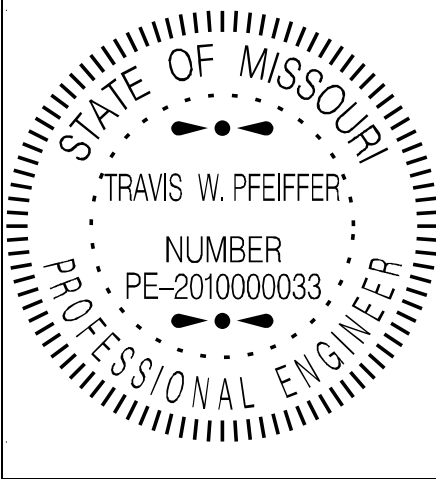


JOB SPECIAL PROVISIONS TABLE OF CONTENTS (ROADWAY)

(Job Special Provisions shall prevail over General Special Provisions whenever in conflict therewith.)

A.	General - Federal JSP-09-02J	1
B.	Contract Liquidated Damages JSP-13-01C	1
C.	Work Zone Traffic Management JSP-02-06N	2
D.	Emergency Provisions and Incident Management JSP-90-11A	5
E.	Project Contact for Contractor/Bidder Questions JSP-96-05	6
F.	Site Restoration	6
G.	ADA Compliance and Final Acceptance of Constructed Facilities JSP-10-01C	7
H.	ADA Material Testing Frequency Modifications JSP-23-01	8
I.	Pavement Marking Layout	9
J.	Modified Pavement Marking Removal	9
K.	Surface Mount Delineator Posts	10
L.	Remove and Relocate Ground Mount Sign	11
M.	Removal and Delivery of Existing Signs JSP-12-01C	11
N.	Coordination with MoDOT Signal Shop for Cabinet Entry	12
O.	Audible Pedestrian Pushbuttons and Signing (Revised 06.09.2023)	13
P.	Pedestrian Push Button Stanchion	15
Q.	Push Button Extension	15
R.	Countdown Pedestrian Signal Heads	15
S.	SL District Traffic Signal Detection System	17
T.	Traffic Signal Maintenance and Programming	24
U.	Coordination with ITS Staff and Utility Locates	27
V.	MoDOT ITS Assets Relocation	28
W.	MoDOT ITS Equipment Within Project Limits	30
X.	Pull Box Adjustment	31
Y.	Utilities JSP-93-26F	31
Z.	ADA Curb Ramps	33
AA.	Airport Requirements JSP-15-09	35
BB.	Lump Sum Temporary Traffic Control JSP-22-01A	36
CC.	NTCIP Compliant Changeable Message Sign (Contractor Furnished and Retained)	37
DD.	Shaping Slopes Class III (Modified Material Requirements) NJSP-20-03B	39
EE.	Contractor Quality Control NJSP-15-42	40
FF.	Concrete Trough with Steel Plate	42
GG.	Access to Commercial Properties and City Streets	42
HH.	Supplemental Revisions JSP-18-01AA	43

Job No.: J6S3609
Route: 44 NOR,SOR
County: Franklin

	MISSOURI HIGHWAYS AND TRANSPORTATION COMMISSION 105 W. CAPITOL AVE. JEFFERSON CITY, MO 65102 Phone 1-888-275-6636
	HNTB Corporation 211 N. Broadway, Suite 2975 St. Louis, MO 63102 Certificate of Authority: No. 001270 Consultant Phone: (314) 241-2808
	If a seal is present on this sheet, JSP's have been electronically sealed and dated.
	JOB NUMBER: J6S3609 FRANKLIN COUNTY, MO DATE PREPARED: November 22, 2023
	ADDENDUM DATE:

Only the following items of the Job Special Provisions (Roadway) are authenticated by this seal: All

JOB
SPECIAL PROVISION

A. General - Federal JSP-09-02J

1.0 Description. The Federal Government is participating in the cost of construction of this project. All applicable Federal laws, and the regulations made pursuant to such laws, shall be observed by the contractor, and the work will be subject to the inspection of the appropriate Federal Agency in the same manner as provided in Sec 105.10 of the Missouri Standard Specifications for Highway Construction with all revisions applicable to this bid and contract.

1.1 This contract requires payment of the prevailing hourly rate of wages for each craft or type of work required to execute the contract as determined by the Missouri Department of Labor and Industrial Relations and requires adherence to a schedule of minimum wages as determined by the United States Department of Labor. For work performed anywhere on this project, the contractor and the contractor's subcontractors shall pay the higher of these two applicable wage rates. State Wage Rates, Information on the Required Federal Aid Provisions, and the current Federal Wage Rates are available on the Missouri Department of Transportation web page at www.modot.org under "Doing Business with MoDOT", "Contractor Resources". Effective Wage Rates will be posted 10 days prior to the applicable bid opening. These supplemental bidding documents have important legal consequences. It shall be conclusively presumed that they are in the bidder's possession, and they have been reviewed and used by the bidder in the preparation of any bid submitted on this project.

1.2 The following documents are available on the Missouri Department of Transportation web page at www.modot.org under "Doing Business with MoDOT"; "Standards and Specifications". The effective version shall be determined by the letting date of the project.

General Provisions & Supplemental Specifications

Supplemental Plans to July 2023 Missouri Standard Plans
For Highway Construction

These supplemental bidding documents contain all current revisions to the published versions and have important legal consequences. It shall be conclusively presumed that they are in the bidder's possession, and they have been reviewed and used by the bidder in the preparation of any bid submitted on this project.

B. Contract Liquidated Damages JSP-13-01C

1.0 Description. Liquidated Damages for failure or delay in completing the work on time for this contract shall be in accordance with Sec 108.8. The liquidated damages include separate amounts for road user costs and contract administrative costs incurred by the Commission.

2.0 Period of Performance. Prosecution of work is expected to begin on the date specified below in accordance with Sec 108.2. Regardless of when the work is begun on this contract, all work on all projects (job numbers) shall be completed on or before the Contract Completion date specified below. Completion by this date shall be in accordance with the requirements of Sec 108.7.1.

Notice to Proceed Date: March 11, 2024
Contract Completion Date: November 1, 2024

2.1 Calendar Days. The count of calendar days will begin on the date the contractor starts any construction operations on the project.

Job Number	Calendar Days	Daily Road User Cost
J6S3609	N/A	\$2,300

3.0 Liquidated Damages for Contract Administrative Costs. Should the contractor fail to complete the work on or before the contract completion date specified in Section 2.0, or within the number of calendar days specified in Section 2.1, whichever occurs first, the contractor will be charged contract administrative liquidated damages in accordance with Sec 108.8 in the amount of **\$2,000** per calendar day for each calendar day, or partial day thereof, that the work is not fully completed. For projects in combination, these damages will be charged in full for failure to complete one or more projects within the above specified contract completion date or calendar days.

4.0 Liquidated Damages for Road User Costs. Should the contractor fail to complete the work on or before the contract completion date specified in Section 2.0, or within the number of calendar days specified in Section 2.1, whichever occurs first, the contractor will be charged road user costs in accordance with Sec 108.8 in the amount specified in Section 2.1 for each calendar day, or partial day thereof, that the work is not fully completed. These damages are in addition to the contract administrative damages and any other damages as specified elsewhere in this contract.

C. Work Zone Traffic Management JSP-02-06N

1.0 Description. Work zone traffic management shall be in accordance with applicable portions of Division 100 and Division 600 of the Standard Specifications, and specifically as follows.

1.1 Maintaining Work Zones and Work Zone Reviews. The Work Zone Specialist (WZS) shall maintain work zones in accordance with Sec 616.3.3 and as further stated herein. The WZS shall coordinate and implement any changes approved by the engineer. The WZS shall ensure all traffic control devices are maintained in accordance with Sec 616, the work zone is operated within the hours specified by the engineer, and will not deviate from the specified hours without prior approval of the engineer. The WZS is responsible to manage work zone delay in accordance with these project provisions. When requested by the engineer, the WZS shall submit a weekly report that includes a review of work zone operations for the week. The report shall identify any problems encountered and corrective actions taken. Work zones are subject to unannounced inspections by the engineer and other departmental staff to corroborate the validity of the WZS's review and may require immediate corrective measures and/or additional work zone monitoring.

1.2 Work Zone Deficiencies. Failure to make corrections on time may result in the engineer suspending work. The suspension will be non-excusable and non-compensable regardless if road user costs are being charged for closures.

2.0 Traffic Management Schedule.

2.1 Traffic management schedules shall be submitted to the engineer for review prior to the start of work and prior to any revisions to the traffic management schedule. The traffic management schedule shall include the proposed traffic control measures, the hours traffic control will be in place, and work hours.

2.2 The traffic management schedule shall conform to the limitations specified in Sec 616 regarding lane closures, traffic shifts, road closures and other width, height and weight restrictions.

2.3 The engineer shall be notified as soon as practical of any postponement due to weather, material or other circumstances.

2.4 In order to ensure minimal traffic interference, the contractor shall schedule lane closures for the absolute minimum amount of time required to complete the work. Lanes shall not be closed until material is available for continuous construction and the contractor is prepared to diligently pursue the work until the closed lane is opened to traffic.

2.5 Traffic Congestion. The contractor shall, upon approval of the engineer, take proactive measures to reduce traffic congestion in the work zone. The contractor shall immediately implement appropriate mitigation strategies whenever traffic congestion reaches an excess of 10 minutes to prevent congestion from escalating to 15 minute or above threshold. If disruption of the traffic flow occurs and traffic is backed up in queues of 15 minute delays or longer, then the contractor shall immediately review the construction operations which contributed directly to disruption of the traffic flow and make adjustments to the operations to prevent the queues from reoccurring. Traffic delays may be monitored by physical presence on site or by utilizing real-time travel data through the work zone that generate text and/or email notifications where available. The engineer monitoring the work zone may also notify the contractor of delays that require prompt mitigation. The contractor may work with the engineer to determine what other alternative solutions or time periods would be acceptable.

2.5.1 Traffic Safety.

2.5.1.1 Recurring Congestion. Where traffic queues routinely extend to within 1000 feet of the ROAD WORK AHEAD, or similar, sign on a divided highway or to within 500 feet of the ROAD WORK AHEAD, or similar, sign on an undivided highway, the contractor shall extend the advance warning area, as approved by the engineer.

2.5.1.2 Non-Recurring Congestion. When traffic queues extend to within 1000 feet of the ROAD WORK AHEAD, or similar, sign on a divided highway or to within 500 feet of the ROAD WORK AHEAD, or similar, sign on an undivided highway infrequently, the contractor shall deploy a means of providing advance warning of the traffic congestion, as approved by the engineer. The warning location shall be no less than 1000 feet and no more than 0.5 mile in advance of the end of the traffic queue on divided highways and no less than 500 feet and no more than 0.5 mile in advance of the end of the traffic queue on undivided highways.

2.6 Traffic Management Center (TMC) Coordination. The Work Zone Specialist (WZS) or their designee shall contact by phone the MoDOT Traffic Management Center (KC Scout TMC at #816-347-2250 or Gateway Guide TMC at #314-275-1513) within five minutes of a lane or ramp closure beginning and within five minutes of a lane or ramp closure being removed. The WZS shall make this phone call 24 hours a day, 365 days of the year since the MoDOT Traffic Management Centers are always staffed.

3.0 Work Hour Restrictions.

3.1 Except for emergency work, as determined by the engineer, and long term lane closures required by project phasing, all lanes shall be scheduled to be open to traffic during the five major holiday periods shown below, from 12:00 noon on the last working day preceding the holiday until 6:00 a.m. on the first working day subsequent to the holiday unless otherwise approved by the engineer.

- Memorial Day
- Labor Day
- Thanksgiving
- Christmas
- New Year’s Day

3.1.1 Independence Day. The lane restrictions specified in Section 3.1 shall also apply to Independence Day, except that the restricted periods shall be as follows:

When Independence Day falls on:	The Holiday is Observed on:	Halt Lane Closures beginning at:	Allow Lane Closures to resume at:
Sunday	Monday	Noon on Friday	6:00 a.m. on Tuesday
Monday	Monday	Noon on Friday	6:00 a.m. on Tuesday
Tuesday	Tuesday	Noon on Monday	6:00 a.m. on Wednesday
Wednesday	Wednesday	Noon on Tuesday	6:00 a.m. on Thursday
Thursday	Thursday	Noon on Wednesday	6:00 a.m. on Friday
Friday	Friday	Noon on Thursday	6:00 a.m. on Monday
Saturday	Friday	Noon on Thursday	6:00 a.m. on Monday

3.2 The contractor shall not perform any construction operation on the roadway, roadbed or active lanes, including the hauling of material within the project limits, during restricted periods, holiday periods or other special events specified in the contract documents.

3.3 The contractor shall be aware that traffic volume data indicates construction operations on the roadbed between the following hours will likely result in traffic queues greater than 15 minutes. Based on this, the contractor’s operations will be restricted accordingly unless it can be successfully demonstrated the operations can be performed without a 15 minute queue in traffic. It shall be the responsibility of the engineer to determine if the above work hours may be modified. Working hours for evenings, weekends and holidays will be determined by the engineer. The contractor may not work during the following listed hours:

I-44 North Outer Road (NOR):
No Restrictions

I-44 South Outer Road (SOR):
No Restrictions

I-44 South Outer Road (SOR) Intersection at Route 185
6:00 a.m. – 8:30 a.m.
3:00 p.m. – 7:00 p.m.

4.0 Detours and Lane Closures.

4.1 When a changeable message sign (CMS) is provided, the contractor shall use the CMS to notify motorists of future traffic disruption and possible traffic delays one week before traffic is shifted to a detour or prior to lane closures. The CMS shall be installed at a location as approved or directed by the engineer. If a CMS with Communication Interface is required, then the CMS shall be capable of communication prior to installation on right of way. All messages planned for use in the work zone shall be approved and authorized by the engineer or its designee prior to deployment. When permanent dynamic message signs (DMS) owned and operated by MoDOT are located near the project, they may also be used to provide warning and information for the work zone. Permanent DMS shall be operated by the TMC, and any messages planned for use on DMS shall be approved and authorized by the TMC at least 72 hours in advance of the work.

4.2 At least one lane of traffic in each direction shall be maintained at all times except for brief intervals of time required when the movement of the contractor's equipment will seriously hinder the safe movement of traffic. Periods during which the contractor will be allowed to interrupt traffic will be designated by the engineer.

5.0 Basis of Payment. No direct payment will be made to the contractor to recover the cost of equipment, labor, materials, or time required to fulfill the above provisions, unless specified elsewhere in the contract document. All authorized changes in the traffic control plan shall be provided for as specified in Sec 616.

D. Emergency Provisions and Incident Management JSP-90-11A

1.0 The contractor shall have communication equipment on the construction site or immediate access to other communication systems to request assistance from law enforcement or other emergency agencies for incident management. In case of traffic accidents or the need for law enforcement to direct or restore traffic flow through the job site, the contractor shall notify law enforcement or other emergency agencies immediately as needed. The area engineer's office shall also be notified when the contractor requests emergency assistance.

2.0 In addition to the 911 emergency telephone number for ambulance, fire or law enforcement services, the following agencies may also be notified for accident or emergency situation within the project limits.

Missouri Highway Patrol 314-416-2180	
City of Sullivan	City of St. Clair
Fire: 573-468-6161	Fire: 636-629-2727
Police: 573-468-8001	Police: 636-629-1313

2.1 This list is not all inclusive. Notification of the need for wrecker or tow truck services will remain the responsibility of the appropriate law enforcement agency.

2.2 The contractor shall notify law enforcement and emergency agencies before the start of construction to request their cooperation and to provide coordination of services when emergencies arise during the construction at the project site. When the contractor completes this

notification with law enforcement and emergency agencies, a report shall be furnished to the engineer on the status of incident management.

3.0 No direct pay will be made to the contractor to recover the cost of the communication equipment, labor, materials or time required to fulfill the above provisions.

E. Project Contact for Contractor/Bidder Questions JSP-96-05

All questions concerning this project during the bidding process shall be forwarded to the project contact listed below.

Aaron Groff, Project Manager
St. Louis District
1590 Woodlake Drive
Chesterfield, MO 63017

Telephone Number: 314-453-1876
Email: Aaron.Groff@modot.mo.gov

All questions concerning the bid document preparation can be directed to the Central Office – Design at (573) 751-2876.

F. Site Restoration

1.0 Description. Restore to its original condition any disturbed area at sites including, but not limited to, guardrail, sidewalk, pull box, conduit, and pole base installations. Restoration shall be accomplished by placing material equivalent to that of the adjacent undisturbed area. Disturbed unpaved areas shall be fertilized and either seeded and mulched or sodded as directed by the engineer. The engineer will have the final authority in determining the acceptability of the restoration work.

2.0 If the contractor elects and receives approval from the engineer for alternate trench and/or pull box locations, any areas of concrete slope protection, sidewalk, pavement, shoulders, islands and medians – as well as any similar improvements consisting of asphaltic concrete materials – removed in conjunction with their construction shall be replaced with improvements of similar composition and thickness. Removals shall be achieved by means of full depth saw cuts, the resulting subgrade compacted to minimum density requirements and topped with 4 inches of compacted aggregate base course prior to replacement of surface materials. Concrete materials used in replacement, shall be approved by the engineer. A commercial asphalt mix may be used for replacement of asphaltic surfacing upon approval of the engineer.

2.1 Unless quantities and pay items for removal and subsequent replacement of improvements are contained in the plans for a specific location of removal work, no direct payment will be made for full depth saw cutting and the removal and subsequent replacement of asphalt or concrete slope protection, sidewalk, pavement, shoulders, islands, medians, sod and the required dowel and tie bars removed and replaced by the contractor as a result of his election to vary the location of conduit runs and pull boxes. This work will be considered as included in the various unit bid prices for conduit and pull boxes established in the contract, and no additional payment will be made.

2.2 Sidewalks and sidewalk ramps that are disturbed as described in this provision shall be replaced to meet current ADA standards.

2.3 Areas that are used by the contractor for jobsite trailers, equipment and materials storage, or used for project staging areas that are disturbed shall be cleaned up and restored to a condition that is both acceptable to the engineer and, at a minimum, equivalent to the existing site condition.

3.0 Basis of Payment. The cost of restoration of disturbed areas will be incidental to the unit price of guardrail, sidewalk, pole base, conduit, and/or pull box. No direct payment will be made for any materials or labor, which is performed under this provision.

G. ADA Compliance and Final Acceptance of Constructed Facilities JSP-10-01C

1.0 Description. The contractor shall comply with all laws pertaining to the Americans with Disabilities Act (ADA) during construction of pedestrian facilities on public rights of way for this project. An ADA Checklist is provided herein to be utilized by the contractor for verifying compliance with the ADA law. The contractor is expected to familiarize himself with the plans involving pedestrian facilities and the ADA Post Construction Checklist prior to performing the work.

2.0 ADA Checklist. The contractor can locate the ADA Checklist form on the Missouri Department of Transportation website:

<https://www.modot.org/forms-contractor-use>

2.1 The ADA Checklist is not to be considered all-inclusive, nor does it supersede any other contract requirements. The ADA checklist is a required guide for the contractor to use during the construction of the pedestrian facilities and a basis for the commission's acceptance of work. Prior to work being performed, the contractor shall bring to the engineer's attention any planned work that is in conflict with the design or with the requirement shown in the checklist. This notification shall be made in writing. Situations may arise where the checklist may not fully address all requirements needed to construct a facility to the full requirements of current ADA law. In those situations, the contractor shall propose a solution to the engineer that is compliant with current ADA law using the following hierarchy of resources: 2010 ADA Standards for Accessible Design, Draft Public Rights of Way Accessibility Guidelines (PROWAG) dated November 23, 2005, MoDOT's Engineering Policy Guidelines (EPG), or a solution approved by the U.S. Access Board.

2.2 It is encouraged that the contractor monitor the completed sections of the newly constructed pedestrian facilities in attempts to minimize negative impacts that his equipment, subcontractors or general public may have on the work. Completed facilities must comply with the requirements of ADA and the ADA Checklist or have documented reasons for the non-compliant items to remain.

3.0 Coordination of Construction.

3.1 Prior to construction and/or closure on an existing pedestrian path of travel, the contractor shall submit a schedule of work to be constructed, which includes location of work performed, the duration of time the contractor expects to impact the facility and an accessible signed pedestrian

detour compliant with MUTCD Section 6D that will be used during each stage of construction. This plan shall be submitted to the engineer for review and approval at or prior to the pre-construction conference. Accessible signed detours shall be in place prior to any work being performed that has the effect of closing an existing pedestrian travel way.

3.2 When consultant survey is included in the contract, the contractor shall use their survey crews to verify that the intended design can be constructed to the full requirements as established in the 2010 ADA Standards. When 2010 ADA Standards do not give sufficient information to construct the contract work, the contractor shall refer to the PROWAG.

3.3 When consultant survey is not included in the contract, the contractor shall coordinate with the engineer, prior to construction, to determine if additional survey will be required to confirm the designs constructability.

4.0 Final Acceptance of Work. The contractor shall provide the completed ADA Checklist to the engineer at the semi-final inspection. ADA improvements require final inspection and compliance with the ADA requirements and the ADA Checklist. Each item listed in the checklist must receive either a "YES" or an "N/A" score. Any item receiving a "NO" will be deemed non-compliant and shall be corrected at the contractor's expense unless deemed otherwise by the engineer. Documentation must be provided about the location of any non-compliant items that are allowed to remain at the end of the construction project. Specific details of the non-compliant items, the ADA requirement that the work was not able to comply with, and the specific reasons that justify the exception are to be included with the completed ADA Checklist provided to the engineer.

4.1 Slope and grade measurements shall be made using a properly calibrated, 2 foot long, electronic digital level approved by the engineer.

5.0 Basis of Payment. The contractor will receive full pay of the contract unit cost for all sidewalk, ramp, curb ramp, median, island, approach work, cross walk striping, APS buttons, pedestrian heads, detectible warning systems and temporary traffic control measures that are completed during the current estimate period as approved by the engineer. Based upon completion of the ADA Checklist, the contractor shall complete any necessary adjustments to items deemed non-compliant as directed by the engineer.

5.1 No direct payment will be made to the contractor to recover the cost of equipment, labor, materials, or time required to fulfill the above provisions, unless specified elsewhere in the contract documents.

H. ADA Material Testing Frequency Modifications JSP-23-01

1.0 Description. This provision revises the Inspection and Testing Plan (ITP) for the construction of ADA compliant features to better match the nature of the work. The Quality Control (QC) testing frequency for the Sections identified below are to be revised as specified.

2.0 Compaction Test on Base Rock Under Sidewalk, Curb Ramps and Paved Approaches. (Revises ITP Sec 304.3.4) The required test frequency will be one per 600 tons.

3.0 Gradation Test on Base Rock Under Sidewalk, Curb Ramps and Paved Approaches. (Revises ITP Sec 304.4.1) The required frequency will be one per 500 tons.

4.0 Concrete Plant Checklists. (Revises ITP Sec 501) Submittal of the 501 Concrete Plant Checklist will be once per week when the contractor is only pouring curb, sidewalk, paved approaches, and curb ramps.

5.0 Concrete Median, Median Strip, Sidewalk, Curb Ramps, and Curb. (Revises ITP Sec 608) The required frequency will be the first truckload for the project and each 100 CUYDs for air and slump thereafter. Strength will be verified by use of cylinders or maturity meters at a minimum rate of one per 100 CUYD.

6.0 Paved Approaches. (ITP Sec 608) The required testing of one test from the first truckload per day and each 100 CUYDs for air and slump will remain per ITP. Strength will be verified by use of cylinders or maturity meters at a minimum rate of one per 100 CUYD.

7.0 Curb Concrete. (Revises ITP Sec 609) The required frequency will be the same as Sec 5.0 above.

8.0 Basis of Payment. No direct payment will be made to the contractor to fulfill the above requirements.

I. Pavement Marking Layout

1.0 Description. Care is to be taken by the contractor to evaluate and document the existing pavement marking layout along the route prior to commencement of any pavement or shoulder work. Any new pavement marking placed after the completion of the paving work on this project shall match the pre-construction layout unless there are any authorized changes in the striping layout that have been approved by the Engineer.

2.0 Construction Requirements.

2.1 The contractor shall submit to the Engineer for review and approval a pavement marking installation plan. This plan will include the pre-construction documentation of the existing pavement marking layout as well as the contractor's proposal for installing the pavement markings, including locations of any intermittent pavement markings for passing zones to meet the requirements outlined above.

2.2 Final striping will not begin until the contractor has received approval of the pavement marking installation plan.

3.0 Method of Measurement. Final measurement for pavement marking will not be made except for authorized changes during construction or where appreciable errors are found in the contract quantity. The revision or correction will be computed and added to or deducted from the contract quantity.

4.0 Basis of Payment. All costs and expenses incurred by the contractor in fulfilling the requirements of the provision shall be considered incidental to pavement marking cost.

J. Modified Pavement Marking Removal

1.0 Description. The first sentence of Sec 620.50.3.2 shall be removed and replaced with the following:

Where required, measurement for the removal of pavement markings will be made to the nearest linear foot per 4-inches of width. No additional pay factor, based upon 4-inches of width, shall be included for removals unless the striping width is greater than 6-inches. Final measurement will not be made except for authorized changes during construction or where appreciable errors are found in the contract quantity. The revision or correction will be computed and added to or deducted from the contract quantity.

2.0 Pavement Marking Removal shall be in accordance with Section 620.50 and specifically as follows with the exception in Section 1.0 above.

3.0 Construction Requirements. Removal of all pavement marking within the project limits shall be as shown on the plans or as approved by the engineer. Pavement marking shall be completely removed to the satisfaction of the engineer with minimal damage to the pavement. The contractor shall use an approved **water blasting method** to remove the pavement marking on concrete surfaces. No more than five percent of the existing marking shall remain. The pavement surface shall not be left scarred with an image that might mislead traffic. Any excess damage or scarring of the pavement shall be repaired at the contractor's expense. It shall be the contractor's responsibility to determine what type of material needs to be removed.

4.0 Method of Measurement. Final measurement will not be made except for authorized changes during construction or where appreciable errors are found in the contract quantity. The revision or correction will be computed and added to or deducted from the contract quantity.

5.0 Basis of Payment. The accepted quantity of pavement marking removal including all labor, equipment, and material necessary to remove the existing marking will be paid for at the contract unit price for the following pay item:

Item 620-70.01 Pavement Marking Removal	LF
Item 620-70.02 Pavement Marking Removal (Symbols)	EA

K. Surface Mount Delineator Posts

1.0 Description. Surface mount delineator posts shall be mounted on raised islands and at the locations indicated in the plans.

2.0 Requirements. 36-inch delineator posts shall have a height of 36 inches, 3 reflective bands with super high intensity prismatic sheeting in accordance with Sec 1042 and be constructed from thermoplastic polyurethane. 18-inch delineator posts shall have a height of 18 inches, two reflective bands with super high intensity prismatic sheeting in accordance with Sec 1042 and be constructed from thermoplastic polyurethane. Color of the delineator posts and reflective bands shall match the nearest pavement marking to which they are placed. Post shall be in the shape of a "T" with a width of 3 inches and depth of 2 inches. Post shall be capable of recovering from repeated vehicle impacts. Post shall insert and be secured into the plastic base with horizontal locking pins. When the post is no longer serviceable, it shall be able to be removed and a new post can be manually inserted and locked into the existing base.

3.0 Construction Requirements. Median island delineator posts shall be surface mounted on the radius points of the island noses. The island or roadway for surface mounts shall be cleaned of dirt and gravel before installation. Delineator posts shall be surface mounted using properly sized anchor bolts according to manufacturer's instructions.

4.0 Method of Measurement. Measurement for installation of delineator post with base will be made per each.

5.0 Basis of Payment. All labor, equipment, and materials necessary to install these delineator posts will be paid for under:

Item Number	Type	Description
903-12.42	Each	36 Inch Surface-Mount Delineator Post
903-99.02	Each	18 Inch Surface-Mount Delineator Post

L. Remove and Relocate Ground Mount Sign

1.0 Description. This work shall consist of relocating and mounting existing signs, including any existing backing bars, of various sizes to new posts at locations shown on the plans, relocating, adjusting, and mounting existing and/or new signs on an existing post or as directed by the engineer. The contractor shall be responsible for all existing signs, including any existing backing bars, to be relocated. During construction, if any sign, including any backing bars, to be relocated is lost, stolen, or damaged in any way, the contractor shall be responsible for all costs.

2.0 Construction Requirements. The contractor shall install new sign support posts at the locations shown on the plans and then relocate and mount existing signs, including any existing backing bars, to the new or relocated posts. All work shall be completed in accordance with the construction requirements of Sec 903.

3.0 Method of Measurement. Measurement will be made per each for relocating, adjusting, and mounting existing signs, including any existing backing bars, to new or existing posts. Measurement for any concrete footings, structural steel posts, pipe posts, perforated square steel tubes and anchor sleeves, and breakaway assemblies will be made in accordance with Sec 903.

4.0 Basis of Payment. All costs incurred for relocating, adjusting, and mounting existing signs, including existing backing bars, to new posts at the locations shown on the plans, complete in place, will be paid for at the contract unit price for the following bid item noted below. Payment for all other labor, equipment, material, and incidental items will be considered completely covered by the bid items included in the contract.

Item Number	Type	Description
903-99.02	Each	Remove and Relocate Ground Mount Sign

M. Removal and Delivery of Existing Signs JSP-12-01C

1.0 Description. All Commission-owned signs removed from the project shall be disassembled, stored, transported, and disposed of as specified herein. Sign supports, structures and hardware removed from the project shall become the property of the contractor.

2.0 Disassembly and Delivery.

2.1 All Commission-owned signs, (excluding abandoned billboard signs), designated for removal in the plans, or any other signs designated by the Engineer, shall be removed from the sign supports and structures, disassembled, stored, transported, and delivered by the contractor to the recycling center for destruction.

2.2 The contractor shall coordinate and make arrangements with the recycling center for delivery of the signs. Sign panels shall be disassembled and/or cut into sizes as required by the recycling center.

2.3 The contractor shall provide the Engineer with a “Sign Delivery Certification” attesting to completion of delivery of all existing sign material from the project to the recycler. In addition, the contractor shall provide to the Engineer a final “Sign Certification of Destruction” from the recycler that documents the total pounds of scrap sign material received from the project and attests that all such material will not be re-purposed and will be destroyed in a recycling process. The contractor can locate the required certification statements from the Missouri Department of Transportation website:

<https://www.modot.org/forms-contractor-use>

2.4 Funds received from the disposal of the signs from the recycling center shall be retained by the Contractor.

3.0 Basis of Payment. All costs associated with removing, disassembling and/or cutting, storing, transporting, and disposing of signs shall be considered as completely covered by the contract unit price for Item No. 202-20.10, “Removal of Improvements”, per lump sum.

N. Coordination with MoDOT Signal Shop for Cabinet Entry

1.0 Description. Commission-furnished color-coded pad locks have been placed on all of MoDOT’s signal cabinets in addition to the key used to unlock the door handle. To gain access to the appropriate cabinets during the project all contractors shall coordinate with MoDOT’s signal shop to obtain the proper keys and locks..

1.0.1 Keys & Locks. Red locks & keys are provided when a contractor has modified the signal cabinet and MoDOT staff shall not have access to the cabinet until it is accepted for maintenance. The blue keys are provided for entry into the cabinet where MoDOT’s Signal Shop group deems the access to be minor in nature (entry to the cabinet to make a simple network switch connection, for example).

1.0.2 Completion of Project. At the completion of the project all keys and pad locks distributed to contractor during the project shall be returned to the Signal Shop supervisor or their representative and keys shall not be reproduced.

2.0 Contact. Initial contact must be made at least seven calendar days before work begins, preferably when the project has the notice to proceed or during the pre-construction meeting, if applicable. MoDOT's Signal Shop supervisors shall be notified prior to work beginning. Contact the signal shop via email at sltrs@modot.mo.gov to coordinate which padlocks are to be used.

3.0 Basis of Payment. No direct payment shall be made for compliance with this provision

O. Audible Pedestrian Pushbuttons and Signing (Revised 06.09.2023)

1.0 Description. Audible pedestrian pushbuttons and signing will be required for all pedestrian indications at all the intersections.

2.0 Installation. Audible signals should be installed as part of a pushbutton assembly.

3.0 Equipment.

3.1 Walk Indications. Accessible pedestrian signals shall have both audible and vibrotactile walk indications.

3.2 Vibrotactile. Vibrotactile walk indications shall be provided by a tactile arrow on the pushbutton that vibrates during the walk interval. Tactile arrow shall be located on the pushbutton that vibrates during the walk interval. Tactile arrow shall be located on the pushbutton, have high visual contrast (light on dark or dark on light), and shall be aligned parallel to the direction of travel on the associated crosswalk.

3.3 Audible. Accessible pedestrian signals shall have an audible walk indication during the walk interval only. The audible walk indication shall be audible from the beginning of the associated crosswalk.

3.4 Pushbutton signage. In addition to standard pedestrian sign requirements, all pushbuttons for the locations mentioned in 1.0 shall have additional signage to indicate crosswalk direction by use of a tactile arrow and the name of the street containing the crosswalk served by the audible pedestrian signal. The sign shall be located immediately above the push button mechanism and parallel to the crosswalk controlled by the button. The street name shall be the name of the street or reasonable abbreviation whose crosswalk is controlled by the push button. Signage shall comply with ADA Accessibility Guidelines (ADAAG) 703.2 specifications for Braille and raised print.

3.4.1 Arrow. Signs shall include a tactile arrow aligned parallel to the crosswalk direction. The arrow shall be raised 0.8 mm (.03 inch) minimum and shall be 4 mm (1.5 in) minimum in length. The arrowhead shall be open at 45 degrees to the shaft and shall be 33 percent of the length of the shaft. Stroke width shall be 10 percent minimum and 15 percent maximum of arrow length. The arrow shall contrast with the background.

3.4.2 Street Name. Accessible pedestrian signals (APS) shall include street name information aligned parallel to the crosswalk direction and shall comply with Revised Draft Guidelines for Accessible Public Rights-of-Way R409.3 or shall provide street name information in audible format.

4.0 Performance.

4.1 Audible Locator Tone. Locator tone that tells the pedestrian that the intersection is equipped with APS and where it is. Pushbutton locator tones shall have duration of 0.15 seconds or less, and shall repeat at 1-second intervals. Pushbutton locator tones shall be intensity responsive to ambient sound, and be audible 6 to 12 feet from the pushbutton, or to the building line. The locator tone shall operate during the DON'T WALK and flashing DON'T WALK intervals only and shall be deactivated when the pedestrian signal is not operative.

4.2 Verbal Wait Message. Acknowledge tone that tells the pedestrian that they have placed a call and informational message that tells the pedestrian to "Wait to cross" street name at intersecting street name.

4.3 Verbal Walk Message. The verbal messages shall provide a clear message that the walk interval is in effect, as well as to which crossing it applies. If available, the audio tone feature will not be used. The verbal message that is provided at regular intervals throughout the timing of the walk interval shall be the term "walk sign," which will be followed by the name of the street to be crossed.

4.4 Volume. Automatic volume adjustment in response to ambient traffic sound level will be provided up to a maximum volume of 100 dB. The units shall be responsive to ambient noise level changes up to no more than 5 dB louder than ambient sound. Tone or voice volume measured at 36 inches from the unit shall be 2dB minimum and 5dB maximum above ambient noise level. At installation, signal system is to be adjusted to be audible at no more than 5 to 12 feet from the system.

5.0 Documentation and Support.

5.1 Operation and Maintenance Manuals. Two copies of the operation and maintenance manuals for each station shall be included.

5.2 USB with Audible Messages. The Contractor shall provide two copies of USB data card to the Engineer that contains files for the manufacturer's audible messages for complete operation of all APS signals at all stations.

6.0 Construction Requirements. Construction requirements shall conform to Sec 902, 1061, and 1092.

7.0 Method of Measurement. Method of measurement shall conform to Sec 902.

8.0 Basis of Payment. Payment for the audible signals will be for each unit per bid item, 902-99.02, "Audible Pedestrian Pushbutton and Signing with Verbal Walk Message", per each. This will include all wiring, power adaptors, pusbuttons and installation hardware needed. Payment for signing and mounting hardware will be included in the pay item for audible pedestrian pushbutton. All costs incurred for complying with this provision including labor shall be considered completely covered by the contract unit price for:

Item Number	Type	Description
902-99.02	EA	Audible Pedestrian Pushbutton and Signing with Verbal Walk Message

P. Pedestrian Push Button Stanchion

1.0 Description. This work shall consist of installing pedestrian push button stanchions at the locations shown on the plans.

2.0 Requirements. Posts used for pedestrian push button stanchions shall be 48-inch long 4-inch diameter (4.5-inch O.D) schedule 40 aluminum pipe.

3.0 Construction Requirements. The post for the pedestrian push button stanchion shall be installed on top of a breakaway pedestal base mounted to a foundation in the sidewalk. The sidewalk foundation shall be constructed as part of the sidewalk and have an 18-inch diameter and 12-inch depth. The breakaway pedestal base shall be mounted to the sidewalk foundation using proper sized anchor bolts according to manufacturer's instructions.

A slip form connection shall be provided on the wiring in the breakaway pedestal base to sever the connection in the event that the pedestrian push button stanchion is struck by a vehicle. Access to wiring shall be provided through an access panel in the breakaway pedestal base as well as the pipe post cap. The cap shall be secured and weather proofed when it is not opened for access.

The final product shall meet or exceed Americans with Disabilities Act (ADA) requirements for pedestrian facilities.

4.0 Method of Measurement. Final measurement of pedestrian push button stanchions will be made per each.

5.0 Basis of Payment. Payment for furnishing all labor, equipment, materials, and tools necessary to place pedestrian push button stanchions shall be completely covered by the contract unit price for:

Item Number	Description	Type
902-99.02	Pedestrian Push Button Stanchion	Each

Q. Push Button Extension

1.0 Description. This work shall consist of furnishing, installing, and placing an extension for the Accessible Pedestrian Signal (APS) push button detector. The extension should be installed according to all applicable portions of Sec. 902 and compatible with the APS assembly.

2.0 Basis of Payment. Payment for the push button extension will be for the following pay item:

Item Number	Description	Units
902-99.02	Misc. Push Button Extension	Each

R. Countdown Pedestrian Signal Heads

1.0 Description. This work shall consist of furnishing, installing and placing into operation any countdown, pedestrian signal heads.

2.0 System Requirements. Delete Sec. 1092.1.9 in its entirety and substitute the following:

1092.1.9 Pedestrian Signal Heads. Pedestrian signal heads shall be in accordance with ITE specifications and standards for pedestrian traffic control signal indications and the following:

(a) Pedestrian signal head housings shall be constructed of a one-piece, 0.250-inch (6 mm) thick, polycarbonate material as shown on the plans. The housing shall include an integral mounting bracket designed for side-of-pole mounting on all makes of signal poles with a terminal compartment and minimum 5-position, double-row terminal block.

(b) The door, lens and any openings in the housing shall have gaskets or seals to exclude dust and moisture from the inside of the compartment.

(c) Lenses shall be constructed of polycarbonate material.

(d) Pedestrian signal head units shall be provided with a manufactured preformed rectangular visor or screen-type louver.

(e) All plastic material shall be ultraviolet stabilized.

(f) Indications shall be ITE Class 3 symbol messages. The "Upraised Hand" symbol shall be illuminated with a filled, Portland orange LED module. The "Walking Person" symbol shall be illuminated with a filled, white LED module. The "Countdown" display numbers shall be illuminated with a Portland orange LED module. The LED modules shall be in accordance with applicable portions of Sec 1092.1.

(g) Pedestrian traffic control signal faces shall be constructed such that all messages are displayed from the same message-bearing surface having a black opaque background. The "Countdown" display shall be located to the right of the "Upraised Hand" and "Walking Person" symbols, which will be overlaid.

(h) Pedestrian signal heads require "Countdown" displays and shall have the following features:

(1) Display numbers must be two digits at least 9 inches in height.

(2) Shall only display the "Countdown" time during the pedestrian change interval. Time displayed shall be in seconds, and begin only at the beginning of the pedestrian change interval. The flashing "Upraised Hand" symbol shall be concurrently displayed during the pedestrian change interval. The total time displayed at the start of the pedestrian change interval shall be automatically adjusted by the pedestrian signal head and not require any manual settings or additional wiring to the signal cabinet.

(3) Once the "Countdown" display reaches "0", the "Countdown" display shall blank-out until the next pedestrian change interval begins.

(4) If the pedestrian change interval is interrupted or shortened as part of a transition into a preemption sequence, the “Countdown” display shall go dark immediately upon activation of the preemption transition.

(5) A test switch shall be provided in order to test the “Countdown” display.

3.0 Construction Requirements. Construction requirements shall conform to Sec 902.

4.0 Method of Measurement. Method of measurement shall conform to Sec 902.

5.0 Basis of Payment. Payment for pedestrian signal heads, including all materials, equipment, labor and tools shall be made and considered completely covered by the contract unit price bid for:


Item Number	Type	Description
902-99.02	Each	Countdown Pedestrian Signal Head, Type 1S

S. SL District Traffic Signal Detection System

1.0 Description. This work shall consist of providing detectors for signalized installations that will support advance traffic signal performance measures (ATSPM) on the Commission’s St. Louis District roadways. Detectors shall be in accordance with the Missouri Standard Specifications for Highway Construction (latest version) and installed to provide detection at locations as shown on the plans or as directed by the Engineer in accordance with Section 902. If any information conflicts between Section 902 and this JSP, the JSP shall supersede.

2.0 Detector Zones. The following detector zones shall be placed as shown in the plans:

- Stop Bar Detection
- Advance Upstream (Performance Measures)
- Dilemma Zone
- Turn Counts
- Advance Video Zones (if applicable)
- Radar Zones (if applicable)
- Advance Data Collector (if applicable)
- Bicycle/Pedestrian (see Section 2.2)

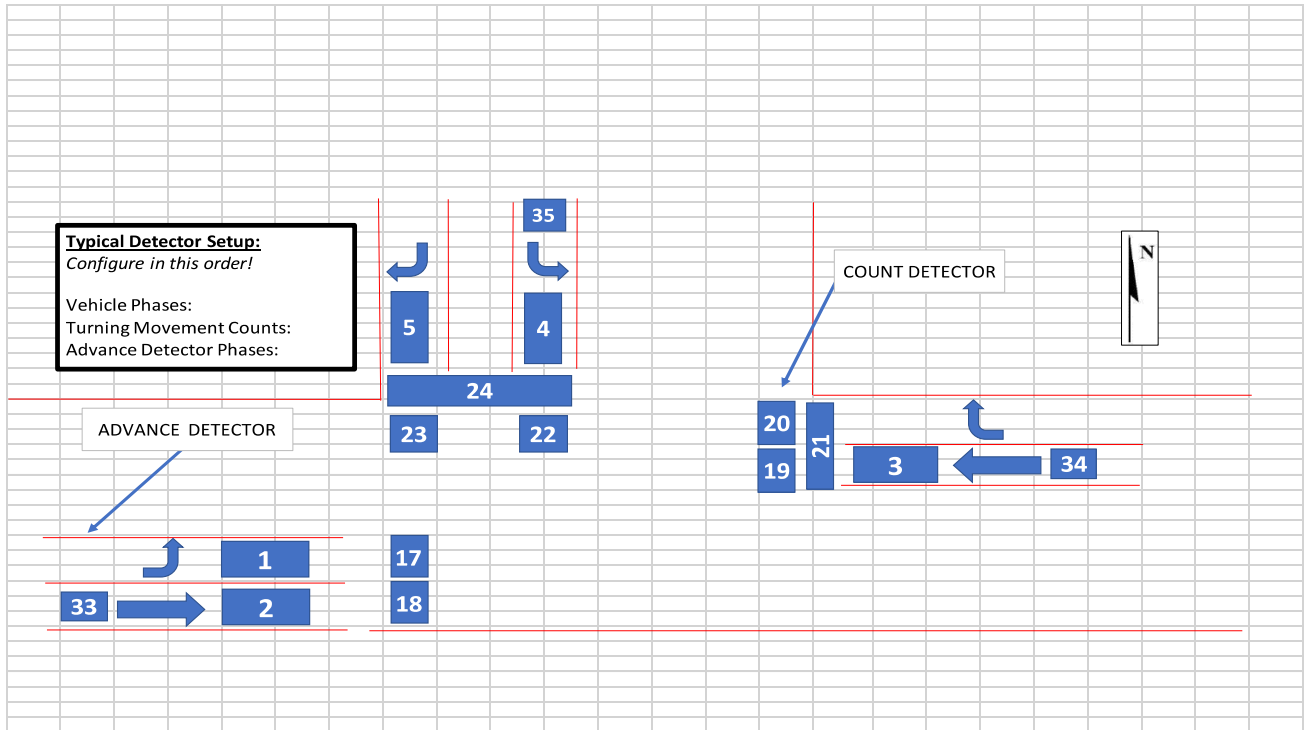

2.1 Dilemma Zones. Dilemma zone detection shall be required for the following approaches for high speed dilemma zone detection:

N/A

Dilemma zone detectors shall be placed at 5 secs and 8 seconds travel time before stop bar per below Table unless directed otherwise in the plans or by the Engineer.

Approach Speed (MPH)	Advance Detector Placement 5 secs Travel time	Advance Detector Placement 8 seconds travel time
35 mph	260	415
40 mph	295	470
45 mph	330	530
50 mph	370	590
55 mph	405	645
60 mph	440	705

2.2 Bicycle/Pedestrian Zones. Bicycle and/or pedestrian zones (if applicable) shall be provided as directed by the Engineer. Specific zone placement and description as required by vendor shall be reviewed and approved by the Engineer.

3.0 Performance Measures. In addition to presence detection, the detection system shall be capable of providing data to an advanced traffic signal controller that can perform at a minimum the following calculations in real time for each detection zone without the addition of another device:

- Speed
- Volume

- Lane Occupancy
- Vehicle Classification
- Other available performance measures

For speed calculations thru movements are required for all detection installations. Turning movement measurements are required for all detection installations. For volume measurements/calculations both mainline thru and all turning movements are required. All values are to be assigned to detector channels within the controller. Other performance measures must be clearly defined. In all cases all performances measures must be ultimately available in an easily usable, exportable format. Turning movement counts shall be installed per the detector setup diagram(s) above to include all lanes. The Contractor shall provide documentation to the Engineer to confirm the volumes are configured and operational through the detection system. The Contractor shall also provide a final schedule of detector assignments in the .pdf format to the Engineer and the Commission's signal maintenance supervisor. Performance measurement data must be configured and fed into the Commission's ATSPM platform with data storage confirmed, see Section 5.0. If utilized on the project, the Contractor's Traffic Engineer shall assist in this task.

4.0 Material. The Contractor can choose from the following list of detector types according to the exceptions noted below:

- Induction Loop
- Video Image
- Radar

Reference each detection type's subsection for specific allowable models. Unless otherwise specified on the plans, the Contractor may supply more than one type of detector and customize the installation based on field conditions, as approved by the Engineer.

4.1 Induction Loops. Induction loops, if selected, shall be in accordance with the Missouri Standard Specifications for Highway Construction (latest version) and shall be installed to provide detection at locations as shown on the plans or as directed by the Engineer in accordance with Section 902. Detector channels shall be assigned as per the layout in this JSP or as directed by the Engineer.

4.2 Video Detection. If video detection is selected, the following provisions shall also apply.

4.2.1 Description. The Contractor shall furnish and install all equipment, materials, software and other miscellaneous items that are required to provide a fully functional Video Detection System for the control of vehicular and pedestrian traffic signals.

4.2.2 Material. The video detection system shall consist of power supply, hard-wired video cameras, all necessary video and power cabling with end connectors, mounting brackets, surge protection as recommended by the manufacturer, video detection processors/extension modules capable of processing the number of camera and phase combination video sources shown on the project plans. The video detection system will be defined as the complete assembly of all required equipment and components for detection of vehicles. Each video detection system shall consist of the video camera(s), lightning arrester for video cabling, processor unit(s), control device (track ball or keypad; no mouse allowed), software and license for system control via a computer (if applicable), communication components, and a color monitor. The video detection system shall have the most current available firmware installed. All camera views shall be obtainable without

requiring the disconnection and reconnection of cables within the system. The video detection systems in the list below are the only systems that are tested, fully functional, and approved for use in the St. Louis District.

- Autoscope Vision
- Iteris Vantage Next
- Aldis Gridsmart Smart mount Camera (Performance Module to be included)

4.2.3 Installation Requirements. The video detection system shall be installed per the manufacturer's recommendations. The installer shall be certified by the video detection system's manufacturer to install the system. All CAT5 cable runs (if used) shall be continuous without splice from the cabinet to the camera. If requested by the engineer, a factory certified representative from the supplier shall be available for on-site assistance for a minimum of one day during installation. The bottom of the video camera shall be mounted per the manufacturer's recommendations, unless otherwise indicated on the plans or approved by the Engineer. The video detection system shall not be installed on pedestal signal unless otherwise directed by the Engineer. The video detection system shall not be installed on a 15' luminaire arm unless otherwise directed by the Engineer.

A separate grounded 120 VAC service outlet shall be provided in the controller cabinet for supplying power to the parts of the video detection system requiring AC power. Use of the grounded service outlet located on the cabinet door will not be permitted. The video detection system must integrate/be compatible with an Advanced Transportation Signal Controller (ATC).

4.2.4 Detection Zones. The detection zones shall be created by drawing the detection zones on the video image. A graphical user interface shall be built into the video detection system and displayed on a video monitor or computer. It shall be possible to edit previously defined detector configurations to fine-tune detection zone placement. When a vehicle is detected by crossing a detection zone, there shall be a visual change on the video display, such as a flashing symbol or a change in color or intensity to verify proper operation of the video detection system.

4.2.5 Performance. Overall performance of the video detection system shall be comparable to inductive loops. Using camera optics and in the absence of occlusion, the video detection system shall be able to detect vehicle presence with 98% accuracy under normal day and night conditions with only slight deterioration in performance under adverse weather conditions, including fog, snow and rain. When visibility exceeds the capabilities of the camera, the video detection system shall default to placing a call on all detectors. Supportive documentation is required to meet this specification and shall be provided to the Engineer before installation.

4.2.6 Monitor. The monitor shall be an LCD active matrix with a minimum 7" diagonal screen color monitor, an NTSC-M system and BNC video in-out connections built into the housing. The unit shall be compact and lightweight, securely mounted to the cabinet shelving, have low power consumption, constructed to operate under extreme temperature conditions, and run on AC power. AC adaptor shall be included. The monitor shall be installed to automatically power on when the cabinet door is opened and automatically power off when the cabinet door is closed. A manual on/off switch shall be provided.

4.2.7 Video Camera and Housing. The camera shall produce a color video image of vehicles during daylight hours, with an optional production of black and white images during nighttime hours. The video shall produce a clear image for scenes with a luminance from a minimum range of 0.18 to 929 foot-candles (2.0 to 10,000 lux). The camera shall provide a minimum resolution of

430 lines horizontal (TVL) and 350 lines vertical under NTSC operation. The camera shall include an electronic shutter or auto iris control based on average scene luminance and shall be equipped with an auto iris lens. sun shield that prevents sunlight from directly entering the lens. The sun shield shall include a provision for water diversion to prevent water from flowing in the camera field of view and shall be able to slide forward and back.

4.2.8 Video Detection System Connections. All bus connections in the video detection system shall be corrosion resistant. Serial communications to a computer shall be through an RS-232/RS-422 serial port through a subminiature "D" connector with a computer running supplied system software. The port shall have the capability to access detection system data as well as the real-time imagery needed to show detector actuations. The processor shall have a RJ-45 plug using Ethernet 10/100 protocols. The equipment shall be provided with either a NEMA TS1 or NEMA TS2 interface as shown on the plans.

For TS1 systems, the video detection system shall be equipped with a TS1 detector interface for a minimum of 32 detector outputs. Logic output levels shall be compatible with the TS1. A subminiature "D" connector on the video detection system shall be used for interfacing to these outputs.

The contractor shall be responsible for any changes or additions to either an existing or new cabinet in order to provide a properly functional video detection system and monitor display. This may include, but is not limited to, additional SDLC connectors, an MMU (malfunction management unit), shelf relocation and component reorganization. No direct pay for any changes or additions. All required connections will be considered part of the video detection system installation.

4.2.9 Documentation. The contractor shall provide one bound copy and one electronic version (.pdf format) of the user's manual.

4.3 Radar Detection. If radar detection is selected, the following provisions shall also apply.

4.3.1 Description. Provide, install and test continuous tracking advance detector (CTAD) units and cabinet interface to detect range, speed, and vehicle estimated time of arrival (ETA) to the stop bar for vehicles or clusters of vehicles moving in the user selected direction of travel. The CTAD shall also detect instantaneous roadway efficiency. This specification sets forth the provisions for a radar detection system that detects vehicles, pedestrians, bicycles, and motorcycles on roadways and provides vehicle presence and full-motion tracking.

4.3.2 Material

4.3.2.1 Stop Bar Detector. The radar detection systems in the list below are the only systems approved for use in the St. Louis District. Installation of radar detection systems shall follow both the below specifications and the manufacturer's instructions.

- WAVETRONIX SmartSensor
 - Matrix

Provide a radar detection system with the following features.

- Shall be able to track/detect a minimum of 64 objects
- Shall be able to operate in a temperature range between -30 degrees and 165 degrees F

- The detection zones shall be configurable based off several factors' such as classification, ETA, speed, presence, and delay.
- The radar sensor shall be forward fire
- The sensor shall operate in the 25 GHz band
- The sensor shall be housed in a sealed IP-67 enclosure

4.3.2.2 Advance Detector. The radar detection systems in the list below are the only systems approved for use in the St. Louis District. Installation of radar detection systems shall follow both the below specifications and the manufacturer's instructions.

- WAVETRONIX SmartSensor
 - Advance
 - Advance Extended
- Iteris Vector
- In addition to the specifications listed in Section 4.3.2.1, the detection range shall also cover the dilemma zone distances prescribed in section 2.1.

4.3.2.3 Power and Communications.

- Power and communications cabling shall be installed per manufacturer specifications
- The radar sensor shall operate at 24 VDC
- Power consumption shall be no more than 38 watts
- If required, the advance detection System shall include all equipment to communicate wirelessly.

4.3.2.4 Contact Closure Card. Any contact closure card shall be compatible with a NEMA detector rack and shall be installed per manufacturer specifications.

4.3.2.5 Lightning Surge Protection. The CTAD shall include surge protection hardware installed per manufacturer specifications. The hardware shall be accepted by the engineer before installation in the cabinet.

4.3.3 Construction Requirements.

4.3.3.1 Mounting Location. All mounting hardware shall be installed per manufacturers specifications. The CTAD shall be mounted as follows:

- at a height that is within the manufacturer's recommended mounting heights.
- The radar shall be positioned so that all detection zones needed for an approach can be captured.
- in a forward-fire position, looking towards either approaching or departing traffic.

4.3.3.2 Induction Card Rack Interface. Install a 4-position induction card rack with power supply and configure based on manufacturer's instructions to provide all needed detection outputs. Any power supply cards for the induction card rack needed for proper operation of the CTAD shall be provided and installed by the contractor.

4.3.3.3 Support. A factory certified representative from the supplier shall be available for on-site assistance for a minimum of one day during installation and shall provide two (2) days of local training after the CTAD has been installed and are operational.

4.3.3.4 Acceptance Testing. The contractor shall develop a proposed test procedure for the CTAD and submit it to the Engineer for approval. It must include visual verification of vehicle detections being received. Each detector shall be tested separately. Revise the proposed test procedure until it is acceptable to the Engineer. Provide all equipment and personnel needed to safely conduct the tests. Arrange for the Engineer's representative to witness the tests. Give the Engineer a report documenting the result of the tests.

4.3.4 Documentation and Software.

4.3.4.1 Prior to purchasing the CTAD system, the contractor shall submit five copies of catalog cut sheets and the environmental testing results to the Engineer for approval.

4.3.4.2 The contractor shall provide five copies of the operation and maintenance manuals for the CTAD system.

4.3.4.3 Contractor shall provide one copy of the software and any cables needed to interface with the system.

4.3.4.4 Contractor shall provide the CTAD installation kit, if applicable, to the Commission upon completion and acceptance of the project.

5.0 Communication with Advanced Transportation Management System (ATMS). The detection systems and all performance measure data should be fed directly into the Commission's current ATSPM platform (currently through TransSuite). All data must be online and verified by contractor to be fully operational and available for data output reporting via the Commission's ATSPM platform. In addition, the data storage for long-term storage use should be configured properly on the Commission's ATSPM platform. The Contractor shall be responsible for ensuring the firmware of all detection works with the Commission's ATSPM platform. If utilized on the project, the Contractor's Traffic Engineer shall assist in this task.

6.0 Technical Support for Detection System. The detection system(s) chosen for installation shall be free of defects in material and workmanship. For five (5) years, technical support from factory certified personnel or factory certified installers shall be available from the supplier. Ongoing software support by the supplier shall include updates for the processor unit and computer software and shall be provided at no cost during this two-year period. The update of the processor unit software to be NTCIP compliant shall be included. Detection system(s) must not be within 5 years of end of support or sale by manufacturer.

7.0 Construction Requirements. Construction requirements shall conform to Sec 902.

8.0 Method of Measurement. Method of measurement shall conform to Sec 902.

9.0 Basis of Payment. Measurement and payment for work covered by this specification shall include all equipment, materials, tools, labor, programming, testing, and documentation necessary to provide a detection system **per intersection** and shall be paid at the contract unit price as follows:

Item No.	Type	Description
902-99.02	Each	SL District Traffic Signal Detection System

T. Traffic Signal Maintenance and Programming

1.0 Description. Traffic signal maintenance and timing for this project shall be in accordance with Section 902 of the Standard Specifications, and specifically as follows.

2.0 Qualified Traffic Engineer

2.1 The contractor shall have an experienced traffic Engineer with a Professional Engineer's (PE) license in Missouri as well as a Professional Traffic Operations Engineer (PTOE) certification (hereafter referred to as "contractor's traffic Engineer") with the noted experience defined below. MoDOT shall approve the traffic Engineer prior to them being hired.

2.2 Experience. Any proposed contractor traffic Engineer shall be able to demonstrate personal successful previous experience in the following tasks:

2.2.1 Response. The contractor's traffic Engineer shall have the ability to be on site within 1 hour of being requested.

2.2.2 Corridor Management: Time/space diagram manipulation in order to successfully adjust offsets and splits for rapidly changing traffic demands.

2.2.3 Controller Programming: Ability to program by hand and by software Phase, TBC, and Coordination levels of Siemens controllers along with NTCIP-compatible controllers.

2.2.4 Intersection Programming: Implementation of adjusted and/or new timing plans as a result of changing traffic demand.

2.2.5 Signal Software: Use and understanding of both Siemens signal software and TransCore traffic control software.

2.3 The contractor shall submit the names(s) of proposed traffic engineer(s) and the name(s) all of other personnel on their proposed staff along with detailed experience in all tasks outlined in Paragraph 2.2 above. The Engineer reserves the right to reject any contractor traffic engineer, before the start of work, who does not have sufficient experience or, at any point during the project, which does not satisfy the requirements set forth within this Job Special Provision. A list of potential traffic engineers shall be submitted for review to the Project Manager and the Commission's Traffic Engineers prior to bid.

2.4 VPN Access. The Commission operates the noted signals through a central signal system which is capable of remote adjustments to controller programming.

2.4.1 The approved contractor's traffic Engineer and any staff assigned to manage the traffic signals during the project is encouraged to apply for VPN (Virtual Private Network) access with the Engineer once the project is awarded. If approved, the Engineer will assign a unique IP address to the contractor's traffic engineering staff, which will allow for remote access to the Commission's central signal control systems as appropriate and the ability to interface with the noted signals on this project.

3.0 Existing Traffic Signals and Communication System

3.1 The contractor shall notify the Engineer 3 weeks prior to the date of ramp bridge closure and detour implementation. The contractor shall meet with the Engineer's representatives to discuss their traffic mitigation plan at least 1 week before the date of the first closure and as needed between construction stages. Traffic mitigation plan should at a minimum include:

- Proposed Timing Plan changes and any models
- Anticipated locations of concern
- A map in electronic format displaying the locations and names of the signals and owning agency as detailed in Paragraphs 3.2 and 3.3 below.
- Other traffic mitigation efforts

3.2 Once a ramp closure has been implemented by the contractor, the contractor shall then be solely responsible for the following signals' controller programming until completion of all closures necessary to complete the contractor's work. Maintenance at these locations for items other than controller programming issues or incidents caused by controller programming or other construction done by the contractor shall remain with the Commission. If any part of an existing traffic signal or its controller within the limits of this project has otherwise been modified or adjusted by the contractor, or the contractor makes any roadway changes to reduce the traffic capacity through a signalized intersection within the limits of the project, or the contractor begins work at an intersection with signals already in operation, the contractor shall then be solely responsible for that signal's controller programming and all signal maintenance as specified in 902.2 and 902.3, except for power costs, until Final Acceptance of the project. Traffic signal maintenance and timing responsibilities shall be broken down in accordance with the below schedules:

Signals Affected:

MO 185 @ RT WW

3.3 The Engineer shall provide to the contractor 2 weeks' notice an electronic report on the existing phasing and timing of each traffic signal, which may be the contractor's responsibility to program. The Engineer's representative shall be available to the contractor before any changes are made to a signal or controller to answer any questions about the report. In lieu of the report, the contractor's traffic Engineer may obtain this information from the appropriate agency's central signal control system. Once the contractor has modified a signal or controller for any reason, the contractor shall be solely responsible for the existing timing plans and all subsequent timing changes.

3.4 The contractor shall notify the Engineer or representative of the changes no later than 1 working day after changes are programmed if unable to provide advance notice as specified in 902.2. In addition, the Contractor shall notify the Engineer and the Commission's Traffic Engineers within one (1) hour of successful implementation of the detour plan.

3.5 The contractor shall be solely responsible for maintaining the coordination at any affected signal to the satisfaction of the Engineer or representative until completion of work as set forth in section 3.2 of this provision. Maintenance of coordination may include the synchronization of the affected controller's internal time clocks to the second using an atomic clock, or other means approved by the engineer. If time clock synchronization is used, the contractor shall verify all affected controllers are synchronized at least 1 time per week with a report to the Engineer or

representative. This report will be in the form of a documentation record as spelled out in the Work Zone Traffic Management Plan.

4.0 Existing Traffic Signal Maintenance and Response

4.1 The contractor shall respond to any signal timing complaints or malfunction complaints for those locations detailed in Section 3.0 of this provision and as specified in Section 902.21.1. Response time shall be 1 hour for complaints received by the contractor between 6 AM and 6 PM on non-holiday weekdays, and 2 hours for all other times. For some cases (due to travel times or other extenuating circumstances) additional time may be acceptable within reason but must be approved by the engineer. These timeframes will replace the '24 hour' response time in Section 105.14 for any signal-related incidents, where the entire cost of the work, if performed by MoDOT personnel or a third party, will be computed as described in Section 108.9 and deducted from the payments due the contractor.

4.2 The contractor must supply a contact name and phone number who will be responsible for receiving signal timing complaints for the Engineer. These complaints may be forwarded directly to the contractor by someone other than the Engineer's representative and will not relieve the contractor from properly responding based on the response times of this Provision. The contractor shall respond to the Engineer and notify the Commission's Traffic Engineers and the representative within 12 hours of the complaint as to the remedy. The contractor shall submit to the Engineer's representative a weekly report of complaints received and remedies performed throughout the duration of the project.

5.0 Original Signal Controller Programming and Acceptance

5.1 The contractor will be responsible for restoring the original signal controller programming at existing intersections and coordination plans for each intersection immediately upon ramp re-opening. The Engineer shall preserve and house the original controller files and provide the contractor with access to those files to perform the restoration of the original plans. Normal plan restoration can be done by a manual command in the signal control system or a preprogrammed time-of-day command change. For any locations rendered offline at the time of re-opening, these locations shall be returned to normal operation by hand. The Contractor shall notify the Engineer and the Commission's Traffic Engineers within one (1) hour of removal of the detour plans. The contractor will be relieved of signal programming maintenance at an existing restored intersection once 48 consecutive hours have passed without a programming malfunction, including restoring normal signal programming to the satisfaction of the Commission. If an agency desires any changes from an original plan, the agency will assume immediate maintenance of the signal to implement desired changes.

6.0 Post Project Report

6.1 The contractor shall submit to the Engineer a post project report, four to six weeks after the final signal adjustments have been completed. The report shall include at a minimum an observation report, summary of timing changes and locations, summary of complaints, and any other pertinent information regarding the contractor's efforts for managing these signal corridors in one electronic document.

7.0 Deliverables

7.1 All deliverables mentioned in this provision shall be submitted to the Engineer in a timely manner to the satisfaction of the Engineer prior to receiving full compensation for this work.

- Experience submittal
- Preliminary Traffic Mitigation Plan
- Notification of Detour Implementation
- Time Base Reports, As Needed
- Complaint Resolutions
- Notification of Restoration to Normal Operations
- Post Project Report

8.0 Construction Requirements. Construction requirements shall conform to Sections 902, 1061 and 1092.

9.0 Method of Measurement. Method of measurement shall conform to Section 902.

10.0 Basis of Payment. Payment will be considered full compensation for all contractor services, installation, and labor to complete the described work:

Item No.	Type	Description
902-99.01	Lump Sum	Traffic Signal Maintenance & Programming

U. Coordination with ITS Staff and Utility Locates

1.0 Description. Any work that will impact the existing communications network must be coordinated with the Commission’s St. Louis District ITS staff. This includes but not limited to removal and replacement of any existing communications equipment, adding new devices and changes to power sources or disconnects. Minor modifications to the existing communications network can have significant impacts on the system and operation of other ITS and traffic signal systems.

1.1 MoDOT is a member of MO-One-Call System. Prior to any excavation or work within MoDOT Right-Of-way, the contractor must contact MO-One Call at 1-800-DIG-RITE and request for Utility Locates within noted project limits. If the scope of work contains modification, addition and/or expansion of existing underground MoDOT ITS, lighting, or signal facilities, the contractor must notify the MoDOT Utilities Locate staff prior to any work, in order for MoDOT to update MoDOT utility location records with Missouri One Call.

2.0 Contact. The contractor shall notify the ITS group via an email to SLITS@modot.mo.gov at least 2 days before any work that may impact the existing network communications. The contractor shall include the Job#, location and brief scope of work in the email’s subject line. The engineer shall be notified prior to making contact with ITS staff. For MoDOT Utility location updates, the contractor must contact MoDOT TMC at 314-275-1500 and ask for Utility Locate Section at least seven calendar days before performing any work.

3.0 The ITS and network devices located within the project limits are a crucial part of the traffic operation system for this area. It is imperative that the downtime be kept to a minimum when adding, removing, or modifying any existing ITS and network devices. This may require the contractor to perform work that will affect existing network devices during nighttime and/or weekend hours, at the discretion of the Engineer. Allowable timeframes for this work will be subject to the need for ITS devices in the area to be used to manage other traffic impacting workzones.

4.0 Basis of Payment. No direct payment shall be made for compliance with this provision.

V. MoDOT ITS Assets Relocation

1.0 Description. The work consist of relocating existing MoDOT Intelligent Transportation System (ITS) facilities (conduit, cable, and/or pull boxes) that may be in conflict with this project construction sections as noted in the plans.

2.0 Materials. The materials used for relocating MoDOT ITS facilities shall be per MoDOT Approved Product List (APL) and meet all MoDOT Specifications. If the material is not in the APL, the contractor shall submit material specification documents to the Engineer and the MoDOT ITS group (via an email in advance to SLITS@modot.mo.gov) for review and approval.

3.0 Construction Requirements. The Contractor shall be aware there are numerous utilities present along the route in this contract. Utility locates were not performed during the design phase of the project; therefore, the extent of conflicts with utilities are unknown.

3.1 The contractor shall be aware there are numerous utilities present along the route in this contract. Utility locates were not performed during the design phase of the project; therefore, the extent of conflicts with utilities are unknown.

3.2 The contractor shall exercise reasonable care relocating MoDOT ITS Assets. Damage to any MoDOT facilities within the area of work caused by the contractor will be deemed by the Engineer as either “non-emergency” or “emergency” upon notification of the damages. Repair to damages will be performed as follows:

- a) Non-Emergency: Contractor will have 4 hours to propose a repair plan to the Engineer for a complete repair within 3 business days.
- b) Emergency: Upon notification of the damage, Contractor must immediately submit a repair plan to the Engineer which will take no more than 4 hours to respond on-site and complete repairs within 48 hours of notification of damage.
- c) In either case, if the proposed plan is unacceptable for any reason to MoDOT, repairs will be made by MoDOT with all costs billed to the Contractor.

3.3 The ITS In-Ground Facilities located within the project limits are a crucial part of the traffic operation system for this area. It is imperative that the downtime be kept to a minimum when replacing, removing, or modifying any existing ITS In-Ground Facilities.

3.4 Prior to any in-ground work, the Contractor shall request for utility locates by contacting Missouri One Call (1-800 DIG-RITE or mo1call.com) for any in-ground installation locations as per plans. If there are any conflicts with MoDOT ITS Assets, the Contractor is responsible for relocation to the satisfaction of the Engineer prior to any in-ground work.

3.5 In the case of a conduit conflict, the Contractor shall trench an area beyond the in-ground work limits, install one or two conduits (must be the same quality as the existing conduit) using Split Duct Method, relocate the existing cables into the new conduit, and seal the conduit joints per manufacturer specifications.

3.6 The Contractor shall coordinate this work with the MoDOT ITS group and have the Engineer's approval prior to performing this task.

3.7 The contractor shall perform a fiber testing (see below requirements) before and after relocating MoDOT fiber cables at the nearest Node Cabinet at each site as shown on the plans and submit that report to the SLITS Group for review and approval.

3.7.1 Test Procedure. For each fiber link, follow this procedure:

- (a) If the link includes fiber installed by others, use an optical loss test set to measure and record the optical loss over that portion of the link before it is spliced to new fiber.
- (b) Calculate the maximum allowable loss for the completed link, both at 1310 nm and at 1550 nm. Use the following formula:

$$\begin{aligned} \text{Maximum link loss} = & \text{Measured loss over portion installed by others} \\ & + (\text{Fiber length in km}) \times (0.35 \text{ for } 1310 \text{ nm and } 0.25 \text{ for } 1550 \text{ nm}) \\ & + (\text{Number of fusion splices}) \times (0.05) \\ & + (\text{Number of mechanical splices [for temp. connection]}) \times (0.3) \\ & + (\text{Number of connections}) \times (0.5) \end{aligned}$$

Provide this calculation to the engineer along with the test results.

- (c) Calibrate an optical loss test set and provide evidence satisfactory to the engineer that the set produces accurate results at both wavelengths. This can be a demonstration that the set correctly measures the loss of a test fiber whose loss is known.
- (d) Use the test set to measure the loss of the link under test. Record the result at both 1310 nm and 1550 nm. Arrange for the engineer or his representative to witness these tests.
- (e) If the measured loss exceeds the calculated maximum, use an optical time domain reflectometer and other test equipment to troubleshoot the link. Take whatever corrective action is required, including cable replacement, to achieve a loss less than the calculated maximum.

3.7.2 Test Result Documentation. Prepare a diagram showing all of the links tested in this project. For the portions installed in this project, show the equipment cabinets, splices, and pigtails. On each line representing a link, show the maximum allowable loss and the actual loss. The actual loss shall be the one measured after all corrective actions have been taken. Submit 5 copies of this diagram to the engineer, along with the calculations for the maximum allowable loss. Submit the diagrams and calculations in an electronic format acceptable to the engineer.

3.7.3 Documentation. Provide the engineer mark-ups of the plans, neat and legible, illustrating as-built versions of the splice and connection diagrams that are contained in the plans.

3.7.4 Certifications. The fiber optic cable shall be factory certified to meet the requirements in this specification. In addition, the manufacturer shall certify that the fiber optic cable has a life expectancy of 20 years.

3.8 The Contractor shall trench an area beyond the in-ground work limits, install one or two conduits (must be the same quality as the existing conduit) using Split Duct Method, relocate the existing cables into the new conduit, and seal the conduit joints per manufacturer specifications.

3.9 Upon completion of this work, the Contractor shall contact the MoDOT ITS group (via email at slits@modot.mo.gov) to verify that all existing MoDOT ITS devices are online and request inspection of this work. Acceptance of this work shall be the sole judgment of the Engineer and the MoDOT ITS group's engineer.

3.10 The contractor shall restore those areas disturbed by this work or installation according to specifications herein.

4.0 **Basis of Payment.** Payment for "MoDOT ITS Assets Relocation" shall be paid as Linear Feet and shall include the trenching, conduit installation, conduit coupling, pull boxes, sealing materials, cable relocation, needed fiber testing, restoration of all disturbed area, all labor and work incidental thereto, and shall be considered to be completely covered by the contract unit price for the following pay item:

Item No.	Unit	Description
910-99.03	Linear Feet	MoDOT ITS Assets Relocation

W. MoDOT ITS Equipment Within Project Limits

1.0 **Description.** MoDOT owned fiber optic cable and conduit, critical MoDOT power supplies and power cables, and pull boxes for fiber and power cabling and other above and underground ITS (Intelligent Transportation System) facilities are present within the limits of this project. Damage or interruption of these items can cause extensive outages to the MoDOT network.

2.0 **Construction Requirements.** The contractor shall exercise reasonable care while completing work near these facilities, and shall take steps necessary to protect these facilities from damage for all items that are not specifically identified as being removed and/or relocated in the plans. Should any of the existing wiring or conduit be damaged by the contractor, it shall be replaced at the contractor's expense and the system in full operation within **4** hours of when the damage occurred. If it is mutually agreed upon between the Commission and the Contractor that the repairs will require more than **4** hours to complete, a mutually agreed upon time for repairs to be complete will be determined.

2.1 The contractor shall not modify any existing network or electrical connections within equipment cabinets, unless coordinated with MoDOT ITS staff. Existing connections include, but are not limited to, fiber jumpers, CAT5(e) cables, power supplies, and power strips. The connection to specific fiber and copper ports on network equipment shall also not be modified, unless coordinated with MoDOT ITS staff, as the network equipment has been configured specifically for each equipment cabinet. Significant network outages and unnecessary troubleshooting to investigate outages can occur, even with minor changes to existing connections within the cabinet.

3.0 **Liquidated Damages.** In the event of damage, if the system is not repaired and in full operation within **4** hours of the damage occurring, or within the timeframe agreed upon, the contractor will be charged with a liquidated damage specified in the amount of \$100.00_per hour

for each full hour that the system is not fully operational. This damage will be assessed independently of the liquidated damages specified elsewhere in the contract.

3.1 The MoDOT Engineer will also have the option of issuing a work order for MoDOT’s on-call ITS Maintenance contractor to make repairs, if it is the Engineer’s opinion that the contractor creating the damage will not be able to make repairs in a timely manner. Contractor’s reimbursement for MoDOT expense for this option shall be in addition to the liquidated damages.

4.0 Basis of Payment. No direct payment shall be made for compliance with this provision.

X. Pull Box Adjustment

1.0 Height Adjustment. Regardless of type or size the pull boxes shown in the plans require adjustment to match the new grade of the roadway, ramp, landing, sidewalk, slope.

2.1 The contractor shall notify the engineer if boxes belonging to utilities other than MoDOT are encountered that will require adjustment. The contractor shall coordinate work with the affected utility to ensure that the completed facilities meet ADA requirements.

3.0 Basis of Payment. All costs associated with compliance with this special provision for all material, equipment, and labor shall be completely covered by the contract unit price for:

Item No.	Type	Description
902-99.02	Each	Pull Box Adjustment

Y. Utilities JSP-93-26F

1.0 For informational purposes only, the following is a list of names, addresses, and telephone numbers of the known utility companies in the area of the construction work for this improvement:

<u>Utility Name</u>	<u>Known Required Adjustment</u>	<u>Type</u>
Crawford Electric Brett Palmer Phone: (573) 732-4415 ext. 179 Email: B.Palmer@Crawfordelec.com	None	Electric
AT&T Distribution Justin Courtouise Phone: (636) 448-2136 Email: jc670s@att.com	None	Communications

CHARTER COMMUNICATIONS Jordan Staat Phone: (314) 393-3321 Email: Jordan.staat@charter.com	None	Communications
Clearwave Communications Roger Halmick Phone: 573-468-1082 Email: Roger.Halmick@fidelitycommunications.com	None	Communications
City of Sullivan Electric Joe Thurmond, Electric Commissioner 305 N Park Street Sullivan, MO 63080 573-468-4712	None	Electric
City of Sullivan Water and Sewer Robert J. Schaffer, PE, CFM 210 West Washington Sullivan, MO 63080 Telephone: 573.468.8965 Email: rschaffer@sullivan.mo.us	None	Water and Sewer
LUMEN Rich Obremski Phone: (314) 378-9931 Email: Richard.Obremski@Lumen.com	None	Communications
Spire MO East Brian Langenbacher Cell: 314.768.7767 Office: 314.713.6572 *902 Email: brian.langenbacher@spireenergy.com	None	Gas

1.1 The existence and approximate location of utility facilities known to exist, as shown on the plans, are based upon the best information available to the Commission at this time. This information is provided by the Commission "as-is" and the Commission expressly disclaims any representation or warranty as to the completeness, accuracy, or suitability of the information for any use. Reliance upon this information is done at the risk and peril of the user, and the Commission shall not be liable for any damages that may arise from any error in the information. It is, therefore, the responsibility of the contractor to verify the above listing information indicating existence, location and status of any facility. Such verification includes direct contact with the listed utilities.

2.0 The Contractor shall be aware there are numerous utilities present along the routes in this contract. **No Utility adjustments are anticipated for this project. The contractor shall adjust guardrail post spacing as necessary to avoid utility conflicts and pothole as necessary.**

No direct payment will be made for compliance to the above note provision.

Z. ADA Curb Ramps

1.0 Description. This work shall consist of constructing new concrete curb ramps that are compliant with current Americans with Disabilities Act (ADA) and MoDOT guidelines at locations shown on the plans and as directed by the engineer. Providing work zone protections for pedestrians will be a primary component of this project. Specifically, this work shall consist of providing pedestrian detours, including all necessary designing of specific detour routes, placing of signing, barricades, and channelizing. Nothing in this provision shall be construed to limit contractor innovation in mitigating pedestrian traffic impacts. All revisions shall be submitted to the engineer in writing 3 days prior to approval.

1.1 The contractor shall assure that the persons establishing the grades of the ADA facilities have a copy of ADA related provisions at hand for reference including the construction ADA checklist, ADA related JSPs, plans, and standard plans. If it is found that written provisions for ADA facilities are not at hand, the engineer may cause ADA work to be ceased until a copy arrives.

2.0 Construction Requirements. Except as noted herein, all applicable provisions in Sec 608 for construction of curb ramps shall apply. Items and materials used for pedestrian traffic control shall be in accordance with Section 616 of the Missouri Standard Specifications for Highway Construction of the version current at the time of the bid opening, as applicable.

2.1 The area to be removed and/or constructed under this provision includes the entire curb ramp, flares, landing pads, truncated domes, sidewalk, and any curbs, including variable height curbs.

2.1.1 Asphalt Mill and fill may be necessary at the face of the ADA ramp to provide a smooth transition from the roadway to the ramp or to drain storm water away from the ADA ramp. The contractor shall establish the grade of the flow line of the gutter before establishing the grades of ADA facilities. Running or standing storm water shall not be pushed out into the roadway by the asphalt where it may be splashed on pedestrians by passing vehicles or cause a hydroplaning hazard. The asphalt mill and fill shall be a minimum of 1.75 inches thick and the edges shall be at a smooth milled butt joint. The contractor shall use an approved BP-1 mix for all corner asphalt mill and fill work unless otherwise specified elsewhere in the contract. Asphalt mill and fill is included in the work of ADA Curb Ramps. If asphalt mill and fill is needed at a corner without any other ADA work, it will be found as a separate line item in this contract.

2.2 Recommendations for the design type of each curb ramp to be built on this project are shown on the plans. These curb ramps may vary from the original design in size, shape, and location as necessary to comply with ADA laws. It is the contractor's responsibility to inspect locations in the field before bidding to verify quantities needed to satisfy this provision.

2.2.1 ADA provides some exceptions to ramp slope where space limitations exist. The apparent construction limits shown on the plans are not considered a space limitation. The use of these exceptions will not be considered by the engineer unless the length needed for compliance goes beyond 10 additional feet as shown as the plans are interpreted by the engineer. The contractor shall not place any ADA exceptions without consulting the engineer on a case-by-case basis.

2.3 Work Area Safety. The contractor shall maintain a work area that is safe for pedestrians. The areas adjacent to the contractor's physical work site shall also be maintained as needed to provide access to adjoining properties, regardless of whether a detour route is in place. All holes shall be covered with secured plywood or steel plates, and the work area walkways shall be free of trip hazards, loose debris, vehicles, materials, and equipment when the contractor is not in the work area. A 3 foot minimum path shall be maintained on any used-in-place walkway needed for access. The contractor shall not be permitted to park on any walkway solely to avoid the need for a lane closure. Items for lane closures are provided in the plans and quantities. The contractor shall fence in his work area to provide no access to the general public during the construction of the project.

2.4 Prosecution of Work. The contractor shall have all necessary personnel, equipment, and materials at hand for all work at each location before the work begins so that work may proceed without delay. Curb ramp work on each street corner shall be completed 84 hours after work begins on that corner, including adjusting pull boxes, placing sod, placing curb, or any other incidental work. The contractor shall be allowed to work at no more than two corners of an intersection at any time, regardless of the amount of work at each intersection.

2.4.1 Pedestrian Detours. The contractor may exempt themselves from the above 84-hour provision by providing and maintaining a signed pedestrian detour at their own cost on a route with equal or better ADA accessibility than the closed pathway if such routes exist. Pedestrian detours shall be approved by the engineer. Since MoDOT may not own the right-of-way of the detour path, the contractor shall ascertain that the detour route will remain open during its planned use as a detour. The contractor shall inform the engineer of their plans to use a detour not less than three weeks before it is set up.

2.4.2 Detour Locations. Pedestrian detours are to cross the street or go around the block where facilities exist. It may be possible to provide one detour for more than one corner/work location; the quantity for pedestrian detours will be based on the number of work locations needing detours and not on the number of detours actually used. The detour routes shall have equal or better accessibility than existing in the construction location and shall be approved by the engineer. Detours may also use roadway shoulders with sufficient width to provide for pedestrians, and the traffic control to protect them, and where parking is not allowed, provided drainage structures are not a hazard.

At locations where an pedestrian detour is not feasible, the contractor has the option of staging work to maintain a 3' minimum pathway, providing a temporary pathway (3' minimum width) that does not reduce the number of through lanes of the roadway, or providing a full closure with signs for a maximum of 84 hours to reopen the walkway to pedestrian traffic in its final configuration. Locations for full closure shall be submitted to the engineer in writing 2 weeks prior to beginning work, and signs shall be placed announcing the closure 1 week before work begins.

2.5 Liquidated Damages. If work associated with curb ramp modification begins but is not complete and open to pedestrian traffic within **84 hours** of commencement, the Commission, the traveling public, and state and local police, and governmental authorities will be damaged in various ways, including but not limited to, increased construction administration cost, potential liability, traffic and traffic flow regulation cost, and pedestrian delay, with its resulting cost to the traveling public. These damages are not reasonably capable of being computed or quantified.

Therefore, the contractor will be charged with liquidated damages specified in the amount of **\$250.00 per hour** of delay that closes a walkway in excess of 84 hours. The contractor's

superintendent and the engineer shall be on site at the time of any closures, and shall both record an agreed time when the walkway was closed. It shall be the responsibility of the engineer to determine the quantity of excess closure time.

2.5.1 The said liquidated damages specified will be assessed regardless if whether it would otherwise be charged as liquidated damages under the Missouri Standard Specification for Highway Construction. There shall be no permitted excuse for delay of the work, including weather.

2.6 The curb ramps to be modified per this provision vary in size. It is the contractor's responsibility to verify actual quantities needed to satisfy this provision.

2.7 The truncated domes shall come from Pre-Qualified List FS-1067 Table 1.

3.0 Method of Measurement. Final measurement will not be made except for authorized changes during construction or where appreciable errors are found in the contract quantity. The revision or correction will be computed and added to or deducted from the contract quantity.

Item No.	Units	Description
608-99.02	Each	ADA Curb Ramp

No direct payment will be made for any excavating or preparing of the subgrade, furnishing or installing reinforcement, any incidental work required for furnishing and installing tie bars, tinting of concrete surface as required in the plans, 4" Type 5 aggregate base, truncated domes, sod, or asphalt mill and fill required to transition the new ramp to existing pavement or to drain the sidewalk, warping sidewalk to meet existing sidewalk sections, relocating or resetting granite curb, the removal and replacement of existing curb/curb and gutter, the removal of existing concrete slabs, saw cuts, or other work necessary in the satisfactory completion of this provision.

AA. Airport Requirements JSP-15-09

1.0 Description. The project is located near a public use airport or heliport or is more than 200 feet above existing ground level, which requires adherence to Federal Aviation Regulation Part 77 (FAA Reg Part 77). "Near" to a public use airport or heliport is defined as follows:

- 20,000 feet (4 miles) from an airport with a runway length of at least 3,200 feet
- 10,000 feet (2 miles) from an airport with runway length less than 3,200 feet
- 5,000 feet (1 mile) from a public use heliport

2.0 The maximum height of the improvement and the equipment operating while performing the improvements was assumed to be 15.0 feet above the current travelway during the process of evaluating the project for compliance with FAA Reg Part 77.

2.1 If the contractor's height of equipment or if the improvement itself is beyond the assumed height as indicated in Sec 2.0, the contractor will work with the resident engineer to fill out the Form 7460-1, or revise the original Form 7460-1 based upon the proposed height and resubmit, if necessary, for a determination by FAA on compliance with FAA Reg Part 77. Further information can be found in MoDOT's Engineering Policy Guide 235.8 Airports. If the Form 7460-

1 must be filed, the associated work shall not be performed prior to the FAA determination, which could take up to 45 days.

2.2 If the contractor's height of equipment and the improvement itself is below the assumed height as indicated in Sec 2.0, no further action is necessary to fulfill the requirements set forth in FAA Reg Part 77.

3.0 Basis of Payment. There will be no direct payment for any work associated with this provision. Contract time extension will be given for the time necessary to obtain or revise the FAA permit. Any delays or costs incurred in obtaining the revised permit will be noncompensable.

BB. Lump Sum Temporary Traffic Control JSP-22-01A

1.0 Delete Sec 616.11 and insert the following:

616.11 Method of Measurement. Measurement for relocation of post-mounted signs will be made to the nearest square foot of sign area only for the signs designated for payment on the plans. All other sign relocations shall be incidental. Measurement for construction signs will be made to the nearest square foot of sign area. Measurement will be made per each for each of the temporary traffic control items provided in the contract.

616.11.1 Lump Sum Temporary Traffic Control. No measurement will be made for temporary traffic control items grouped and designated to be paid per lump sum. The list of lump sum items provided in the plans or contract is considered an approximation and may be subject to change based on field conditions. This is not a complete list and may exclude quantities for duplicate work zone packages used in simultaneous operations. The contractor shall provide all traffic control devices required to execute the provided traffic control plans for each applicable operation, stage, or phase. No measurement will be made for any additional signs or devices needed except for changes in the traffic control plan directed by the engineer.

2.0 Delete Sec 616.12 and insert the following:

616.12 Basis of Payment. All temporary traffic control devices authorized for installation by the engineer will be paid for at the contract unit price for each of the pay items included in the contract. Whether the devices are paid individually, or per lump sum, no direct payment will be made for the following:

- (a) Incidental items necessary to complete the work, unless specifically provided as a pay item in the contract.
- (b) Installing, operating, maintaining, cleaning, repairing, removing, or replacing traffic control devices.
- (c) Covering and uncovering existing signs and other traffic control devices.
- (d) Relocating temporary traffic control devices, including permanent traffic control devices temporarily relocated, unless specifically included as a pay item in the contract.
- (e) Worker apparel.

- (f) Flaggers, AFADs, PFDs, pilot vehicles, and appurtenances at flagging stations.
- (g) Furnishing, installing, operating, maintaining, and removing construction-related vehicle and equipment lighting.
- (h) Construction and removal of temporary equipment crossovers, including restoring pre-existing crossovers.
- (i) Provide and maintaining work zone lighting and work area lighting.

616.12.1 Lump Sum Temporary Traffic Control. Traffic control items grouped together in the contract or plans for lump sum payment shall be paid incrementally per Sec 616.12.1.1. Alternately, upon request from the contractor, the engineer will consider a modified payment schedule that more accurately reflects completion of traffic control work. No payment will be made for any additional signs or devices needed except for changes in the traffic control plan directed by the engineer. Additional items directed by the engineer will be paid for in accordance with Sec 109.4. No adjustment to the price will be made for overruns or underruns of other work or for added work that is completed within existing work zones.

616.12.1.1 Partial payments. For purposes of determining partial payments, the original contract amount will be the total dollar value of all original contract line items less the price for Lump Sum Temporary Traffic Control (LSTTC). If the contract includes multiple projects, this determination will be made for each project. Partial payments will be made as follows:

- (a) The first payment will be made when five percent of the original contract amount is earned. The payment will be 50 percent of the price for LSTTC, or five percent of the original contract amount, whichever is less.
- (b) The second payment will be made when 50 percent of the original contract amount is earned. The payment will be 25 percent of the price for LSTTC, or 2.5 percent of the original contract amount, whichever is less.
- (c) The third payment will be made when 75 percent of the original contract amount is earned. The payment will be 20 percent of the price for LSTTC, or two percent of the original contract amount, whichever is less.
- (d) Payment for the remaining balance due for LSTTC will be made when the contract has been accepted for maintenance or earlier as approved by the engineer.

616.12.1.2 Temporary traffic control will be paid for at the contract lump sum price for Item:

Item No.	Unit	Description
616-99.01	Lump Sum	Misc. Lump Sum Temporary Traffic Control

CC. NTCIP Compliant Changeable Message Sign (Contractor Furnished and Retained)

1.0 Description. All solar powered changeable message signs, hereinafter referred to as a CMS, shall be in accordance with these specifications.

2.0 Material. Each CMS shall consist of an all LED (light emitting diode) matrix message board, solar/battery power supply and a user-operated interface, as specified, all mounted on a heavy duty, towable trailer.

2.1 Each CMS shall be either Full Matrix or Character Matrix, and have the following minimum characteristics:

- (a) Full Matrix - Each CMS shall be the Full Matrix type with the capability of providing one, two, and three lines of individual changeable characters with minimum heights of 52 (1300), 28 (700), and 18 (450) inches (mm), respectively. Full Matrix signs shall be capable of both static and dynamic graphics, and full display sized messages.
- (b) Character Matrix (Three Line) – Each CMS shall consist of a minimum of three lines containing eight individual changeable characters per line. Each character shall be a minimum of 12 inches wide and 18 inches (450 mm) high.
- (c) Sign firmware shall comply with the current FHWA and DOT (Department of Transportation) NTCIP standards and support all NTCIP mandatory objects.
- (d) Physical access to the onboard computer shall be protected by a padlock or other locking handle mechanism. Electronic access to the onboard computer shall be protected by a username and password.

2.2 Full matrix CMS and character matrix CMS shall meet the following:

- (a) The overall sign dimensions shall not be less than 72 inches (1800 mm) high x 126 inches (3150 mm) wide.
- (b) The CMS shall be legible up to a distance of 650 feet (200 m) for both day and night operations and shall be visible for ½-mile (800 m) with 18 inch (450 mm) characters.
- (c) When fully raised in the display position, the bottom of the CMS board shall be at least a height of 7 feet (2100 mm) from the ground and shall be able to rotate a complete 360 degrees atop the lift mechanism. A sight tube, used to aim the CMS board to oncoming traffic, shall be installed on the CMS board or mast. The CMS shall have an electrical hydraulic lifting mechanism that includes a manual lifting and lowering relief mechanism as a backup. It also must be able to be locked into various viewing angles as determined best for the motorists by the CMS operator.
- (d) All LED displays and control circuitry shall be operational from -20 F (-29 C) to 120 F (50 C). The LED's shall have a rated life of 100,000 hours. The LED's shall be ITE amber in color on a flat black background.
- (e) The CMS face shall be constructed that if an individual panel or pixel fails the rest of the face shall continue to display the message.
- (f) The unit shall be able to withstand a 65-mph (105-kmph) maximum road wind speed. The trailer shall be able to support the fully extended CMS board in an 80-mph (130-kmph) wind load.
- (g) Solar charging system shall allow for total autonomy of 24/7/365 continuous operation.

- (h) All exterior surfaces except the sign face shall be cleaned, primed, and finished with two coats of Highway Safety Orange and the sign interior itself shall be cleaned and finished with one coat of corrosion inhibiting primer and two coats of flat black. The sign face shall be covered with a rigid translucent material to prevent damage to the sign face caused by the environment.

3.0 Construction Requirements. Prior to placing a CMS on a project, the engineer shall verify proposed CMS location is void of conflict with another DMS or CMS locations presently established. If a conflict is present, the engineer shall contact the Traffic Management Center (TMC) at 314-275-1526 to mitigate. If no conflict is present, engineer shall provide Traffic Management Center (TMC) with the Job Number, Route, County, specific CMS location, and a CMS identification number that is permanently affixed to the CMS. The engineer and contractor shall verify the message displayed on board is compliant with CMS messaging policies. The contractor shall place the CMS 6 feet [2 meters] off of the right edge of shoulder at the location shown on the plans or as directed by the engineer. The CMS shall be placed so that the right side of the unit is advanced approximately 3 degrees ahead with the direction of traffic. CMS shall not be located in medians. CMS shall be delineated with a minimum of five non-metallic channelizing devices. Installation, including location and placement, shall be approved by the engineer. If needed, the contractor shall relocate the CMS as directed by the engineer.

3.1 When not in use, the CMS shall be stored no closer than 30 feet [10 meters] to the edge of pavement carrying traffic, unless it is in a properly protected area or an off-site storage area or as otherwise directed by the engineer.

4.0 Basis of Payment. All expenses incurred by the contractor in integrating, maintaining, relocating, operating, and protecting the changeable message signs as outlined above shall be paid for at the contract unit price for Item 616-99.02 Changeable Message Sign, Contractor Furnished and Retained, per Each.

4.1 Cost for channelizers shall be included in the contract unit price for CMS.

Item Number	Unit	Description
616-99.02	EACH	NTCIP Compliant Changeable Message Sign (Contractor Furnished and Retained)

DD. Shaping Slopes Class III (Modified Material Requirements) NJSP-20-03B

Delete Sec 215.1.3 and 215.1.3.1 and substitute the following:

215.1.3 Shaping Slopes, Class III, shall consist of providing rock fill material and shaping slopes to construct additional shoulder width for the installation of guardrail and Type A crashworthy end terminals in accordance with Missouri Standard Plans for Highway Construction. The rock fill material used shall meet the requirements specified in Sec 215.1.3.1. The shoulder surface shall be finished smooth such that it is traversable and without significant voids or depressions.

215.1.3.1 Material Requirements. Rock fill material used for Shaping Slopes, Class III, shall consist of a durable crushed stone, shot rock or broken concrete, with a predominant size of 3 inches and a maximum size of 6 inches. Acceptance by the engineer will be made by visual inspection.

215.4 Basis of Payment. The accepted quantity will be paid at the contract unit bid price for:

Item Number	Type	Description
215-99.10	100 LF	Misc. Shaping Slopes Class III – Modified Material Requirement

EE. Contractor Quality Control NJSP-15-42

1.0 The contractor shall perform Quality Control (QC) testing in accordance with the specifications and as specified herein. The contractor shall submit a Quality Control Plan (QC Plan) to the engineer for approval that includes all items listed in Section 2.0, prior to beginning work.

2.0 Quality Control Plan.

- (a) The name and contact information of the person in responsible charge of the QC testing.
- (b) A list of the QC technicians who will perform testing on the project, including the fields in which they are certified to perform testing.
- (c) A proposed independent third party testing firm for dispute resolution, including all contact information.
- (d) A list of Hold Points, when specified by the engineer.
- (e) The MoDOT Standard Inspection and Testing Plan (ITP). This shall be the version that is posted at the time of bid on the MoDOT website (www.modot.org/quality).

3.0 Quality Control Testing and Reporting. Testing shall be performed per the test method and frequency specified in the ITP. All personnel who perform sampling or testing shall be certified in the MoDOT Technician Certification Program for each test that they perform.

3.1 Reporting of Test Results. All QC test reports shall be submitted as soon as practical, but no later than the day following the test. Test data shall be immediately provided to the engineer upon request at any time, including prior to the submission of the test report. No payment will be made for the work performed until acceptable QC test results have been received by the engineer and confirmed by QA test results.

3.1.1 Test results shall be reported on electronic forms provided by MoDOT. Forms and Contractor Reporting Excel2Oracle Reports (CRE2O) can be found on the MoDOT website. All required forms, reports and material certifications shall be uploaded to a Microsoft SharePoint® site provided by MoDOT, and organized in the file structure established by MoDOT.

3.2 Non-Conformance Reporting. A Non-Conformance Report (NCR) shall be submitted by the contractor when the contractor proposes to incorporate material into the work that does not meet the testing requirements or for any work that does not comply with the contract terms or specifications.

3.2.1 Non-Conformance Reporting shall be submitted electronically on the Non-Conformance Report form provided on the MoDOT Website. The NCR shall be uploaded to the MoDOT SharePoint® site and an email notification sent to the engineer.

3.2.2 The contractor shall propose a resolution to the non-conforming material or work. Acceptance of a resolution by the engineer is required before closure of the non-conformance report.

4.0 Work Planning and Scheduling.

4.1 Two-week Schedule. Each week, the contractor shall submit to the engineer a schedule that outlines the planned project activities for the following two-week period. The two-week schedule shall detail all work and traffic control events planned for that period and any Hold Points specified by the engineer.

4.2 Weekly Meeting. When work is active, the contractor shall hold a weekly project meeting with the engineer to review the planned activities for the following week and to resolve any outstanding issues. Attendees shall include the engineer, the contractor superintendent or project manager and any foreman leading major activities. This meeting may be waived when, in the opinion of the engineer, a meeting is not necessary. Attendees may join the meeting in person, by phone or video conference.

4.3 Pre-Activity Meeting. A pre-activity meeting is required in advance of the start of each new activity, except when waived by the engineer. The purpose of this meeting is to review construction details of the new activity. At a minimum, the discussion topics shall include: safety precautions, QC testing, traffic impacts, and any required Hold Points. Attendees shall include the engineer, the contractor superintendent and the foreman who will be leading the new activity. Pre-activity meetings may be held in conjunction with the weekly project meeting.

4.4 Hold Points. Hold Points are events that require approval by the engineer prior to continuation of work. Hold Points occur at definable stages of work when, in the opinion of the engineer, a review of the preceding work is necessary before continuation to the next stage.

4.4.1 A list of typical Hold Point events is available on the MoDOT website. Use of the Hold Point process will only be required for the project-specific list of Hold Points, if any, that the engineer submits to the contractor in advance of the work. The engineer may make changes to the Hold Point list at any time.

4.4.2 Prior to all Hold Point inspections, the contractor shall verify the work has been completed in accordance with the contract and specifications. If the engineer identifies any corrective actions needed during a Hold Point inspection, the corrections shall be completed prior to continuing work. The engineer may require a new Hold Point to be scheduled if the corrections require a follow-up inspection. Re-scheduling of Hold Points require a minimum 24-hour advance notification from the contractor unless otherwise allowed by the engineer.

5.0 Quality Assurance Testing and Inspection. MoDOT will perform quality assurance testing and inspection of the work, except as specified herein. The contractor shall utilize the inspection checklists provided in the ITP as a guide to minimize findings by MoDOT inspection staff. Submittal of completed checklists is not required, except as specified in 5.1.

5.1 Inspection and testing required in the production of concrete for the project shall be the responsibility of the contractor. Submittal of the 501 Concrete Plant Checklist is required.

6.0 Basis of Payment. No direct payment will be made for compliance with this provision.

FF. Concrete Trough with Steel Plate

1.0 This work includes furnishing and installing a diamond tread steel plate over a cast-in-place concrete trough in accordance with the plans to ensure positive drainage.

1.1 The dimensions of the steel plate and concrete trough shall be in accordance with the plans and in coordination with the engineer.

1.2 The steel shall be in accordance with Division 700 of Missouri Standards for Highway Construction, latest edition.

2.0 Method of Measurement: Measurement of the concrete trough shall be made per linear foot of trough based upon the pay limits denoted in the plans.

3.0 Basis of Payment: Payment for the concrete trough with steel plate, including all materials, equipment, labor, and tools shall be made and considered completely covered by the contract unit price bid for:

Item Number	Type	Description
609-99.03	LF	Concrete Trough with Steel Plate

GG. Access to Commercial Properties and City Streets

1.0 Description. This improvement is located within a commercial and residential area. While working on entrances, adjacent properties or street approaches, the contractor shall make every reasonable effort to minimize any interference to the properties and to pursue the work diligently. Under no circumstances shall the contractor completely block ingress/egress to and from businesses during the normal business hours of each business unless as approved in advance by the property owner and the engineer.

1.1 It shall be the contractor's responsibility to inform and notify the adjacent property owner 48 hours prior to starting any construction activities that may impact driveway and parking lot access or occur along the frontage of the property owner's parcel. Notification shall be in written form and include the contractor's contact information, the Engineer's contact information, and an estimated schedule of work and the associated impacts.

2.0 Construction Requirements. If there exists more than one entrance to the property, the contractor shall keep a minimum of one entrance to that property completely open at all times unless approved in advance by the property owner and the engineer. If there is only one entrance, the contractor shall only construct one half of the entrance at a time. Where the entrance is not considered by the engineer to be wide enough to allow vehicular traffic on one half of the entrance width, the contractor shall use a high early strength PCCP to minimize the entrance closure, as directed by the engineer. The minimum compressive strength of the PCCP shall be 2500 psi for light traffic (residential) and 3000 psi for commercial traffic before allowing access.

3.0 Liquidated Damages Specified. If the entire entrance or city street approach is not complete and open to traffic within **seven (7) calendar days**, the Commission, the traveling public, and state and local police and governmental authorities will be damaged in various ways, including but not limited to, increased construction administration cost, potential liability, traffic and traffic flow regulation cost, traffic congestion and motorist delay, with its resulting cost to the traveling

public. These damages are not reasonably capable of being computed or quantified. Therefore, the contractor will be charged with liquidated damages specified in the amount of **\$1,000.00 per day** for each full day that an entrance or street approach is not complete and open to traffic in excess of the limitation as specified elsewhere in the special provision.

4.0 Basis of Payment. No direct payment will be made to the contractor to recover the cost of equipment, labor, materials, or time required to fulfill the above provisions, unless specified elsewhere in the contract documents.

HH. Supplemental Revisions JSP-18-01AA

Compliance with [2 CFR 200.216 – Prohibition on Certain Telecommunications and Video Surveillance Services or Equipment](#).

The Missouri Highways and Transportation Commission shall not enter into a contract (or extend or renew a contract) using federal funds to procure or obtain equipment, services, or systems that uses covered telecommunications equipment or services as substantial or as critical technology as part of any system where the video surveillance and telecommunications equipment was produced by Huawei Technologies Company, ZTE Corporation, Hytera Communications Corporation, Hangzhou Hikvision Digital Technology Company, or Dahua Technology Company (or any subsidiary or affiliate of such entities).

Stormwater Compliance Requirements

1.0 Description. This provision requires the contractor to provide a Water Pollution Control Manager (WPCM) for any project that includes land disturbance on the project site and the total area of land disturbance, both on the project site, and all Off-site support areas, is one (1) acre or more. Regardless of the area of Off-site disturbance, if no land disturbance occurs on the project site, these provisions do not apply. When a WPCM is required, all sections within this provision shall be applicable, including assessment of specified Liquidated Damages for failure to correct Stormwater Deficiencies, as specified herein. This provision is in addition to any other stormwater, environmental, and land disturbance requirements specified elsewhere in the contract.

1.1 Definitions. The project site is defined as all areas designated on the plans, including temporary and permanent easements. The project site is equivalent to the “permitted site”, as defined in MoDOT’s State Operating Permit. An Off-site area is defined as any location off the project site the contractor utilizes for a dedicated project support function, such as, but not limited to, staging area, plant site, borrow area, or waste area.

1.2 Reporting of Off-Site Land Disturbance. If the project includes any planned land disturbance on the project site, prior to the start of work, the contractor shall submit a written report to the engineer that discloses all Off-site support areas where land disturbance is planned, the total acreage of anticipated land disturbance on those sites, and the land disturbance permit number(s). Upon request by the engineer, the contractor shall submit a copy of its land disturbance permit(s) for Off-site locations. Based on the total acreage of land disturbance, both on and Off-site, the engineer shall determine if these Stormwater Compliance Requirements shall apply. The Contractor shall immediately report any changes to the planned area of Off-site land

disturbance. The Contractor is responsible for obtaining its own separate land disturbance permit for Off-site areas.

2.0 Water Pollution Control Manager (WPCM). The Contractor shall designate a competent person to serve as the Water Pollution Control Manager (WPCM) for projects meeting the description in Section 1.0. The Contractor shall ensure the WPCM completes all duties listed in Section 2.1.

2.1 Duties of the WPCM:

- (a) Be familiar with the stormwater requirements including the current MoDOT State Operating Permit for construction stormwater discharges/land disturbance activities; MoDOT's statewide Stormwater Pollution Prevention Plan (SWPPP); the Corps of Engineers Section 404 Permit, when applicable; the project specific SWPPP, the Project's Erosion & Sediment Control Plan; all applicable special provisions, specifications, and standard drawings; and this provision;
- (b) Successfully complete the MoDOT Stormwater Training Course within the last 4 years. The MoDOT Stormwater Training is a free online course available at MoDOT.org;
- (c) Attend the Pre-Activity Meeting for Grading and Land Disturbance and all subsequent Weekly Meetings in which grading activities are discussed;
- (d) Oversee and ensure all work is performed in accordance with the Project-specific SWPPP and all updates thereto, or as designated by the engineer;
- (e) Review the project site for compliance with the Project SWPPP, as needed, from the start of any grading operations until final stabilization is achieved, and take necessary actions to correct any known deficiencies to prevent pollution of the waters of the state or adjacent property owners prior to the engineer's weekly inspections;
- (f) Review and acknowledge receipt of each MoDOT Inspection Report (Land Disturbance Inspection Record) for the Project within forty eight (48) hours of receiving the report and ensure that all Stormwater Deficiencies noted on the report are corrected as soon as possible, but no later than stated in Section 5.0.

3.0 Pre-Activity Meeting for Grading/Land Disturbance and Required Hold Point. A Pre-Activity meeting for grading/land disturbance shall be held prior to the start of any land disturbance operations. No land disturbance operations shall commence prior to the Pre-Activity meeting except work necessary to install perimeter controls and entrances. Discussion items at the pre-activity meeting shall include a review of the Project SWPPP, the planned order of grading operations, proposed areas of initial disturbance, identification of all necessary BMPs that shall be installed prior to commencement of grading operations, and any issues relating to compliance with the Stormwater requirements that could arise in the course of construction activity at the project.

3.1 Hold Point. Following the pre-activity meeting for grading/land disturbance and subsequent installation of the initial BMPs identified at the pre-activity meeting, a Hold Point shall occur prior to the start of any land disturbance operations to allow the engineer and WPCM the time needed to perform an on-site review of the installation of the BMPs to ensure compliance with the SWPPP is met. Land disturbance operations shall not begin until authorization is given by the engineer.

4.0 Inspection Reports. Weekly and post run-off inspections will be performed by the engineer and each Inspection Report (Land Disturbance Inspection Record) will be entered into a web-based Stormwater Compliance database. The WPCM will be granted access to this database and shall promptly review all reports, including any noted deficiencies, and shall acknowledge receipt of the report as required in Section 2.1 (f.).

5.0 Stormwater Deficiency Corrections. All stormwater deficiencies identified in the Inspection Report shall be corrected by the contractor within 7 days of the inspection date or any extended period granted by the engineer when weather or field conditions prohibit the corrective work. If the contractor does not initiate corrective measures within 5 calendar days of the inspection date or any extended period granted by the engineer, all work shall cease on the project except for work to correct these deficiencies, unless otherwise allowed by the engineer. All impact costs related to this halting of work, including, but not limited to stand-by time for equipment, shall be borne by the Contractor. Work shall not resume until the engineer approves the corrective work.

5.1 Liquidated Damages. If the Contractor fails to complete the correction of all Stormwater Deficiencies listed on the MoDOT Inspection Report within the specified time limit, the Commission will be damaged in various ways, including but not limited to, potential liability, required mitigation, environmental clean-up, fines, and penalties. These damages are not reasonably capable of being computed or quantified. Therefore, the contractor will be charged with liquidated damages specified in the amount of \$2,000 per day for failure to correct one or more of the Stormwater Deficiencies listed on the Inspection Report within the specified time limit. In addition to the stipulated damages, the stoppage of work shall remain in effect until all corrections are complete.

6.0 Basis of Payment. No direct payment will be made for compliance with this provision.

Anti-Discrimination Against Israel Certification

By signing this contract, the Company certifies it is not currently engaged in and shall not, for the duration of the contract, engage in a boycott of goods or services from the State of Israel, companies doing business in or with Israel or authorized by, licensed by, or organized under the laws of the State of Israel, or persons or entities doing business in the State of Israel as defined by Section 34.600 RSMo. This certification shall not apply to contracts with a total potential value of less than One Hundred Thousand Dollars (\$100,000) or to contractors with fewer than ten (10) employees.

Ground Tire Rubber (GTR) Dry Process Modification of Bituminous Pavement Material

1.0 Description. This work shall consist of the dry process of adding ground tire rubber (GTR) to modify bituminous material to be used in highway construction. Existing GTR requirements in Section 1015 pertain to the wet process method of GTR modification that blends GTR with the asphalt binder (terminal blending or blending at HMA plant). The following requirements shall govern for dry process GTR modification. The dry process method adds GTR as a fine aggregate or mineral filler during mix production. All GTR modified asphalt mixtures shall be in accordance with Secs 401, 402, or 403 as specified in the contract; except as revised by this specification.

2.0 Materials. The contractor shall furnish a manufacturer’s certification to the engineer for each shipment of GTR furnished stating the name of the manufacturer, the chemical composition, workability additives, and certifying that the GTR supplied is in accordance with this specification.

2.1 Product Approval. The GTR product shall contain a Trans-Polyoctenamer (TOR) added at 4.5 % of the weight of the crumb rubber or an engineered crumb rubber (ECR) workability additive that has proven performance in Missouri. Other GTR additives shall be demonstrated and proven prior to use such as a five-year field performance history in other states or performance on a federal or state-sanctioned accelerated loading facility.

2.2 General. GTR shall be produced from processing automobile or truck tires by ambient or cryogenic grinding methods. Heavy equipment tires, uncured or de-vulcanized rubber will not be permitted. GTR shall also meet the following material requirements:

Table 1 – GTR Material Properties		
Property	Test Method	Criteria
Specific Gravity	ASTM D1817	1.02 to 1.20
Metal Contaminates	ASTM D5603	≤ 0.01%
Fiber Content	ASTM D5603	≤ 0.5%
Moisture Content	ASTM D1509	≤ 1.0%*
Mineral Filler	AASHTO M17	≤ 4.0%

*Moisture content of the GTR shall not cause foaming when combined with asphalt binder and aggregate during mix production

2.3 Gradation. The GTR material prior to TOR or ECR workability additives shall meet the following gradation and shall be tested in accordance with ASTM D5603 and ASTM D5644.

Table 2 – GTR Gradation	
Sieve	Percent Passing by Weight
No. 20	100
No. 30	98-100
No. 40	50-70
No. 100	5-15

3.0 Delivery, Storage, and Handling. The GTR shall be supplied in moisture-proof packaging or other appropriate bulk containers. GTR shall be stored in a dry location protected from rain before use. Each bag or container shall be properly labeled with the manufacturer’s designation for the GTR and specific type, mesh size, weight and manufacturer’s batch or Lot designation.

4.0 Feeder System. Dry Process GTR shall be controlled with a feeder system using a proportioning device that is accurate to within ± 3 percent of the amount required. The system shall automatically adjust the feed rate to always maintain the material within this tolerance and shall have a convenient and accurate means of calibration. The system shall provide in-process monitoring, consisting of either a digital display of output or a printout of feed rate, in pounds per minute, to verify feed rate. The supply system shall report the feed in 1-pound increments using load cells that will enable the user to monitor the depletion of the GTR. Monitoring the system

volumetrically will not be allowed. The feeder shall interlock with the aggregate weight system and asphalt binder pump to maintain correct mixture proportions at all production rates.

Flow indicators or sensing devices for the system shall be interlocked with the plant controls to interrupt mixture production if GTR introduction rate is not within ± 3 percent. This interlock will immediately notify the operator if GTR introduction rate exceeds introduction tolerances. All plant production will cease if the introduction rate is not brought back within tolerance after 30 seconds. When the interlock system interrupts production and the plant has to be restarted, upon restarting operations; the modifier system shall run until a uniform feed can be observed on the output display. All mix produced prior to obtaining a uniform feed shall be rejected.

4.1 Batch Plants. GTR shall be added to aggregate in the weigh hopper. Mixing times shall be increased per GTR manufacturer recommendations.

4.2 Drum Plants. The feeder system shall add GTR to aggregate and liquid binder during mixing and provide sufficient mixing time to produce a uniform mixture. The feeder system shall ensure GTR does not become entrained in the exhaust system of the drier or plant and is not exposed to the drier flame at any point after introduction.

5.0 Testing During Mixture Production. Testing of asphalt mixes containing GTR shall not begin until at least 30 minutes after production or per additive supplier's recommendation.

6.0 Construction Requirements. Mixes containing GTR shall have a target mixing temperature of 325 F or as directed by the GTR additive supplier. The additive supplier's recommendations shall be followed to allow for GTR binder absorption/reaction. This may include holding mix in the silo to allow time for binder to absorb into the GTR. Rolling operations may need to be modified.

7.0 Mix Design Test Method Modification. A formal mixing procedure from the additive supplier shall be provided to the contractor and engineer that details the proper sample preparation, including blending GTR with the binder or other additives. Samples shall be prepared and fabricated in accordance with this procedure by the engineer and contractor throughout the duration of the project.

8.0 Mix design Volumetrics. Mix design volumetric equations shall be modified as follows:

8.1 Additional virgin binder added to offset GTR absorption of binder shall be counted as part of the mix virgin binder

8.2 GTR shall be included as part of the aggregate when calculating VMA of the mix.

8.2.1 GTR SPG shall be 1.15

8.3 Mix G_{sb} used to determine VMA shall be calculated as follows:

$$G_{sb (JMF)} = \frac{(100 - P_{bmv})}{\left(\frac{P_s}{G_{sb}} + \frac{P_{GTR}}{G_{GTR}}\right)}$$

where:

- $G_{sb (JMF)}$ = bulk specific gravity of the combined aggregate including GTR
- P_{bmv} = percent virgin binder by total mixture weight
- P_s = percent aggregate by total mixture weight (not including GTR)
- P_{GTR} = percent GTR by total mixture weight
- G_{sb} = bulk specific gravity of the combined aggregate (not including GTR)
- G_{GTR} = GTR specific gravity

8.4 G_{se} shall be calculated as follows:

$$G_{se} = \frac{(100 - P_b - P_{GTR})}{\left(\frac{100}{G_{mm}} - \frac{P_b}{G_b} - \frac{P_{GTR}}{G_{GTR}}\right)}$$

8.5 P_{be} shall be calculated as follows:

$$P_{be} = P_b - \frac{P_{ba}}{100} * (P_s + P_{GTR})$$

9.0 Minimum GTR Amount. The minimum dosage rate for GTR shall be 5 % by weight of total binder for an acceptable one bump grade or 10 % by weight of total binder for an acceptable two bump grade as detailed in the following table. Varying percentage blends of GTR and approved additives may be used as approved by the engineer with proven performance and meeting the specified requirements of the contract grade.

Contract Binder Grade	Percent Effective Virgin Binder Replacement Limits	Required Virgin Binder Grade	Minimum GTR Dosage Rate
PG 76-22	0 - 20	PG 70-22	5 %
		PG 64-22	10 %
PG 70-22	0 - 30	PG 64-22	5 %
		PG 58-28	10 %
PG 64-22	0 - 40*	PG 58-28	5 %
		PG 52-34	10 %
PG 58-28	0 - 40*	PG 52-34	5 %
		PG 46-34	10 %

* Reclaimed Asphalt Shingles (RAS) may be used when the contract grade is PG 64-22 or PG 58-28. RAS replacement shall follow the 2 x RAS criteria when calculating percent effective binder replacement in accordance Sec 401.

Delete Sec 403.19.2 and substitute the following:

403.19.2 Lots. The lot size shall be designated in the contractor's QC Plan. Each lot shall contain no less than four sublots and the maximum sublot size shall be 1,000 tons. The maximum lot size shall be 4,000 tons for determination of pay factors. Sublots from incomplete lots shall be combined with the previous complete lot for determination of pay factors. When no previous lot exists, the mixture shall be treated in accordance with [Sec 403.23.7.4.1](#). A new lot shall begin when the asphalt content of a mixture is adjusted in accordance with [Sec 403.11](#).

Delete Sec 106.9 and substitute the following:

106.9 Buy America Requirements

Buy America Requirements are waived if the total amount of Federal financial assistance applied to the project, through awards or subawards, is below \$500,000.

106.9.1 Buy America Requirements for Iron and Steel.

On all federal-aid projects, the contractor's attention is directed to Title 23 CFR 635.410 *Buy America Requirements*. Where steel or iron products are to be permanently incorporated into the contract work, steel and iron material shall be manufactured, from the initial melting stage through the application of coatings, in the USA except for "minimal use" as described herein. Furthermore, any coating process of the steel or iron shall be performed in the USA. Under a general waiver from FHWA the use of pig iron and processed, pelletized, and reduced iron ore manufactured outside of the USA will be permitted in the domestic manufacturing process for steel or iron material.

106.9.2 Buy America Requirements for Iron and Steel for Manufactured items.

A manufactured item will be considered iron and steel if it is "predominantly" iron or steel. Predominantly iron or steel means that the cost of iron or steel content of a product is more than 50 percent of the total cost of all its components.

106.9.2 Any sources other than the USA as defined will be considered foreign. The required domestic manufacturing process shall include formation of ingots and any subsequent process. Coatings shall include any surface finish that protects or adds value to the product.

106.9.3 "Minimal use" of foreign steel, iron or coating processes will be permitted, provided the cost of such products does not exceed 1/10 of one percent (0.1 percent) of the total contract cost or \$2,500.00, whichever is greater. If foreign steel, iron, or coating processes are used, invoices to document the cost of the foreign portion, as delivered to the project, shall be provided and the engineer's written approval obtained prior to placing the material in any work.

106.9.4 Buy America requirements include a step certification for all fabrication processes of all steel or iron materials that are accepted per Sec 1000. The AASHTO Product Evaluation and Audit Solutions compliance program verifies that all steel and iron products fabrication processes conform to 23 CFR 635.410 Buy America Requirements and is an acceptable standard per 23 CFR 635.410(d). AASHTO Product Evaluation and Audit Solutions compliant suppliers will not be required to submit step certification documentation with the shipment for some selected steel and iron materials. The AASHTO Product Evaluation and Audit Solutions compliant supplier shall maintain the step certification documentation on file and shall provide this documentation to the engineer upon request.

106.9.4.1 Items designated as Category 1 will consist of steel girders, piling, and reinforcing steel installed on site. Category 1 items require supporting documentation prior to incorporation into the project showing all steps of manufacturing, including coating, as being completed in the United States and in accordance with CFR Title 23 Section 635.410 Buy America Requirements. This includes the Mill Test Report from the original producing steel mill and certifications documenting the manufacturing process for all subsequent fabrication, including coatings. The certification shall include language that certifies the following. That all steel and iron materials permanently incorporated in this project was procured and processed domestically and all manufacturing processes, including coating, as being completed in the United States and in accordance with CFR Title 23 Section 635.410.

106.9.4.2 Items designated as Category 2 will include all other steel or iron products not in Category 1 and permanently incorporated in the project. Category 2 items shall consist of, but not be limited to items such as fencing, guardrail, signing, lighting and signal supports. The prime contractor is required to submit a material of origin form certification prior to incorporation into the project from the fabricator for each item that the product is domestic. The Certificate of Materials Origin form ([link to certificate form](#)) from the fabricator must show all steps of manufacturing, including coating, as being completed in the United States and in accordance with CFR Title 23 Section 635.410 Buy America Requirements and be signed by a fabricator representative. The engineer reserves the right to request additional information and documentation to verify that all Buy America requirements have been satisfied. These documents shall be submitted upon request by the engineer and retained for a period of 3 years after the last reimbursement of the material.

106.9.4.3 Any minor miscellaneous steel or iron items that are not included in the materials specifications shall be certified by the prime contractor as being procured domestically. Examples of these items would be bolts for sign posts, anchorage inserts, etc. The certification shall read "I certify that all steel and iron materials permanently incorporated in this project during all manufacturing processes, including coating, as being completed in the United States and in accordance with CFR Title 23 Section 635.410 Buy America Requirements procured and processed domestically in accordance with CFR Title 23 Section 635.410 Buy America Requirements. Any foreign steel used was submitted and accepted under minor usage". The certification shall be signed by an authorized representative of the prime contractor.

106.9.5 When permitted in the contract, alternate bids may be submitted for foreign steel and iron products. The award of the contract when alternate bids are permitted will be based on the lowest total bid of the contract based on furnishing domestic steel or iron products or 125 percent of the lowest total bid based on furnishing foreign steel or iron products. If foreign steel or iron products are awarded the contract, domestic steel or iron products may be used; however, payment will be at the contract unit price for foreign steel or iron products.

106.9.6 Buy America Requirements for Construction Materials other than iron and steel materials. Construction materials means articles, materials, or supplies that consist of only one of the items listed. Minor additions of articles, materials, supplies, or binding agents to a construction material do not change the categorization of the construction material. Upon request by the engineer, the contractor shall submit a domestic certification for all construction materials listed that are incorporated into the project.

- (a) Non-ferrous metals
- (b) Plastic and Polymer-based products (including polyvinylchloride, composite building materials, and polymers used in fiber optic cables)

- (c) Glass (including optic glass)
- (d) Fiber optic cable (including drop cable)
- (e) Optical fiber
- (f) Lumber
- (g) Engineered wood
- (h) Drywall

106.9.6.1 Minimal Use allowance for Construction Materials other than iron or steel.

“The total value of the non-compliant products is no more than the lesser of \$1,000,000 or 5% of total applicable costs for the project.” The contractor shall submit to the engineer any non-domestic materials and their total material cost to the engineer. The contractor and the engineer will both track these totals to assure that the minimal usage allowance is not exceeded.

106.9.7 Buy America Requirements for Manufactured Products.

Manufactured products means:

- (a) Articles, materials, or supplies that have been:
 - (i) Processed into a specific form and shape; or
 - (ii) Combined with other articles, materials, or supplies to create a product with different properties than the individual articles, materials, or supplies.
- (b) If an item is classified as an iron or steel product, a construction material, or a section 70917(c) material under § 184.4(e) and the definitions set forth in this section, then it is not a manufactured product. However, an article, material, or supply classified as a manufactured product under § 184.4(e) and paragraph (1) of this definition may include components that are construction materials, iron or steel products, or section 70917(c) materials.

106.9.7.1 Manufactured products are exempt from Buy America requirements. To qualify as a manufactured product, items that consist of two or more of the listed construction materials that have been combined together through a manufacturing process, and items that include at least one of the listed materials combined with a material that is not listed through a manufacturing process, should be treated as manufactured products, rather than as construction materials.

106.9.7.2 Manufactured items are covered under a general waiver to exclude them from Buy America Requirements. To qualify for the exemption the components must comprise of 55% of the value of materials in the item. The final assembly must also be performed domestically.