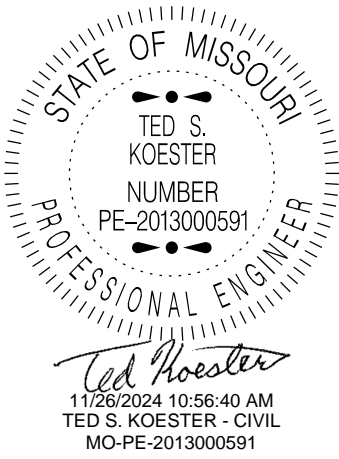


TABLE OF CONTENTS

- A. Construction Requirements
- B. Epoxy Pressure Injecting

	MISSOURI HIGHWAYS AND TRANSPORTATION COMMISSION 105 W. CAPITOL AVE. JEFFERSON CITY, MO 65101 Phone (888) 275-6636
	If a seal is present on this sheet, JSP's has been electronically sealed and dated.
	JOB NO. J5S3545 Crawford County, MO Date Prepared: 11/26/2024

Only the following items of the Job Special Provisions (Bridge) are authenticated by this seal: All

JOB SPECIAL PROVISIONS (BRIDGE)

A. CONSTRUCTION REQUIREMENTS

1.0 Description. This provision contains general construction requirements for this project.

2.0 Construction Requirements. The plans and the asbestos and lead inspection report for the existing structure(s) are included in the contract in the bridge electronic deliverables zip file for informational purposes only.

2.1 In order to assure the least traffic interference, the work shall be scheduled so that the bridge closure is for the absolute minimum amount of time required to complete the work. The bridge shall not be closed until material is available for continuous construction and the contractor is prepared to diligently pursue the work until the closed bridge is opened to traffic.

2.2 Bridge work by contractor forces, including erection, rehabilitation or demolition, shall not be allowed over traffic unless a bridge platform protection system is installed below the work area except for work performed above a deck that is intact. The protection system shall be capable of catching all falling objects such as tools, overhang brackets or materials. Lifting of objects that are heavier than the capacity of the bridge protection system shall not be permitted.

2.3 Provisions shall be made to prevent any debris and material from falling onto the roadway. If determined necessary by the engineer, any debris and material that falls below the bridge outside the previously specified limits shall be removed as approved by the engineer at the contractor's expense. Traffic under the bridge shall be maintained in accordance with the contract documents.

2.4 Any damage sustained to the remaining structure as a result of the contractor's operations shall be repaired or the material replaced as approved by the engineer at the contractor's expense.

2.5 Provisions shall be made to prevent damage to any existing utilities. Any damage sustained to the utilities as a result of the contractor's operations shall be the responsibility of the contractor. All costs of repair and disruption of service shall be as determined by the utility owners and as approved by the engineer.

3.0 Method of Measurement. No measurement will be made.

4.0 Basis of Payment. Payment for the above-described work will be considered completely covered by the contract unit price for other items included in the contract.

B. EPOXY PRESSURE INJECTING

1.0 Description. Surface cracks in the substructure shall be pressure injected with epoxy. The engineer will designate the cracks to be repaired.

2.0 Material.

2.1 Epoxy. The epoxy material shall consist of a two-component system in accordance with the requirements of ASTM C 881, Type IV, Grade 1, except that the viscosity shall be a maximum of 4.5 poise (0.45 Pa·s). The Class designation of the epoxy shall be determined according to the temperature that exists on the job.

JOB SPECIAL PROVISIONS (BRIDGE)

2.2 Certification. The contractor shall furnish manufacturer's certification that the material supplied is in accordance with these specifications. The certification shall include or have attached typical test results for all specified properties required by ASTM C 881 for the injecting resin. The engineer reserves the right to sample and test any or all material supplied.

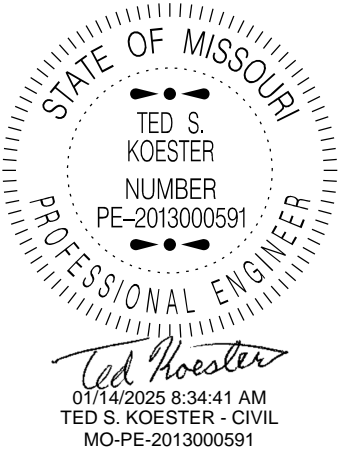
3.0 Construction Requirements. The surface to receive the epoxy grout shall be cleaned of laitance, grease and foreign matter by sandblasting. The cracks shall be cleaned of debris by using oil-free and water-free compressed air or vacuum. After the cracks are cleaned, the epoxy shall be injected in accordance with manufacturer's recommendations. The temporary surface seal and placement and method of attachment of injection ports shall be in accordance with the epoxy manufacturer's recommendations.

4.0 Method of Measurement. The extent of epoxy pressure injecting may vary from the estimated quantity but the contract unit price shall prevail regardless of the variation. The epoxy pressure injecting will be measured to the nearest linear foot (0.5 m).

5.0 Basis of Payment. Accepted quantity of epoxy pressure injecting will be paid for at the contract unit price. Payment for the above described work, including all material, equipment, labor and any other incidental work necessary to complete this item, will be considered completely covered by the contract unit price for Epoxy Pressure Injecting.

TABLE OF CONTENTS

- A. Construction Requirements
- B. Diamond Grinding
- C. Epoxy Pressure Injecting
- D. Alternate Construction Methods

	MISSOURI HIGHWAYS AND TRANSPORTATION COMMISSION 105 W. CAPITOL AVE. JEFFERSON CITY, MO 65101 Phone (888) 275-6636
	If a seal is present on this sheet, JSP's has been electronically sealed and dated.
	JOB NO. J5S3550 Crawford County, MO Date Prepared: 1/14/2025
Only the following items of the Job Special Provisions (Bridge) are authenticated by this seal: All	

JOB SPECIAL PROVISIONS (BRIDGE)

A. CONSTRUCTION REQUIREMENTS

1.0 Description. This provision contains general construction requirements for this project.

2.0 Construction Requirements. The plans and the asbestos and lead inspection report for the existing structure(s) are included in the contract in the bridge electronic deliverables zip file for informational purposes only.

2.1 In order to assure the least traffic interference, the work shall be scheduled so that a lane closure is for the absolute minimum amount of time required to complete the work. A lane shall not be closed until material is available for continuous construction and the contractor is prepared to diligently pursue the work until the closed lane is opened to traffic.

2.2 Bridge work by contractor forces, including erection, rehabilitation or demolition, shall not be allowed over traffic unless a bridge platform protection system is installed below the work area except for work performed above a deck that is intact. The protection system shall be capable of catching all falling objects such as tools, overhang brackets or materials. Lifting of objects that are heavier than the capacity of the bridge protection system shall not be permitted.

2.3 Provisions shall be made to prevent any debris and material from falling onto the roadway. If determined necessary by the engineer, any debris and material that falls below the bridge outside the previously specified limits shall be removed as approved by the engineer at the contractor's expense. Traffic under the bridge shall be maintained in accordance with the contract documents.

2.4 Any damage sustained to the remaining structure as a result of the contractor's operations shall be repaired or the material replaced as approved by the engineer at the contractor's expense.

2.5 Provisions shall be made to prevent damage to any existing utilities. Any damage sustained to the utilities as a result of the contractor's operations shall be the responsibility of the contractor. All costs of repair and disruption of service shall be as determined by the utility owners and as approved by the engineer.

3.0 Method of Measurement. No measurement will be made.

4.0 Basis of Payment. Payment for the above-described work will be considered completely covered by the contract unit price for other items included in the contract.

B. DIAMOND GRINDING

1.0 Description. This work will only be performed at the discretion of the engineer and will be underrun if not required by the engineer. This work shall consist of grinding the new concrete surface to provide good riding characteristics, a surface texture and proper drainage. If the engineer determines it necessary to provide good riding characteristics, grinding shall be performed on all or part of the bridge approach slabs and sealed in accordance with [Sec 703.3.8](#). The finished surface shall be in accordance with [Sec 703.3.7](#) and as shown on the plans or as directed by the engineer except as modified below.

2.0 Equipment. The equipment shall be of a size that will grind a strip at least 3 feet wide using diamond blades and shall not cause spalls at cracks, joints or other locations.

JOB SPECIAL PROVISIONS (BRIDGE)

3.0 Construction Requirements. The construction operation shall be scheduled and proceed in a manner that produces a uniform finished surface. Auxiliary or ramp lane grinding shall transition from the edge of the mainline as required to provide drainage and an acceptable riding surface.

3.1 Deck repair, if required, shall be completed prior to any grinding.

3.2 Grinding shall be accomplished in a manner that eliminates joint or crack faults and provides lateral drainage by maintaining a constant cross slope between grinding extremities in each lane. A maximum tolerance of 1/16 inch will be allowed for adjacent sides of joints and cracks, except that under no circumstances shall the grinding depth exceed 1/4 inch from the top of the original surface. When grinding across faulted joints, a minimum of a 20-foot transition onto the approach side slab shall be used.

3.3 The cross slope of the pavement shall be as shown on the plans and shall have no depressions or misalignment of slope greater than 1/4 inch in 12 feet when measured with a 12-foot straightedge placed perpendicular to the centerline. Areas of deviation shall be reground. Straightedge requirements will not apply across longitudinal joints or outside the ground area.

3.4 As soon as practical after grinding, the surface will be straight edged longitudinally, and all variations exceeding 1/8 inch in 10 feet will be plainly marked. Areas of deviation shall be reground.

3.5 Substantially all of the pavement surface shall be textured. Extra depth grinding to eliminate minor depressions in order to provide texturing on 100 percent of the pavement surface will not be required. No unground surface area between passes will be permitted, except as specified otherwise in the contract documents.

3.6 The grinding process shall produce a final pavement surface that is true to grade and uniform in appearance with a longitudinal line-type texture. The line-type texture shall contain parallel longitudinal corrugations that present a narrow ridge corduroy-type appearance. The peaks of the ridges shall be approximately 1/32 inch higher than the bottoms of the grooves. The grooves shall be evenly spaced. There shall be approximately 50-55 grooves per foot, measured perpendicular to the centerline.

3.7 The contractor shall remove and dispose of all residue from the grinding in a manner and at a location to satisfy environmental regulations. The contractor shall have the engineer's approval for the method of spreading and disposal of the residue prior to beginning any grinding operations.

3.8 Solid residue shall be removed from the pavement surface before any residue is blown by traffic action or wind.

3.9 Residue shall not be permitted to encroach on open lanes.

3.10 The residue shall not enter into gutters or closed drainage systems.

3.11 The contractor may disperse residue onto unpaved shoulders, adjacent roadside embankments, or median ditch areas of divided highways where the residue runoff can percolate into the soil, unless specified otherwise in the contract. The spread rate shall not

JOB SPECIAL PROVISIONS (BRIDGE)

generate surface runoff. If surface runoff occurs at a grinding location, the contractor shall haul the residue to an approved location at the contractor's expense.

3.12 Discharge of any residue runoff shall not flow into adjacent rivers, streams, lakes, ponds or other open bodies of water.

3.13 Residue shall not be spread within 100 feet of any streams, lakes or other open bodies of water, or within 15 feet of a water filled ditch.

3.14 The contractor shall use appropriate equipment and methods so the discharging of the residue does not cause erosion of soil or damage to established vegetation along the roadway. The contractor shall repair and reseed any areas where the discharge of grinding residue causes damage to roadway slopes or vegetated areas at the contractor's expense.

3.15 If the solids concentration of discharged residue at any particular area is determined to be excessive by the engineer, the contractor shall provide equipment and material to flush the areas with water as directed by the engineer, at the contractor's expense.

3.16 The pavement shall be cleaned prior to opening to traffic as directed by the engineer.

4.0 Smoothness Requirements.

4.1 No diamond grinding shall be performed until the pavement has attained a strength sufficient to be opened to all types of traffic. All diamond grinding shall be completed on any section prior to opening that section to other than construction traffic, unless approved by the engineer.

4.2 The engineer will be the sole authority for determining if the driving surface is sufficiently smooth.

4.3 The engineer will evaluate the smoothness of the concrete wearing surface after the concrete has cured and direct the contractor to diamond grind where deemed necessary.

4.4 After initial diamond grinding operations, if any, the engineer will again evaluate the smoothness of the concrete wearing surface and approach slab, repeating as many times as necessary to achieve the desired surface smoothness.

4.5 Any deficiencies in the final surface due to improper contractor operations or equipment shall be corrected by the contractor at the contractor's expense.

4.6 All areas shall be tested with a 10-foot straightedge in accordance with section 3.4 of this job special provision.

5.0 Method of Measurement. Measurement for diamond grinding will be made to the nearest square yard. Measurement will be based upon the area of initial diamond grinding completed as directed by the engineer. Subsequent passes of diamond grinding over a previously ground area will not be measured. No deduction will be made for gaps to avoid striping or raised pavement markers. No additional measurement will be made for diamond grinding bridge approach slabs.

6.0 Basis of Payment. Payment for diamond grinding will be paid for at the contract unit price per square yard. Payment for diamond grinding will be considered full compensation

JOB SPECIAL PROVISIONS (BRIDGE)

for all labor, equipment, material, and incidentals to complete this work, including hauling and disposal of grinding residue and cleaning the pavement prior to opening to traffic.

C. EPOXY PRESSURE INJECTING

1.0 Description. Surface cracks in the substructure shall be pressure injected with epoxy. The engineer will designate the cracks to be repaired.

2.0 Material.

2.1 Epoxy. The epoxy material shall consist of a two-component system in accordance with the requirements of ASTM C 881, Type IV, Grade 1, except that the viscosity shall be a maximum of 4.5 poise (0.45 Pa·s). The Class designation of the epoxy shall be determined according to the temperature that exists on the job.

2.2 Certification. The contractor shall furnish manufacturer's certification that the material supplied is in accordance with these specifications. The certification shall include or have attached typical test results for all specified properties required by ASTM C 881 for the injecting resin. The engineer reserves the right to sample and test any or all material supplied.

3.0 Construction Requirements. The surface to receive the epoxy grout shall be cleaned of laitance, grease and foreign matter by sandblasting. The cracks shall be cleaned of debris by using oil-free and water-free compressed air or vacuum. After the cracks are cleaned, the epoxy shall be injected in accordance with manufacturer's recommendations. The temporary surface seal and placement and method of attachment of injection ports shall be in accordance with the epoxy manufacturer's recommendations.

4.0 Method of Measurement. The extent of epoxy pressure injecting may vary from the estimated quantity but the contract unit price shall prevail regardless of the variation. The epoxy pressure injecting will be measured to the nearest linear foot (0.5 m).

5.0 Basis of Payment. Accepted quantity of epoxy pressure injecting will be paid for at the contract unit price. Payment for the above described work, including all material, equipment, labor and any other incidental work necessary to complete this item, will be considered completely covered by the contract unit price for Epoxy Pressure Injecting.

D. ALTERNATE CONSTRUCTION METHODS

1.0 Description. The contractor has the option of selecting one of two alternate methods for the hydro-demolition work. Plans for each alternate are provided in the same plan set and are not separated.

The two alternate methods are:

Alternate A = Hydro-demolition using special repair zones

Alternate B = Hydro-demolition removing material in strips along the driving surface

2.0 Bidding. Separate pay items, descriptions and quantities are included in the itemized proposal for each bridge alternate. The bidder shall bid all the roadway items as specified in the Roadway Plans and Special Provisions. The bidder shall bid only one of the bridge alternates and leave the contract unit price column blank for all pay items listed for the other bridge alternate.

JOB SPECIAL PROVISIONS (BRIDGE)

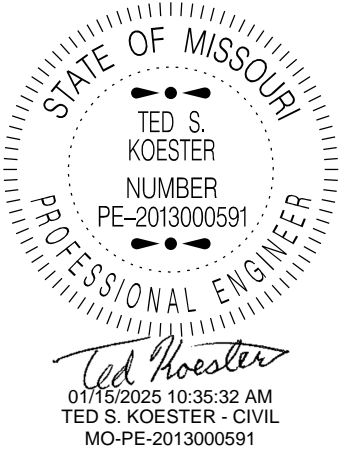
The chosen alternate will be the same for all the bridges on the project. If the bidder leaves any value in the unit price column for another alternate other than the one they are bidding, the bid will be rejected.

3.0 Method of Measurement. The quantities of the alternates will be measured in accordance with the plans and the standard specifications.

4.0 Basis of Payment. The pay items included in the contract for the chosen alternate will be paid for at the contract unit price in accordance with the plans and the standard specifications.

TABLE OF CONTENTS

- A. Construction Requirements
- B. Diamond Grinding
- C. Alternate Construction Methods

	<p>MISSOURI HIGHWAYS AND TRANSPORTATION COMMISSION 105 W. CAPITOL AVE. JEFFERSON CITY, MO 65101 Phone (888) 275-6636</p>
	<p>If a seal is present on this sheet, JSP's has been electronically sealed and dated.</p>
	<p>JOB NO. J5S3579 Crawford County, MO Date Prepared: 1/15/2025</p>
	<p>Only the following items of the Job Special Provisions (Bridge) are authenticated by this seal: All</p>

JOB SPECIAL PROVISIONS (BRIDGE)

A. CONSTRUCTION REQUIREMENTS

1.0 Description. This provision contains general construction requirements for this project.

2.0 Construction Requirements. The plans and the asbestos and lead inspection report for the existing structure(s) are included in the contract in the bridge electronic deliverables zip file for informational purposes only.

2.1 In order to assure the least traffic interference, the work shall be scheduled so that a lane closure is for the absolute minimum amount of time required to complete the work. A lane shall not be closed until material is available for continuous construction and the contractor is prepared to diligently pursue the work until the closed lane is opened to traffic.

2.2 Bridge work by contractor forces, including erection, rehabilitation or demolition, shall not be allowed over traffic unless a bridge platform protection system is installed below the work area except for work performed above a deck that is intact. The protection system shall be capable of catching all falling objects such as tools, overhang brackets or materials. Lifting of objects that are heavier than the capacity of the bridge protection system shall not be permitted.

2.3 Provisions shall be made to prevent any debris and material from falling onto the roadway. If determined necessary by the engineer, any debris and material that falls below the bridge outside the previously specified limits shall be removed as approved by the engineer at the contractor's expense. Traffic under the bridge shall be maintained in accordance with the contract documents.

2.4 Any damage sustained to the remaining structure as a result of the contractor's operations shall be repaired or the material replaced as approved by the engineer at the contractor's expense.

2.5 Provisions shall be made to prevent damage to any existing utilities. Any damage sustained to the utilities as a result of the contractor's operations shall be the responsibility of the contractor. All costs of repair and disruption of service shall be as determined by the utility owners and as approved by the engineer.

3.0 Method of Measurement. No measurement will be made.

4.0 Basis of Payment. Payment for the above-described work will be considered completely covered by the contract unit price for other items included in the contract.

B. DIAMOND GRINDING

1.0 Description. This work will only be performed at the discretion of the engineer and will be underrun if not required by the engineer. This work shall consist of grinding the new concrete surface to provide good riding characteristics, a surface texture and proper drainage. If the engineer determines it necessary to provide good riding characteristics, grinding shall be performed on all or part of the bridge approach slabs and sealed in accordance with [Sec 703.3.8](#). The finished surface shall be in accordance with [Sec 703.3.7](#) and as shown on the plans or as directed by the engineer except as modified below.

2.0 Equipment. The equipment shall be of a size that will grind a strip at least 3 feet wide using diamond blades and shall not cause spalls at cracks, joints or other locations.

JOB SPECIAL PROVISIONS (BRIDGE)

3.0 Construction Requirements. The construction operation shall be scheduled and proceed in a manner that produces a uniform finished surface. Auxiliary or ramp lane grinding shall transition from the edge of the mainline as required to provide drainage and an acceptable riding surface.

3.1 Deck repair, if required, shall be completed prior to any grinding.

3.2 Grinding shall be accomplished in a manner that eliminates joint or crack faults and provides lateral drainage by maintaining a constant cross slope between grinding extremities in each lane. A maximum tolerance of 1/16 inch will be allowed for adjacent sides of joints and cracks, except that under no circumstances shall the grinding depth exceed 1/4 inch from the top of the original surface. When grinding across faulted joints, a minimum of a 20-foot transition onto the approach side slab shall be used.

3.3 The cross slope of the pavement shall be as shown on the plans and shall have no depressions or misalignment of slope greater than 1/4 inch in 12 feet when measured with a 12-foot straightedge placed perpendicular to the centerline. Areas of deviation shall be reground. Straightedge requirements will not apply across longitudinal joints or outside the ground area.

3.4 As soon as practical after grinding, the surface will be straight edged longitudinally, and all variations exceeding 1/8 inch in 10 feet will be plainly marked. Areas of deviation shall be reground.

3.5 Substantially all of the pavement surface shall be textured. Extra depth grinding to eliminate minor depressions in order to provide texturing on 100 percent of the pavement surface will not be required. No unground surface area between passes will be permitted, except as specified otherwise in the contract documents.

3.6 The grinding process shall produce a final pavement surface that is true to grade and uniform in appearance with a longitudinal line-type texture. The line-type texture shall contain parallel longitudinal corrugations that present a narrow ridge corduroy-type appearance. The peaks of the ridges shall be approximately 1/32 inch higher than the bottoms of the grooves. The grooves shall be evenly spaced. There shall be approximately 50-55 grooves per foot, measured perpendicular to the centerline.

3.7 The contractor shall remove and dispose of all residue from the grinding in a manner and at a location to satisfy environmental regulations. The contractor shall have the engineer's approval for the method of spreading and disposal of the residue prior to beginning any grinding operations.

3.8 Solid residue shall be removed from the pavement surface before any residue is blown by traffic action or wind.

3.9 Residue shall not be permitted to encroach on open lanes.

3.10 The residue shall not enter into gutters or closed drainage systems.

3.11 The contractor may disperse residue onto unpaved shoulders, adjacent roadside embankments, or median ditch areas of divided highways where the residue runoff can percolate into the soil, unless specified otherwise in the contract. The spread rate shall not

JOB SPECIAL PROVISIONS (BRIDGE)

generate surface runoff. If surface runoff occurs at a grinding location, the contractor shall haul the residue to an approved location at the contractor's expense.

3.12 Discharge of any residue runoff shall not flow into adjacent rivers, streams, lakes, ponds or other open bodies of water.

3.13 Residue shall not be spread within 100 feet of any streams, lakes or other open bodies of water, or within 15 feet of a water filled ditch.

3.14 The contractor shall use appropriate equipment and methods so the discharging of the residue does not cause erosion of soil or damage to established vegetation along the roadway. The contractor shall repair and reseed any areas where the discharge of grinding residue causes damage to roadway slopes or vegetated areas at the contractor's expense.

3.15 If the solids concentration of discharged residue at any particular area is determined to be excessive by the engineer, the contractor shall provide equipment and material to flush the areas with water as directed by the engineer, at the contractor's expense.

3.16 The pavement shall be cleaned prior to opening to traffic as directed by the engineer.

4.0 Smoothness Requirements.

4.1 No diamond grinding shall be performed until the pavement has attained a strength sufficient to be opened to all types of traffic. All diamond grinding shall be completed on any section prior to opening that section to other than construction traffic, unless approved by the engineer.

4.2 The engineer will be the sole authority for determining if the driving surface is sufficiently smooth.

4.3 The engineer will evaluate the smoothness of the concrete wearing surface after the concrete has cured and direct the contractor to diamond grind where deemed necessary.

4.4 After initial diamond grinding operations, if any, the engineer will again evaluate the smoothness of the concrete wearing surface and approach slab, repeating as many times as necessary to achieve the desired surface smoothness.

4.5 Any deficiencies in the final surface due to improper contractor operations or equipment shall be corrected by the contractor at the contractor's expense.

4.6 All areas shall be tested with a 10-foot straightedge in accordance with section 3.4 of this job special provision.

5.0 Method of Measurement. Measurement for diamond grinding will be made to the nearest square yard. Measurement will be based upon the area of initial diamond grinding completed as directed by the engineer. Subsequent passes of diamond grinding over a previously ground area will not be measured. No deduction will be made for gaps to avoid striping or raised pavement markers. No additional measurement will be made for diamond grinding bridge approach slabs.

6.0 Basis of Payment. Payment for diamond grinding will be paid for at the contract unit price per square yard. Payment for diamond grinding will be considered full compensation

JOB SPECIAL PROVISIONS (BRIDGE)

for all labor, equipment, material, and incidentals to complete this work, including hauling and disposal of grinding residue and cleaning the pavement prior to opening to traffic.

C. ALTERNATE CONSTRUCTION METHODS

1.0 Description. The contractor has the option of selecting one of two alternate methods for the hydro-demolition work. Plans for each alternate are provided in the same plan set and are not separated.

The two alternate methods are:

Alternate C = Hydro-demolition using special repair zones

Alternate D = Hydro-demolition removing material in strips along the driving surface

2.0 Bidding. Separate pay items, descriptions and quantities are included in the itemized proposal for each bridge alternate. The bidder shall bid all the roadway items as specified in the Roadway Plans and Special Provisions. The bidder shall bid only one of the bridge alternates and leave the contract unit price column blank for all pay items listed for the other bridge alternate. The chosen alternate will be the same for all the bridges on the project. If the bidder leaves any value in the unit price column for another alternate other than the one they are bidding, the bid will be rejected.

3.0 Method of Measurement. The quantities of the alternates will be measured in accordance with the plans and the standard specifications.

4.0 Basis of Payment. The pay items included in the contract for the chosen alternate will be paid for at the contract unit price in accordance with the plans and the standard specifications.