

Job No.: J9I3838
Route: I-55
County: Cape Girardeau/Scott

JOB SPECIAL PROVISIONS TABLE OF CONTENTS (ROADWAY)

(Job Special Provisions shall prevail over General Special Provisions whenever in conflict therewith.)

| | |
|--|----|
| A. General - Federal JSP-09-02L | 1 |
| B. Contract Liquidated Damages JSP- 13-01D | 1 |
| C. Work Zone Traffic Management JSP-02-06N | 2 |
| D. Emergency Provisions and Incident Management JSP-90-11A | 5 |
| E. Project Contact for Contractor/Bidder Questions JSP-96-05A | 6 |
| F. Supplemental Revisions JSP-18-01KK | 6 |
| G. Contractor Quality Control NJSP-15-42 | 13 |
| H. Experimental Test Sections for Frictional Characteristics | 15 |
| I. Modified Winter Months Requirements | 21 |
| J. Order of Work – Paving | 22 |
| K. Coordination With Other Projects | 22 |
| L. Bridge End Transitions | 23 |
| M. Pavement Marking Log | 23 |
| N. Permanent Aggregate Edge Treatment NJSP-15-40B | 23 |
| O. Optional Temporary Pavement Marking Paint NJSP-18-07G | 24 |
| P. Guardrail Grading Requirements JSP-17-02B | 25 |
| Q. Shaping Slopes Class III (Modified Material Requirements) NJSP-20-03B | 26 |
| R. Vegetative Barrier Pavement JSP-24-04B | 26 |
| S. High-Tension Guard Cable Barrier JSP 24-03 | 27 |
| T. Contractor Furnished Borrow | 28 |
| U. Grading Requirements | 28 |
| V. Airport Requirements JSP-15-09 | 28 |
| W. Type B Concrete Traffic Barrier(Modified Moment Slab) | 29 |
| X. Truck Mounted Attenuator (TMA) for Stationary Activities JSP-23-04 | 30 |
| Y. Utilities JSP-93-26F | 30 |
| Z. Tubular Delineator | 30 |
| AA. Non-Tracking Tack JSP-24-02A | 31 |
| BB. Special Consideration of Change Orders and Value Engineering JSP-21-07 | 32 |
| CC. Balanced Mix Design Requirements for Sec 403 Asphalt JSP-24-01C | 32 |
| DD. HiMod Asphalt Mixture Requirements JSP-25-02 | 64 |
| EE. Additional Research JSP-25-06 | 67 |

Job No.: J9I3838
Route: I-55
County: Cape Girardeau/Scott

| | |
|---|--|
|  Seiji Shimbo 11/20/2025 2:57:18 PM SEIJI SHIMBO - CIVIL MO-PE-2017019046 | <p>MISSOURI HIGHWAYS AND TRANSPORTATION COMMISSION 105 W. CAPITOL AVE. JEFFERSON CITY, MO 65102 Phone 1-888-275-6636</p> <p>If a seal is present on this sheet, JSP's have been electronically sealed and dated.</p> <p>Job Number: J9I38380 Cape Girardeau, Scott County Date Prepared: 10/27/2025</p> <p>ADDENDUM DATE:</p> <p>Only the following items of the Job Special Provisions (Roadway) are authenticated by this seal: All</p> |
|---|--|

**JOB
SPECIAL PROVISION**

A. General - Federal JSP-09-02L

1.0 Description. The Federal Government is participating in the cost of construction of this project. All applicable Federal laws, and the regulations made pursuant to such laws, shall be observed by the contractor, and the work will be subject to the inspection of the appropriate Federal Agency in the same manner as provided in Sec 105.10 of the Missouri Standard Specifications for Highway Construction with all revisions applicable to this bid and contract.

1.1 This contract requires payment of the prevailing hourly rate of wages for each craft or type of work required to execute the contract as determined by the Missouri Department of Labor and Industrial Relations and requires adherence to a schedule of minimum wages as determined by the United States Department of Labor. For work performed anywhere on this project, the contractor and the contractor's subcontractors shall pay the higher of these two applicable wage rates. State Wage Rates, Information on the Required Federal Aid Provisions, and the current Federal Wage Rates are available on the Missouri Department of Transportation web page at www.modot.org under "Doing Business with MoDOT", "Contractor Resources". Effective Wage Rates will be posted 10 days prior to the applicable bid opening. These supplemental bidding documents have important legal consequences. It shall be conclusively presumed that they are in the bidder's possession, and they have been reviewed and used by the bidder in the preparation of any bid submitted on this project.

1.2 The following documents are available on the Missouri Department of Transportation web page at www.modot.org under "Doing Business with MoDOT"; "Standards and Specifications". The effective version shall be determined by the letting date of the project.

General Provisions & Supplemental Specifications

Supplemental Plans to July 2025 Missouri Standard Plans
For Highway Construction

These supplemental bidding documents contain all current revisions to the published versions and have important legal consequences. It shall be conclusively presumed that they are in the bidder's possession, and they have been reviewed and used by the bidder in the preparation of any bid submitted on this project.

B. Contract Liquidated Damages JSP- 13-01D

1.0 Description. Liquidated Damages for failure or delay in completing the work on time for this contract shall be in accordance with Sec 108.8. The liquidated damages include separate amounts for road user costs and contract administrative costs incurred by the Commission.

2.0 Period of Performance. Prosecution of work is expected to begin on the date specified below in accordance with Sec 108.2. Regardless of when the work is begun on this contract, all work on all projects shall be completed on or before the date specified below. Completion by this date shall be in accordance with the requirements of Sec 108.7.1.

Job No.: J9I3838
Route: I-55
County: Cape Girardeau/Scott

Notice to Proceed: March 23, 2026
Contract Completion Date: November 1, 2027

2.1 Calendar Days and Completion Dates. Completion of the project is required as specified herein. The count of calendar days will begin on the date the contractor starts any construction operations on the project.

| Project | Calendar Days | Daily Road User Cost |
|---------|---------------|----------------------|
| J9I3838 | 314 | \$7600 |

3.0 Liquidated Damages for Contract Administrative Costs. Should the contractor fail to complete the work on or before the contract completion date specified in Section 2.0, or within the number of calendar days specified in Section 2.1, whichever occurs first, the contractor will be charged contract administrative liquidated damages in accordance with Sec 108.8 in the amount of **\$2000** per calendar day for each calendar day, or partial day thereof, that the work is not fully completed. For projects in combination, these damages will be charged in full for failure to complete one or more projects within the specified contract completion date or calendar days.

4.0 Liquidated Damages for Road User Costs. Should the contractor fail to complete the work on or before the contract completion date specified in Section 2.0, or within the number of calendar days specified in Section 2.1, whichever occurs first, the contractor will be charged road user costs in accordance with Sec 108.8 in the amount specified in Section 2.1 for each calendar day, or partial day thereof, that the work is not fully completed. These damages are in addition to the contract administrative damages and any other damages as specified elsewhere in this contract.

C. Work Zone Traffic Management JSP-02-06N

1.0 Description. Work zone traffic management shall be in accordance with applicable portions of Division 100 and Division 600 of the Standard Specifications, and specifically as follows.

1.1 Maintaining Work Zones and Work Zone Reviews. The Work Zone Specialist (WZS) shall maintain work zones in accordance with Sec 616.3.3 and as further stated herein. The WZS shall coordinate and implement any changes approved by the engineer. The WZS shall ensure all traffic control devices are maintained in accordance with Sec 616, the work zone is operated within the hours specified by the engineer, and will not deviate from the specified hours without prior approval of the engineer. The WZS is responsible to manage work zone delay in accordance with these project provisions. When requested by the engineer, the WZS shall submit a weekly report that includes a review of work zone operations for the week. The report shall identify any problems encountered and corrective actions taken. Work zones are subject to unannounced inspections by the engineer and other departmental staff to corroborate the validity of the WZS's review and may require immediate corrective measures and/or additional work zone monitoring.

1.2 Work Zone Deficiencies. Failure to make corrections on time may result in the engineer suspending work. The suspension will be non-excusable and non-compensable regardless if road user costs are being charged for closures.

2.0 Traffic Management Schedule.

2.1 Traffic management schedules shall be submitted to the engineer for review prior to the start of work and prior to any revisions to the traffic management schedule. The traffic management

schedule shall include the proposed traffic control measures, the hours traffic control will be in place, and work hours.

2.2 The traffic management schedule shall conform to the limitations specified in Sec 616 regarding lane closures, traffic shifts, road closures and other width, height and weight restrictions.

2.3 The engineer shall be notified as soon as practical of any postponement due to weather, material or other circumstances.

2.4 In order to ensure minimal traffic interference, the contractor shall schedule lane closures for the absolute minimum amount of time required to complete the work. Lanes shall not be closed until material is available for continuous construction and the contractor is prepared to diligently pursue the work until the closed lane is opened to traffic.

2.5 Traffic Congestion. The contractor shall, upon approval of the engineer, take proactive measures to reduce traffic congestion in the work zone. The contractor shall immediately implement appropriate mitigation strategies whenever traffic congestion reaches an excess of **10 minutes** to prevent congestion from escalating beyond this delay threshold. If disruption of the traffic flow occurs and traffic is backed up in queues equal to or greater than the delay time threshold listed above, then the contractor shall immediately review the construction operations which contributed directly to disruption of the traffic flow and make adjustments to the operations to prevent the queues from reoccurring. Traffic delays may be monitored by physical presence on site or by utilizing real-time travel data through the work zone that generate text and/or email notifications where available. The engineer monitoring the work zone may also notify the contractor of delays that require prompt mitigation. The contractor may work with the engineer to determine what other alternative solutions or time periods would be acceptable. When a Work Zone Analysis Spreadsheet is provided, the contractor will find it in the electronic deliverables on MoDOT's Online Plans Room. The contractor may refer to the Work Zone Analysis Spreadsheet for detailed information on traffic delays.

2.5.1 Traffic Safety.

2.5.1.1 Recurring Congestion. Where traffic queues routinely extend to within 1000 feet of the ROAD WORK AHEAD, or similar, sign on a divided highway or to within 500 feet of the ROAD WORK AHEAD, or similar, sign on an undivided highway, the contractor shall extend the advance warning area, as approved by the engineer.

2.5.1.2 Non-Recurring Congestion. When traffic queues extend to within 1000 feet of the ROAD WORK AHEAD, or similar, sign on a divided highway or to within 500 feet of the ROAD WORK AHEAD, or similar, sign on an undivided highway infrequently, the contractor shall deploy a means of providing advance warning of the traffic congestion, as approved by the engineer. The warning location shall be no less than 1000 feet and no more than 0.5 mile in advance of the end of the traffic queue on divided highways and no less than 500 feet and no more than 0.5 mile in advance of the end of the traffic queue on undivided highways.

3.0 Work Hour Restrictions.

3.1 Except for emergency work, as determined by the engineer, and long term lane closures required by project phasing, all lanes shall be scheduled to be open to traffic during the five major holiday periods shown below, from 12:00 noon on the last working day preceding the holiday until

6:00 a.m. on the first working day subsequent to the holiday unless otherwise approved by the engineer.

Memorial Day
Labor Day
Thanksgiving
Christmas
New Year's Day

3.1.1 Independence Day. The lane restrictions specified in Section 3.1 shall also apply to Independence Day, except that the restricted periods shall be as follows:

| When Independence Day falls on: | The Holiday is Observed on: | Halt Lane Closures beginning at: | Allow Lane Closures to resume at: |
|---------------------------------|-----------------------------|----------------------------------|-----------------------------------|
| Sunday | Monday | Noon on Friday | 6:00 a.m. on Tuesday |
| Monday | Monday | Noon on Friday | 6:00 a.m. on Tuesday |
| Tuesday | Tuesday | Noon on Monday | 6:00 a.m. on Wednesday |
| Wednesday | Wednesday | Noon on Tuesday | 6:00 a.m. on Thursday |
| Thursday | Thursday | Noon on Wednesday | 6:00 a.m. on Friday |
| Friday | Friday | Noon on Thursday | 6:00 a.m. on Monday |
| Saturday | Friday | Noon on Thursday | 6:00 a.m. on Monday |

3.2 The contractor shall not perform any construction operation on the roadway, roadbed or active lanes, including the hauling of material within the project limits, during restricted periods, holiday periods or other special events specified in the contract documents.

3.4 Any work requiring a reduction in the number of through lanes of traffic shall be completed during nighttime hours. Nighttime hours shall be considered to be 7:00 p.m. to 7:00 a.m. for this project.

3.5 The contractor shall not alter the start time, ending time, or a reduction in the number of through lanes of traffic or ramp closures without advance notification and approval by the engineer. The only work zone operation approved to begin 30 minutes prior to a reduction in through traffic lanes or ramp closures is the installation of traffic control signs. Should lane closures be placed or remain in place, prior to the approved starting time or after the approved ending time, the Commission, the traveling public, and state and local police and governmental authorities will be damaged in various ways, including but not limited to, increased construction administration cost, potential liability, traffic and traffic flow regulation cost, traffic congestion and motorist delays, with a resulting cost to the traveling public. These damages are not easily computed or quantified. Therefore, the contractor will be charged with liquidated damages specified in the amount of **\$1000 per 15 minute increment** for each 15 minutes that the temporary lane closures are in place and not open to traffic in excess of the limitation as specified elsewhere in this special provision. It shall be the responsibility of the engineer to determine the quantity of unapproved closure time.

3.5.1 The said liquidated damages specified will be assessed regardless if it would otherwise be charged as liquidated damages under the Missouri Standard Specification for Highway Construction, as amended elsewhere in this contract.

4.0 Detours and Lane Closures.

4.1 When a changeable message sign (CMS) is provided, the contractor shall use the CMS to notify motorists of future traffic disruption and possible traffic delays one week before traffic is shifted to a detour or prior to lane closures. The CMS shall be installed at a location as approved or directed by the engineer. If a CMS with Communication Interface is required, then the CMS shall be capable of communication prior to installation on right of way. All messages planned for use in the work zone shall be approved and authorized by the engineer or its designee prior to deployment. When permanent dynamic message signs (DMS) owned and operated by MoDOT are located near the project, they may also be used to provide warning and information for the work zone. Permanent DMS shall be operated by the TMC, and any messages planned for use on DMS shall be approved and authorized by the TMC at least 72 hours in advance of the work.

4.2 At least one lane of traffic in each direction shall be maintained at all times except for brief intervals of time required when the movement of the contractor's equipment will seriously hinder the safe movement of traffic. Periods during which the contractor will be allowed to interrupt traffic will be designated by the engineer.

5.0 Basis of Payment. No direct payment will be made to the contractor to recover the cost of equipment, labor, materials, or time required to fulfill the above provisions, unless specified elsewhere in the contract document. All authorized changes in the traffic control plan shall be provided for as specified in Sec 616.

D. Emergency Provisions and Incident Management JSP-90-11A

1.0 The contractor shall have communication equipment on the construction site or immediate access to other communication systems to request assistance from law enforcement or other emergency agencies for incident management. In case of traffic accidents or the need for law enforcement to direct or restore traffic flow through the job site, the contractor shall notify law enforcement or other emergency agencies immediately as needed. The area engineer's office shall also be notified when the contractor requests emergency assistance.

2.0 In addition to the 911 emergency telephone number for ambulance, fire or law enforcement services, the following agencies may also be notified for accident or emergency situation within the project limits.

| MISSOURI HIGHWAY PATROL | | |
|--|-------------------------------|---------------------------|
| TROOP E - 573-840-9500 | | |
| City of Jackson | City of Cape Girardeau | City of Scott City |
| Fire 1: 573-243-1010 | Fire: 573-339-6330 | Fire: 573-264-2126 |
| Fire 2: 573-204-0606 | Police: 573-335-6621 | Police: 573-264-2157 |
| Police: 573-243-3151 | | |
| Cape Girardeau County Sheriff: 573-243-3551 | | |
| Scott County Sheriff: 573-545-3525 | | |

2.1 This list is not all inclusive. Notification of the need for wrecker or tow truck services will remain the responsibility of the appropriate law enforcement agency.

Job No.: J9I3838
Route: I-55
County: Cape Girardeau/Scott

2.2 The contractor shall notify law enforcement and emergency agencies before the start of construction to request their cooperation and to provide coordination of services when emergencies arise during the construction at the project site. When the contractor completes this notification with law enforcement and emergency agencies, a report shall be furnished to the engineer on the status of incident management.

3.0 No direct pay will be made to the contractor to recover the cost of the communication equipment, labor, materials or time required to fulfill the above provisions.

E. Project Contact for Contractor/Bidder Questions JSP-96-05A

1.0 All questions concerning this project during the bidding process shall be forwarded to the project contact listed below.

Seiji Shimbo, Project Contact
Southeast District
2675 N. Main Street
Sikeston, MO 63801

Telephone Number: 573-472-5389
Email: seiji.shimbo@modot.mo.gov

1.1 All questions concerning the bid document preparation can be directed to the Central Office – Design as listed below.

Telephone Number: (573) 751-2876
Email: BCS@modot.mo.gov

2.0 Upon award and execution of the contract, the successful bidder/contractor shall forward all questions and coordinate the work with the engineer listed below:

Kevin Plott, Resident Engineer
Southeast District
198 State Hwy Y
Jackson, MO 63755

Telephone Number: 573-243-0899
Email: kevin.plottr@modot.mo.gov

F. Supplemental Revisions JSP-18-01KK

- Compliance with [2 CFR 200.216 – Prohibition on Certain Telecommunications and Video Surveillance Services or Equipment.](#)

The Missouri Highways and Transportation Commission shall not enter into a contract (or extend or renew a contract) using federal funds to procure or obtain equipment, services, or systems that uses covered telecommunications equipment or services as substantial or as critical technology as part of any system where the video surveillance and telecommunications equipment was produced by Huawei Technologies Company, ZTE Corporation, Hytera Communications

Corporation, Hangzhou Hikvision Digital Technology Company, or Dahua Technology Company (or any subsidiary or affiliate of such entities).

- Stormwater Compliance Requirements

1.0 Description. This provision requires the contractor to provide a Water Pollution Control Manager (WPCM) for any project that includes land disturbance on the project site and the total area of land disturbance, both on the project site, and all Off-site support areas, is one (1) acre or more. Regardless of the area of Off-site disturbance, if no land disturbance occurs on the project site, these provisions do not apply. When a WPCM is required, all sections within this provision shall be applicable, including assessment of specified Liquidated Damages for failure to correct Stormwater Deficiencies, as specified herein. This provision is in addition to any other stormwater, environmental, and land disturbance requirements specified elsewhere in the contract.

1.1 Definitions. The project site is defined as all areas designated on the plans, including temporary and permanent easements. The project site is equivalent to the “permitted site”, as defined in MoDOT’s State Operating Permit. An Off-site area is defined as any location off the project site the contractor utilizes for a dedicated project support function, such as, but not limited to, staging area, plant site, borrow area, or waste area.

1.2 Reporting of Off-Site Land Disturbance. If the project includes any planned land disturbance on the project site, prior to the start of work, the contractor shall submit a written report to the engineer that discloses all Off-site support areas where land disturbance is planned, the total acreage of anticipated land disturbance on those sites, and the land disturbance permit number(s). Upon request by the engineer, the contractor shall submit a copy of its land disturbance permit(s) for Off-site locations. Based on the total acreage of land disturbance, both on and Off-site, the engineer shall determine if these Stormwater Compliance Requirements shall apply. The Contractor shall immediately report any changes to the planned area of Off-site land disturbance. The Contractor is responsible for obtaining its own separate land disturbance permit for Off-site areas.

2.0 Water Pollution Control Manager (WPCM). The Contractor shall designate a competent person to serve as the Water Pollution Control Manager (WPCM) for projects meeting the description in Section 1.0. The Contractor shall ensure the WPCM completes all duties listed in Section 2.1.

2.1 Duties of the WPCM:

- (a) Be familiar with the stormwater requirements including the current MoDOT State Operating Permit for construction stormwater discharges/land disturbance activities; MoDOT’s statewide Stormwater Pollution Prevention Plan (SWPPP); the Corps of Engineers Section 404 Permit, when applicable; the project specific SWPPP, the Project’s Erosion & Sediment Control Plan; all applicable special provisions, specifications, and standard drawings; and this provision;
- (b) Successfully complete the MoDOT Stormwater Training Course within the last 4 years. The MoDOT Stormwater Training is a free online course available at MoDOT.org;

- (c) Attend the Pre-Activity Meeting for Grading and Land Disturbance and all subsequent Weekly Meetings in which grading activities are discussed;
- (d) Oversee and ensure all work is performed in accordance with the Project-specific SWPPP and all updates thereto, or as designated by the engineer;
- (e) Review the project site for compliance with the Project SWPPP, as needed, from the start of any grading operations until final stabilization is achieved, and take necessary actions to correct any known deficiencies to prevent pollution of the waters of the state or adjacent property owners prior to the engineer's weekly inspections;
- (f) Review and acknowledge receipt of each MoDOT Inspection Report (Land Disturbance Inspection Record) for the Project within forty eight (48) hours of receiving the report and ensure that all Stormwater Deficiencies noted on the report are corrected as soon as possible, but no later than stated in Section 5.0.

3.0 Pre-Activity Meeting for Grading/Land Disturbance and Required Hold Point. A Pre-Activity meeting for grading/land disturbance shall be held prior to the start of any land disturbance operations. No land disturbance operations shall commence prior to the Pre-Activity meeting except work necessary to install perimeter controls and entrances. Discussion items at the pre-activity meeting shall include a review of the Project SWPPP, the planned order of grading operations, proposed areas of initial disturbance, identification of all necessary BMPs that shall be installed prior to commencement of grading operations, and any issues relating to compliance with the Stormwater requirements that could arise in the course of construction activity at the project.

3.1 Hold Point. Following the pre-activity meeting for grading/land disturbance and subsequent installation of the initial BMPs identified at the pre-activity meeting, a Hold Point shall occur prior to the start of any land disturbance operations to allow the engineer and WPCM the time needed to perform an on-site review of the installation of the BMPs to ensure compliance with the SWPPP is met. Land disturbance operations shall not begin until authorization is given by the engineer.

4.0 Inspection Reports. Weekly and post run-off inspections will be performed by the engineer and each Inspection Report (Land Disturbance Inspection Record) will be entered into a web-based Stormwater Compliance database. The WPCM will be granted access to this database and shall promptly review all reports, including any noted deficiencies, and shall acknowledge receipt of the report as required in Section 2.1 (f.).

5.0 Stormwater Deficiency Corrections. All stormwater deficiencies identified in the Inspection Report shall be corrected by the contractor within 7 days of the inspection date or any extended period granted by the engineer when weather or field conditions prohibit the corrective work. If the contractor does not initiate corrective measures within 5 calendar days of the inspection date or any extended period granted by the engineer, all work shall cease on the project except for work to correct these deficiencies, unless otherwise allowed by the engineer. All impact costs related to this halting of work, including, but not limited to stand-by time for equipment, shall be borne by the Contractor. Work shall not resume until the engineer approves the corrective work.

5.1 Liquidated Damages. If the Contractor fails to complete the correction of all Stormwater Deficiencies listed on the MoDOT Inspection Report within the specified time limit, the Commission will be damaged in various ways, including but not limited to, potential liability, required mitigation, environmental clean-up, fines, and penalties. These damages are not

reasonably capable of being computed or quantified. Therefore, the contractor will be charged with liquidated damages specified in the amount of \$2,000 per day for failure to correct one or more of the Stormwater Deficiencies listed on the Inspection Report within the specified time limit. In addition to the stipulated damages, the stoppage of work shall remain in effect until all corrections are complete.

6.0 Basis of Payment. No direct payment will be made for compliance with this provision.

- ***Delete Sec 106.9 in its entirety and substitute the following:***

106.9 Buy America Requirements.

Buy America Requirements are waived if the total amount of Federal financial assistance applied to the project, through awards or subawards, is below \$500,000.

106.9.1 Buy America Requirements for Iron or Steel Products.

The contractor's attention is directed to Title 23 CFR 635.410 *Buy America Requirements*. Where articles, materials or supplies that consist wholly or predominantly of iron or steel or a combination of both are to be permanently incorporated into the contract work, steel and iron material shall be manufactured, from the initial melting stage through the application of coatings, in the USA except for "minimal use" as described herein. Predominantly of iron or steel or a combination of both means that the cost of the iron and steel content exceeds 50 percent of the total cost of all its components. Under a general waiver from FHWA the use of pig iron and processed, pelletized, and reduced iron ore manufactured outside of the USA will be permitted in the domestic manufacturing process for steel or iron material.

106.9.1.1 Any sources other than the USA as defined will be considered foreign. The required domestic manufacturing process shall include formation of ingots and any subsequent process. Coatings shall include any surface finish that protects or adds value to the product.

106.9.1.2 "Minimal use" of foreign steel, iron or coating processes will be permitted, provided the cost of such products does not exceed 1/10 of one percent (0.1 percent) of the total contract cost or \$2,500.00, whichever is greater. If foreign steel, iron, or coating processes are used, invoices to document the cost of the foreign portion, as delivered to the project, shall be provided and the engineer's written approval obtained prior to placing the material in any work.

106.9.1.3 Buy America requirements include a step certification for all fabrication processes of all steel or iron materials that are accepted per Sec 1000. The AASHTO Product Evaluation and Audit Solutions compliance program verifies that all steel and iron products fabrication processes conform to 23 CFR 635.410 Buy America Requirements and is an acceptable standard per 23 CFR 635.410(d). AASHTO Product Evaluation and Audit Solutions compliant suppliers will not be required to submit step certification documentation with the shipment for some selected steel and iron materials. The AASHTO Product Evaluation and Audit Solutions compliant supplier shall maintain the step certification documentation on file and shall provide this documentation to the engineer upon request.

106.9.1.3.1 Items designated as Category 1 will consist of steel girders, piling, and reinforcing steel installed on site. Category 1 items require supporting documentation prior to incorporation into the project showing all steps of manufacturing, including coating, as being completed in the United States and in accordance with CFR Title 23 Section 635.410 Buy America Requirements. This includes the Mill Test Report from the original producing steel mill and certifications

documenting the manufacturing process for all subsequent fabrication, including coatings. The certification shall include language that certifies all steel and iron materials permanently incorporated in this project was procured and processed domestically and all manufacturing processes, including coating, as being completed in the United States and in accordance with CFR Title 23 Section 635.410.

106.9.1.3.2 Items designated as Category 2 will include all other steel or iron products not in Category 1 and permanently incorporated in the project. Category 2 items shall consist of, but not be limited to items such as fencing, guardrail, signing, lighting and signal supports. The prime contractor is required to submit a material of origin form certification prior to incorporation into the project from the fabricator for each item that the product is domestic. The Certificate of Materials Origin form ([link to certificate form](#)) from the fabricator must show all steps of manufacturing, including coating, as being completed in the United States and in accordance with CFR Title 23 Section 635.410 Buy America Requirements and be signed by a fabricator representative. The engineer reserves the right to request additional information and documentation to verify that all Buy America requirements have been satisfied. These documents shall be submitted upon request by the engineer and retained for a period of 3 years after the last reimbursement of the material.

106.9.1.3.3 Any minor miscellaneous steel or iron items that are not included in the materials specifications shall be certified by the prime contractor as being procured domestically. Examples of these items would be bolts for sign posts, anchorage inserts, etc. The certification shall read "I certify that all steel and iron materials permanently incorporated in this project during all manufacturing processes, including coating, as being completed in the United States and in accordance with CFR Title 23 Section 635.410 Buy America Requirements procured and processed domestically in accordance with CFR Title 23 Section 635.410 Buy America Requirements. Any foreign steel used was submitted and accepted under minor usage". The certification shall be signed by an authorized representative of the prime contractor.

106.9.1.4 When permitted in the contract, alternate bids may be submitted for foreign steel and iron products. The award of the contract when alternate bids are permitted will be based on the lowest total bid of the contract based on furnishing domestic steel or iron products or 125 percent of the lowest total bid based on furnishing foreign steel or iron products. If foreign steel or iron products are awarded in the contract, domestic steel or iron products may be used; however, payment will be at the contract unit price for foreign steel or iron products.

106.9.2 Buy America Requirements for Construction Materials other than iron or steel products.

Construction materials mean articles, materials, or supplies that consist of only one of the items listed. Minor additions of articles, materials, supplies, or binding agents to a construction material do not change the categorization of the construction material. Upon request by the engineer, the contractor shall submit a domestic certification for all construction materials listed that are incorporated into the project.

- (a) Non-ferrous metals
- (b) Plastic and Polymer-based products (including polyvinylchloride, composite building materials, and polymers used in fiber optic cables)
- (c) Glass (including optic glass)
- (d) Fiber optic cable (including drop cable)
- (e) Optical fiber
- (f) Lumber

- (g) Engineered wood
- (h) Drywall

106.9.3 Buy America Requirements for Manufactured Products.

Manufactured products mean articles, materials or supplies that have been processed into a specific form and shape, or combined with other articles, materials or supplies to create a product with different properties than the individual articles, materials or supplies. If an item is classified as an iron or steel product, an excluded material, or other product category as specified by law or in 2 CFR part 184, then it is not a manufactured product. However, an article, material or supply classified as a manufactured product may include components that are iron or steel products, excluded materials, or other product categories as specified by law or in 2 CFR part 184. Mixtures of excluded materials delivered to a work site without final form for incorporation into a project are not a manufactured product.

106.9.3.1 Produced in the United States, in the case of manufactured products, means:

- (A) For projects obligated on or after October 1, 2025, the product was manufactured in the United States; and
- (B) For projects obligated on or after October 1, 2026, the product was manufactured in the United States and the cost of the components of the manufactured product that are mined, produced, or manufactured in the United States is greater than 55 percent of the total cost of all components of the manufactured product.

106.9.3.2 (i) With respect to precast concrete products that are classified as manufactured products, components of precast concrete products that consist wholly or predominantly of iron or steel or a combination of both shall meet the requirements of paragraph (b) of this section. The cost of such components shall be included in the applicable calculation for purposes of determining whether the precast concrete product is produced in the United States.

(ii) With respect to intelligent transportation systems and other electronic hardware systems that are installed in the highway right of way or other real property and classified as manufactured products, the cabinets or other enclosures of such systems that consist wholly or predominantly of iron or steel or a combination of both shall meet the requirements of paragraph (b) of this section. The cost of cabinets or other enclosures shall be included in the applicable calculation for purposes of determining whether systems referred to in the preceding sentence are produced in the United States.

106.9.4 Waiver for De Minimis Costs for Manufactured and Construction Materials other than iron or steel products.

“The total value of the non-compliant products is no more than the lesser of \$1,000,000 or 5% of total applicable costs for the project.” The contractor shall submit to the engineer any non-domestic materials and their total material cost to the engineer. The contractor and the engineer will both track these totals to assure that the minimal usage allowance is not exceeded.

- Third-Party Test Waiver for Concrete Aggregate

1.0 Description. Third party tests may be allowed for determining the durability factor for concrete pavement and concrete masonry aggregate.

2.0 Material. All aggregate for concrete shall be in accordance with Sec 1005.

2.1 MoDOT personnel shall be present at the time of sampling at the quarry. The aggregate sample shall be placed in an approved tamper-evident container (provided by the quarry) for shipment to the third-party testing facility.

2.2 AASHTO T 161 Method B Resistance of Concrete to Rapid Freezing and Thawing, shall be used to determine the aggregate durability factor. All concrete beams for testing shall be 3-inch wide by 4-inch deep by 16-inch long or 3.5-inch wide by 4.5-inch deep by 16-inch long. All beams for testing shall receive a 35-day wet cure fully immersed in saturated lime water prior to initiating the testing process.

2.3 Concrete test beams shall be made using a MoDOT approved concrete pavement mix design.

3.0 Testing Facility Requirements. All third-party test facilities shall meet the requirements outlined in this provision.

3.1 The testing facility shall be AASHTO accredited.

3.1.1 For tests ran after January 1, 2025, accreditation documentation shall be on file with the Construction and Materials Division prior to any tests being performed.

3.1.2 Construction and Materials Division may consider tests completed prior to January 1, 2025, to be acceptable if all sections of this provision are met, with the exception of 3.1.1. Accreditation documentation shall be provided with the test results for tests completed prior to January 1, 2025. No tests completed prior to September 1, 2024, will be accepted.

3.2 The testing facility shall provide their testing process, list of equipment, equipment calibration documentation, and testing certifications or qualifications of technicians performing the AASHTO T 161 Procedure B tests. The testing facility shall provide details on their freezing and thawing apparatus including the time and temperature profile of their freeze-thaw chamber. The profile shall include the temperature set points throughout the entirety of the freeze-thaw cycle. The profile shall show the cycle time at which the apparatus drains/fills with water and the cycle time at which the apparatus begins cooling the specimens.

3.3 Results, no more than five years old, from the third-party test facility shall compare within ± 2.0 percent of an independent test from another AASHTO accredited test facility or with MoDOT test records, in order to be approved for use (e.g. test facility results in a durability factor of 79, MoDOT's recent durability test factor is 81; this compared within $+2$ percent). The independent testing facility shall be in accordance with this provision. The comparison test can be from a different sample of the same ledge combination.

3.4 When there is a dispute between the third party durability test results and MoDOT durability test results, the MoDOT durability test result shall govern.

3.5 Test results shall be submitted to MoDOT's Construction and Materials division electronically for final approval. Test results shall include raw data for all measurements of relative dynamic modulus of elasticity and percent length change for each individual concrete specimen. Raw data shall include initial measurements made at zero cycles and every subsequent measurement of concrete specimens. Raw data shall include the cycle count and date each measurement was taken. Test results shall also include properties of the concrete mixture as required by AASHTO T 161. This shall include the gradation of the coarse aggregate sample. If AASHTO T 152 is

used to measure fresh air content, then the aggregate correction factor for the mix determined in accordance with AASHTO T 152 shall also be included.

4.0 Method of Measurement. There is no method of measurement for this provision. The testing requirements and number of specimens shall be in accordance with AASHTO T 161 Procedure B.

5.0 Basis of Payment. No direct payment will be made to the contractor or quarry to recover the cost of aggregate samples, sample shipments, testing equipment, labor to prepare samples or test samples, or developing the durability report.

- ***Delete paragraph 15.0 of the General Provision Disadvantaged Business Enterprise (DBE) Program Requirements and substitute the following:***

15.0 Bidder's List Quote Summary. MoDOT is a recipient of federal funds and is required by 49 CFR 26.11 to provide data about its DBE program. All bidders who seek to work on federally assisted contracts must submit data about all DBE and non-DBEs in accordance with Sec 102.7.9. MoDOT will not compare the submitted Bidder's List Quote Summary to any other documents or submittals, pre or post award. All information will be used by MoDOT in accordance with 49 CFR 26.11 for reporting to USDOT and to aid in overall DBE goal setting.

- ***Add Sec 102.7.9 to include the following:***

102.7.9 Bidder's List Quote Summary. Each bidder shall submit with each bid a summary of all subcontractors, material suppliers, and service providers (e.g. hauling) considered on federally funded projects pursuant to 49 CFR 26.11. The bidder will provide the firm's name, the corresponding North American Industry Classification System (NAICS) code(s) the firm(s) were considered for, and whether or not they were used in the bid. The information submitted should be the most complete information available at the time of bid. The information shall be disclosed on the Bidder's List Quote Summary form provided in the bidding documents and submitted in accordance with Sec 102.10. Failure to disclose this information may result in a bid being declared irregular.

G. Contractor Quality Control NJSP-15-42

1.0 The contractor shall perform Quality Control (QC) testing in accordance with the specifications and as specified herein. The contractor shall submit a Quality Control Plan (QC Plan) to the engineer for approval that includes all items listed in Section 2.0, prior to beginning work.

2.0 Quality Control Plan.

- (a) The name and contact information of the person in responsible charge of the QC testing.
- (b) A list of the QC technicians who will perform testing on the project, including the fields in which they are certified to perform testing.
- (c) A proposed independent third party testing firm for dispute resolution, including all contact information.
- (d) A list of Hold Points, when specified by the engineer.

(e) The MoDOT Standard Inspection and Testing Plan (ITP). This shall be the version that is posted at the time of bid on the MoDOT website (www.modot.org/quality).

3.0 Quality Control Testing and Reporting. Testing shall be performed per the test method and frequency specified in the ITP. All personnel who perform sampling or testing shall be certified in the MoDOT Technician Certification Program for each test that they perform.

3.1 Reporting of Test Results. All QC test reports shall be submitted as soon as practical, but no later than the day following the test. Test data shall be immediately provided to the engineer upon request at any time, including prior to the submission of the test report. No payment will be made for the work performed until acceptable QC test results have been received by the engineer and confirmed by QA test results.

3.1.1 Test results shall be reported on electronic forms provided by MoDOT. Forms and Contractor Reporting Excel2Oracle Reports (CRE2O) can be found on the MoDOT website. All required forms, reports and material certifications shall be uploaded to a Microsoft SharePoint® site provided by MoDOT, and organized in the file structure established by MoDOT.

3.2 Non-Conformance Reporting. A Non-Conformance Report (NCR) shall be submitted by the contractor when the contractor proposes to incorporate material into the work that does not meet the testing requirements or for any work that does not comply with the contract terms or specifications.

3.2.1 Non-Conformance Reporting shall be submitted electronically on the Non-Conformance Report form provided on the MoDOT Website. The NCR shall be uploaded to the MoDOT SharePoint® site and an email notification sent to the engineer.

3.2.2 The contractor shall propose a resolution to the non-conforming material or work. Acceptance of a resolution by the engineer is required before closure of the non-conformance report.

4.0 Work Planning and Scheduling.

4.1 Two-week Schedule. Each week, the contractor shall submit to the engineer a schedule that outlines the planned project activities for the following two-week period. The two-week schedule shall detail all work and traffic control events planned for that period and any Hold Points specified by the engineer.

4.2 Weekly Meeting. When work is active, the contractor shall hold a weekly project meeting with the engineer to review the planned activities for the following week and to resolve any outstanding issues. Attendees shall include the engineer, the contractor superintendent or project manager and any foreman leading major activities. This meeting may be waived when, in the opinion of the engineer, a meeting is not necessary. Attendees may join the meeting in person, by phone or video conference.

4.3 Pre-Activity Meeting. A pre-activity meeting is required in advance of the start of each new activity, except when waived by the engineer. The purpose of this meeting is to review construction details of the new activity. At a minimum, the discussion topics shall include: safety precautions, QC testing, traffic impacts, and any required Hold Points. Attendees shall include the engineer, the contractor superintendent and the foreman who will be leading the new activity. Pre-activity meetings may be held in conjunction with the weekly project meeting.

4.4 Hold Points. Hold Points are events that require approval by the engineer prior to continuation of work. Hold Points occur at definable stages of work when, in the opinion of the engineer, a review of the preceding work is necessary before continuation to the next stage.

4.4.1 A list of typical Hold Point events is available on the MoDOT website. Use of the Hold Point process will only be required for the project-specific list of Hold Points, if any, that the engineer submits to the contractor in advance of the work. The engineer may make changes to the Hold Point list at any time.

4.4.2 Prior to all Hold Point inspections, the contractor shall verify the work has been completed in accordance with the contract and specifications. If the engineer identifies any corrective actions needed during a Hold Point inspection, the corrections shall be completed prior to continuing work. The engineer may require a new Hold Point to be scheduled if the corrections require a follow-up inspection. Re-scheduling of Hold Points require a minimum 24-hour advance notification from the contractor unless otherwise allowed by the engineer.

5.0 Quality Assurance Testing and Inspection. MoDOT will perform quality assurance testing and inspection of the work, except as specified herein. The contractor shall utilize the inspection checklists provided in the ITP as a guide to minimize findings by MoDOT inspection staff. Submittal of completed checklists is not required, except as specified in 5.1.

5.1 Inspection and testing required in the production of concrete for the project shall be the responsibility of the contractor. Submittal of the 501 Concrete Plant Checklist is required.

6.0 Basis of Payment. No direct payment will be made for compliance with this provision.

H. Experimental Test Sections for Frictional Characteristics

1.0 Description. This special provision details construction of seven different test sections (including control section) located on Interstate 55 in Cape Girardeau County, Project J9I3838. The purpose of the test sections is to study frictional characteristics and overlay performance in SP095 mixtures with varying requirements using Mix Design (BMD) parameters and different asphalt binder types. Areas not described in the following Job Special Provision are to be constructed in accordance with the plans and specifications as described in the contract documents.

2.0 General. The contractor shall be responsible for meeting the performance requirements on all asphalt mix designs for this project. Acceptable test results meeting the performance requirements in JSP2401 – Balanced Mix Design Requirements for Cracking Tolerance Index (CT_{Index}), Rutting Tolerance Index (RT_{Index}) and Hamburg Wheel Track (HWT) shall be submitted with the mix design for each test section. SMA mixtures not meeting minimum RT_{Index} requirements will be approved provided that the mixtures meet the minimum CT_{Index} and Hamburg requirements.

2.1.1 The contractor shall submit a schedule of work at least seven days prior to work beginning within test section areas specified in Section 3.0. Any changes to the schedule, except weather related events, shall be provided to the engineer in writing at least three days prior to the change in work schedule occurring.

2.1.2 The contractor shall allow the Commission and the research entities associated with this project access to all operations for data collection.

Types of data collection during production include, but are not limited to the following:

- Sampling of asphalt mixtures and components of mixtures at the plant
- Verifying additive rates at the plant
- Pavement testing before and after overlay construction

2.1.3 A designated work area shall be dedicated to the research team at the asphalt plant. The work area shall be large enough to set-up a mobile trailer with two parking spots. The contractor shall provide four separate 20-amp electrical circuits to meet the research team's equipment needs.

2.1.4 MoDOT will provide traffic control for the research entities and coordinate with the contractor prior to starting work.

2.1.5 The contractor shall submit all mix designs to Construction and Materials for approval at least 3 months in advanced of placing any mixture on the test section. The contractor shall consider the switching of materials, different mix designs, meeting BMD performance requirements, and construction methods of the seven test sections as part of their bid proposal.

2.2 Asphalt Binder Source and Additives. The contractor shall have the capability of providing the different asphalt grades and asphalt additives during production. All mix designs shall contain either a liquid anti-strip or a mineral filler to mitigate stripping. TSR testing shall be required during mix design but will not be required for the individual test sections during production.

3.0 Test Section Locations and General Descriptions. Each test section shall be constructed in the southbound driving lane only (or adjacent shoulder area) on I-55 from log mile 103.92 to 107.2 (Just south of Exit 105, I-55/US 61 interchange to north of Exit 102, LaSalle Ave/Main Street interchange. Each test section description and location are listed as follows:

| Section ID/Name ¹ | Log Miles (Includes Transitional Areas and Test Section Location) | Mile Marker Test Section Location ² | General Description |
|--|---|---|--|
| SP095B w/ Hi-Mod asphalt binder | 103.92 to 105.22 | Mile-Marker 104.8 to 104.6 (104.97 to 105.17) | SP095 dense graded mixture using highly polymer modified asphalt binder |
| SP095BSM w/ PG 76-22 and lower virgin asphalt content | 105.22 to 105.62 | Mile-Marker 104.4 to 104.2 (105.37 to 105.57) | SMA Mixture that sets the virgin asphalt content by meeting the minimum BMD criteria. |
| SP095BSM w/ PG 76-22 SMA Mixture per JSP2401 | Not to be used on Mainline (For Shoulder Construction Only – 105.22 to 105.62) | Place mix on shoulder adjacent to previous test section | SP095BSM w/ PG 76-22 following JSP2401 Requirements |
| SP095BSM w/ ECR plus Fibers | 105.62 to 106.02 | Mile-Marker 104.0 to 103.8 (105.77 to 105.97) | SMA mixture using Elastiko™ Engineered Crumb Tire Rubber – 10 % by weight of virgin asphalt binder. Cellulose fibers included with mixture. |

| | | | |
|-------------------------------|------------------|---|--|
| SP095BSM w/ ECR no Fibers | 106.02 to 106.42 | Mile-Marker 103.6 to 103.4 (106.17 to 106.37) | SMA mixture using Elastiko™ Engineered Crumb Tire Rubber – 10 % by weight of virgin asphalt binder. No Cellulose fibers. |
| SP095BLP w/ PG 76-22 | 106.42 to 106.82 | Mile-Marker 103.2 to 103.0 (106.57 to 106.77) | SP095 Dense Graded Mix meeting Sec 403.3.3 aggregate requirements. |
| CONTROL SP095B w/ PG 76-22 | 106.82 to 107.20 | Mile-Marker 102.8 to 102.6 (106.97 to 107.17) | Same as Typical Section |

¹Note: The contractor may reorder the construction of test sections. All changes shall be recorded in writing to the engineer.

²The actual test section for each mixture shall match the physical mile marker posts.

3.1 General Asphalt Mix and Construction Requirements. Asphalt mixtures shall follow one or a combination of the following specifications, except as noted herein:

- JSP2401 – Balanced Mix Design Requirements
- JSP2502 – HiMod Asphalt Mixture Requirements
- General Provisions, Division 100 - Ground Tire Rubber (GTR) dry process modification of Bituminous Pavement.

Each test section shall be treated as small quantity with no PWL, pay factors, or paver-mounted thermal profiler requirements. Pavement smoothness throughout the test section limits shall be waived of profiler requirements and shall meet Longitudinal and Transverse Straightedging requirements in accordance with Sec 610.4.3 and Sec 610.4.4. Final acceptance of all test sections and transitions shall be in accordance with Section 5.0 described herein.

3.2 Test Section Description. Each test section shall be constructed to following specifications:

SP095B w/ Hi-Mod asphalt binder. This section shall be designed and constructed in accordance with JSP2502 – HiMod Asphalt Mixture Requirements.

SP095BSM w/ lower asphalt binder. This section shall be designed and constructed in accordance with JSP2401- Balanced Mix Design Requirements, except the minimum virgin asphalt content and SuperPave volumetric requirements of VMA and VFA shall be waived. Mix used for construction of this section shall be designed and produced to meet BMD performance criteria in accordance with JSP2401.

SP095BSM w/ PG 76-22 (Control). This mixture shall be produced and placed only on the outer shoulder areas adjacent to the SP095BSM w/ lower asphalt binder. The mixture shall meet all JSP2401 mixture requirements.

SP095BSM w/ ECR plus Fibers. This section shall be designed and constructed in accordance with JSP2401 - Balanced Mix Design Requirements along with General Provisions, Division 100 – Ground Tire Rubber (GTR) dry process modification of bituminous pavement. This section shall contain Engineered Crumb Rubber (ECR) additive Elastiko™ supplied by Asphalt Plus, LLC. The target ECR additive rate is 10 percent by weight of virgin asphalt binder.


SP095BSM w/ ECR without Fibers. This test section shall be the same as the SP095BSM w/ ECR plus Fibers, except cellulose fibers shall not be incorporated into the ECR mixture.

SP095BLP w/ PG 76-22. This section shall be designed and constructed in accordance with JSP2401 - Balanced Mix Design Requirements where Sec 403.3.3 aggregate requirements shall apply.

SP095B w/ PG 76-22 (Control). This section shall be the control section that meets Sec 403 requirements.

4.0 Construction and Material Requirements. All test sections shall be constructed as described herein.

4.1 Test Section Construction. Each test section constructed shall consist of a 0.2-miles (1056-foot) testing area that shall represent the mix design. The beginning and ending of each test section shall match the existing mile marker post. If the mile marker post does not exist, the contractor shall provide a temporary stake to mark the location. An example layout of the test sections is illustrated as follows:

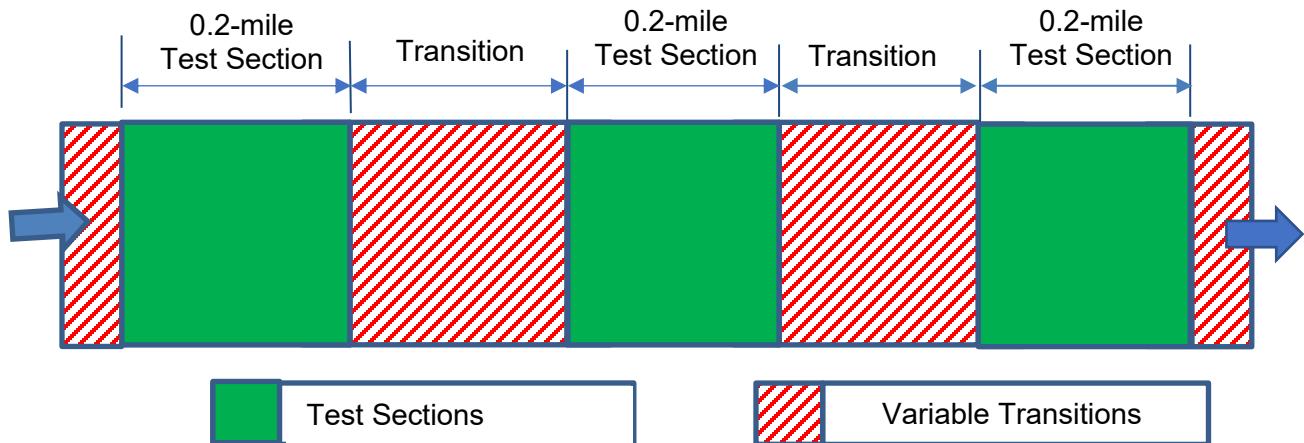

4.2 Transition Zones. Transition zones are provided between test sections for switching mix types, finish out any leftover quantities from the previous test section, and/or adjust the mixtures for the test section. The transition zones vary in length and are approximately 1000-feet. The contractor may also utilize the shoulders for trial runs at the contract unit price for BP-2.

5.0 Quality Control and Quality Acceptance.

The following table details the minimum number of specimens required for QC and QA testing at the plant for each test section:

| Test Method | Minimum Number of Specimens | Molded Specimen Height (mm) |
|---|-----------------------------|---------------------------------|
| QC Frequency: 1 Set per Test Section QA Frequency: Retained Loose Mix Only¹ | | |
| Cracking Tolerance Index (CT _{Index}) | 5 Compacted Specimens | 62 (± 1 mm) ^(b) |
| Rutting Tolerance Index (RT _{Index}) | 3 Compacted Specimens | 62 (± 1 mm) ^(b) |
| QC and QA Retained Loose Mix (for performance testing) | 250 lbs each | N/A |
| % Asphalt Content | 1 Sample | N/A |
| Theo. Max SG of mixture, Gmm | 1 Sample | N/A |
| % Air Voids | 2 Compacted Specimens | N _{Design} |
| QC and QA Retained Loose Mix (for volumetric testing) | 40 lbs each | N/A |

¹QA will run Hamburg test for all test sections out of the retained loose mix

The contractor shall be responsible for establishing the optimum rolling pattern to achieve density within the transition zones prior to each test section and it shall remain consistent and uniform throughout each test section.

Mat density and longitudinal joint density QC and QA core samples shall be taken at the end of the transition zone (just prior to the beginning of each test section) at one location for each test section. Longitudinal joint density QC and QA samples shall be taken within six inches of an unconfined centerline joint.

QC shall perform CT_{Index}, RT_{Index}, air voids, and asphalt content testing from loose mix samples for each test section. QA will conduct Hamburg testing for each test section to verify stability. QC/QA retained loose mix sample shall be taken at the plant for each test section to resolve any issues on testing results.

6.0 Removal of Material.

Mixtures shall be within the specified limits for CT_{Index}, RT_{Index}, V_a, AC, and density.

Test Sections not meeting a minimum CT_{Index} of 40 for non-SMA mixtures and a minimum CT_{Index} of 80 for SMA mixtures shall be removed and replaced with the specified mixture for that test section by the contractor.

Test Sections not meeting the minimum RT_{Index} of 80 shall be evaluated with Hamburg testing and removed and replaced with the specified mixture for that test section by the contractor if the Hamburg testing rut depth is greater than $\frac{1}{2}$ -inch at the designated number of wheel passes.

Test Sections not meeting the specified limits of V_a shall be evaluated with Hamburg testing and removed and replaced with the specified mixture for that test section by the contractor if the Hamburg testing rut depth is greater than $\frac{1}{2}$ -inch at the designated number of wheel passes.

Test Sections not meeting the specified limits of AC shall be removed and replaced with the specified mixture for that test section by the contractor.

Test sections for non-SMA mixtures with a percent of theoretical maximum density of less than 90.5 percent in the mat, or less than 89.5 for unconfined longitudinal joints, shall be removed and replaced with the specified mixture for that test section by the contractor. For SMA mixtures, any test section with a percent of theoretical maximum density of less than 92.0 percent in the mat or less than 90.0 for unconfined longitudinal joints shall be removed and replaced with the specified mixture for that test section by the contractor.

Test sections that have densities above the removal limits, but not meeting the minimum specified density for acceptance shall be corrected with rapid penetrating emulsion as detailed in the following table.

| Field Density (Percent of Laboratory Max. Theoretical Density) | Acceptance |
|--|------------------------------------|
| For all SP mixtures other than SMA: | |
| 92.5 to 98.0 inclusive | 100 |
| 90.5 to 92.4 inclusive | Correction Required ^(a) |
| Above 98.0 or Below 90.5 | Remove and Replace |
| For SMA mixtures: | |
| >94.0 | 100 |
| 92.0 to 93.9 inclusive | Correction Required ^(a) |
| Above 98.0 or Below 92.0 | Remove and Replace |

(a) Correction requires spraying rapid penetrating emulsion on deficient density areas in accordance with JSP2303. All costs associated with correction shall be at the contractor's expense with no additional payment.

| Longitudinal Joint Density | |
|---|------------------------------------|
| Field Density (Percent of Laboratory Max. Theoretical Specific Gravity) | Acceptance |
| SuperPave Mixtures | |
| ≥ 90.5 | 100 |
| 89.5 – 90.4 | Correction Required ^(a) |
| < 89.5 | Remove and Replace |
| SMA Mixtures | |
| > 92.0 | 100 |
| 90.0 – 91.9 | Correction Required ^(a) |
| < 90.0 | Remove and Replace |

(a) Correction requires spraying rapid penetrating emulsion on deficient density areas in accordance with JSP2303. All costs associated with correction shall be at the contractor's expense with no additional payment.

In addition to volumetric, performance, and density testing, any mixture within a test section that exhibits surface defects such as segregation, tenderness, raveling, flushing/bleeding, rutting, holes, debris, etc.; as determined by the engineer, shall be removed and replaced.

When a test section is subject to removal, the cost to remove and replace the unacceptable mix will be shared evenly between the Commission and the contractor once for each test section. The cost for this one-time removal and replacement will be based on the contract unit price for Item No. 403-00.06, Asphaltic Concrete Mixture PG 76-22 (SP095B Mix), plus an additional 30 percent for delta mix costs and removal. No payment will be made for additional removal and replacement of test sections.

7.0 Basis of Payment. Payment for compliance with this provision will be made at the contract unit price for Item No. 403-99.01, Experimental Test Sections, per lump sum.

Item No. 403-99.01, Experimental Test Sections, lump sum should only include costs associated with additional labor, materials, tools, equipment, traffic control, testing, and incidental items necessary to complete the work as described in this provision that are above and beyond costs associated with unit price for Item No. 403-00.06, Asphaltic Concrete Mixture PG 76-22 (SP095B Mix). The asphaltic concrete mixture placed in these test sections will be paid for per ton unit price for Item No. 403-00.06, Asphaltic Concrete Mixture PG 76-22 (SP095B Mix).

I. Modified Winter Months Requirements

1.0 Description. This project contains work which spans the winter months.

2.0 Work to be Completed. The contractor shall cease operations for the winter months by November 1, 2026. Any paving operation performed by the contractor shall not result in a lane height differential between adjacent lanes. Any edge drop off condition resulting from paving operations shall be addressed with edge treatment, as noted in the Plans. Guardrail and Guard Cable installations shall be completed for any completed length where the final surface was placed. Pavement Marking shall be in accordance with section 3.0 of this provision.

3.0 Maintenance of Pavement Marking. No application of Permanent Pavement Marking Paint shall occur between October 1, 2026 and March 1, 2027. Pavement marking between October 1, 2026 and March 1, 2027 shall be Temporary Pavement Marking Paint in accordance with JSP Optional Temporary Pavement Marking Paint.

4.0 Winter Related Maintenance Activities. The contractor shall have the project in a condition as not to interfere with the plowing of snow. The contractor shall also provide a taper at the end of his paving that will not be damaged by the plowing of snow. The taper shall be installed at a length of 100 feet.

5.0 Liquidated Damages Specified. If the requirements for winter months in accordance with this provision are not met and operations are not ceased by November 1, 2026, the Commission, the traveling public, and state and local police and governmental authorities will be damaged in various ways, including but not limited to, increased construction administration cost, potential liability, traffic and traffic flow regulation cost, traffic congestion and motorist delay, with its resulting cost to the traveling public. These damages are not reasonably capable of being computed or quantified. Therefore, the contractor will be charged with liquidated damages

specified in the amount of **\$7,600 per day** for each full day that operations are not ceased. It shall be the responsibility of the engineer to determine the quantity of excess closure time.

5.1 The said liquidated damages specified will be assessed regardless of whether it would otherwise be charged as liquidated damages under the Missouri Standard Specification for Highway Construction, as amended elsewhere in this contract.

6.0 Basis of Payment. There will be no direct pay for compliance with this provision.

J. Order of Work – Paving

1.0 Description. This contract is comprised of disconnect sections (SB LM 103.920 to SB LM 116.283, NB LM 90.206 to NB LM 105.960 and SB Off-ramp at Exit 89). The contractor shall complete work in the following order.

1. Southbound Off-ramp at Exit 89
2. Northbound lanes and ramps
3. Southbound lanes and ramps

Once the contractor starts asphalt operations on the Northbound section, they shall continue to work on that section until all paving work is completed before moving to another section. Once all paving is completed in a section, this shall be considered as the final paving operations for that section and rumble strips as well as final pavement marking shall be installed within the time specified for each item in Section 620 and 626 of the Missouri Standard Specifications for Highway Construction and shall be in accordance with JSP Optional Temporary Pavement Marking Paint NJSP-18-07E.

2.0 Basis of Payment. No direct payment will be made to the contractor for the cost to comply with this provision.

K. Coordination With Other Projects

1.0 Description. The contractor shall coordinate traffic management between the following projects within the same project limits:

MoDOT Job Number J9P3122 (Bridge rehabilitation, I-55 northbound over BNSF Railway and Route 74 and Route 61 over I-55. Add roundabout at Route 61 and Silver Springs Road.)

1.1 This list of projects is not all inclusive. The contractor shall be aware that there may be other projects including, but not limited to, utility, Cape Girardeau County, Scott County, City, private, MoDOT maintenance, permit, or other projects that may impact project construction or traffic control in the vicinity of this project. It shall be the responsibility of the contractor to determine what, if any projects other than the ones listed above may impact this project and work coordinate construction and traffic management efforts between this project and any other project involved.

2.0 Basis of Payment. No direct payment will be made to the contractor to recover the cost of equipment, labor, materials or time required to fulfill the above provisions, unless specified elsewhere in the contract document.

L. Bridge End Transitions

1.0 At all bridge exceptions, the engineer will determine in the field the ending point of the transition. This point will not necessarily be at the bridge end, but will be located at a point which provides the smoothest transition and approach to the bridge. Where bridges are to be resurfaced, the surfacing shall be from curb to curb.

M. Pavement Marking Log

1.0 Description. The contractor shall log the locations of existing pavement marking prior to any construction operations that may affect the existing pavement marking. The log shall contain all existing pavement marking and shall include center stripes, no passing stripes, lane lines, turn arrows, hash bars, cross walks, and stop bars. The contractor shall provide a copy of the existing pavement marking log to the engineer. The contractor shall place the new pavement marking at the same locations as the existing pavement marking, unless otherwise directed by the engineer or shown on the plans.

2.0 Basis of Payment. No direct payment will be made for logging of existing pavement marking.

N. Permanent Aggregate Edge Treatment NJSP-15-40B

1.0 Description. This work shall consist of furnishing and installing a permanent aggregate edge treatment along the edge of shoulder or pavement as shown on the plans or as directed by the engineer.

2.0 Construction Requirements. Aggregate shall be simultaneously deposited and spread on the sub-grade and shall not be deposited on the pavement or shoulder and bladed into place. Aggregate material shall be shaped according to the typical section and compacted until there is no visible evidence of further consolidation.

3.0 Material Requirements. Material used for the aggregate edge treatment shall be Type 1, 5, or 7 Aggregate in accordance with Sec 1007 or an allowable substitute approved by the engineer. Bituminous cold millings meeting the gradation for Type 1, 5 or 7 Aggregate may be used in lieu of aggregate. Limestone screenings or other material with excessive fines will not be allowed. Material will be accepted based on certification in lieu of testing contingent upon satisfactory results being obtained in the field.

4.0 Measurement by Weight. Measurement of the aggregate edge treatment material shall be per ton and in accordance with Sec 310.5.3.

5.0 Basis of Payment. The accepted quantities of aggregate edge treatment will be paid for at the contract unit price for 304-99.10, Permanent Aggregate Edge Treatment, per ton and will be full compensation for all labor, equipment and material to complete the described work. No fuel adjustment will be made for Permanent Aggregate Edge Treatment.

O. Optional Temporary Pavement Marking Paint NJSP-18-07G

1.0 Description. This provision provides the contractor with the option to either complete all Permanent Pavement Marking Paint (PPMP) prior to the time limits specified herein or to apply Temporary Pavement Marking Paint (TPMP) in accordance with Sec 620.10.2 (4 in. width) in all locations shown on the plans as PPMP and delay application of the PPMP until the spring of 2027, as allowed herein. PPMP is defined as Class 1 Pavement Marking Paint and Class 2 Pavement Marking Paint and does not include Sec 620.20.3 Durable Pavement Markings.

1.1 No application of PPMP shall occur between October 1, 2026 and March 1, 2027, both dates inclusive, except as stated herein. When the contractor has begun application of PPMP prior to October 1, 2026, and weather limitations stated in Sec 620.20.2.4 can be met, the contractor may complete the PPMP within the first seven (7) calendar days of October. If all (100%) of the PPMP is not completed on or before October 7, 2026, all previously applied PPMP, including any painted markings applied prior to October 1, shall be considered TPMP, and the contractor shall complete the remaining marking with TPMP, and then re-apply PPMP in all planned locations after March 1, 2027. All PPMP shall be completed prior to June 1, 2027. No additional payment will be made for PPMP that is later determined to be TPMP due to the contractor's failure to complete the PPMP within the time specified.

1.2 Use of TPMP Prior to October 1. The contractor has the option to apply TPMP in lieu of PPMP prior to October 1, 2026, even when there is sufficient time to complete the PPMP prior to October 1, 2026. For example, the contractor may choose to use TPMP as a base coat for the PPMP on open-graded surfaces in order to achieve higher retroreflectivity readings on the surface coat as compared to a single application.

1.2.1 The contractor has the option of using TPMP in lieu of Temporary Raised Pavement Markers if applied each day that existing markings are obliterated.

2.0 Construction Requirements. TPMP shall be accurately placed in the final planned location and shall be completely covered by the final application of PPMP. Any failure to comply with this requirement shall be corrected by removal of the misplaced pavement markings at the contractor's expense and without marring of the pavement surface.

2.1 Prior to application of the PPMP on TPMP, TPMP shall be fully cured in accordance with the manufacturer's recommendation, or for a period of 12 hours, whichever is greater.

3.0 Weather Limitations. All weather limitations specified in Sec 620 for PPMP and TPMP shall apply. Cold Weather Pavement Marking Paint, in accordance with Sec 620.10.6, shall be used for TPMP when specified weather limitations do not allow the use of waterborne paint. No additional payment will be made for the use of Cold Weather Pavement Marking Paint as TPMP. Cold Weather Pavement Marking Paint is not an allowable substitute for PPMP and shall subsequently be covered with PPMP.

4.0 Time Exception. If application of PPMP is to be delayed to the spring of 2027, the contractor shall submit a request to the engineer for a time exception and shall provide a revised work schedule that shows the planned completion of the PPMP.

4.1 Upon receipt of the time exception request in Section 4.0, the engineer will list "Application of Permanent Pavement Marking Paint" as an exception on the Semi-Final Inspection form, thus granting an exception to the count of contract time thru June 1, 2027, solely for the purpose of

Job No.: J913838
Route: I-55
County: Cape Girardeau/Scott

delaying application of PPMP. This time exception shall not apply to any time needed to complete any other work items. Liquidated Damages, as specified elsewhere in this contract, shall remain in effect for all other work items not completed by the contract time limits, as specified elsewhere in this contract, and for PPMP not completed by June 1, 2027.

5.0 Method of Measurement. No final measurement will be made for TPMP.

6.0 Basis of Payment. Full payment for TPMP will be made at the contract lump sum price even when PPMP is completed prior to the time limitation and TPMP is not used or only partially used.

6.2 If a \$0 bid is entered for TPMP, no payment will be made should TPMP become necessary.

| Item Number | Description | Unit |
|-------------|----------------------------------|------|
| 620-99.01 | Temporary Pavement Marking Paint | LS |

P. Guardrail Grading Requirements JSP-17-02B

1.0 Description. Guardrail installation and grading shall be in accordance with Missouri Standard Specifications for Highway Construction, Missouri Standard Plans for Highway Construction, and as described herein.

2.0 Construction Requirements. When guardrail and/or end treatment removal and replacement requires grading of the shoulder and/or slopes, Section 606.3.1(b), (c), and 606.3.1.1 of the Missouri Standard Specifications shall be waived and the following shall apply:

a) Along roadways and shoulders, remove no more guardrail than can be reconstructed within seven (7) calendar days, including weekends and holidays. The seven day counting period shall start when the first piece of safety hardware is removed.

b) The active work zone area that encompasses the guardrail and/or end treatment reconstruction, shall not exceed one (1) mile in length. The contractor shall be required to provide and maintain approved channelizing devices adjacent to the reconstruction area.

c) Only one-side of the roadway shall be worked on at the same time. Divided facilities shall be limited to work on one-side of each direction at the same time.

d) When the removal of any existing safety hardware device exposes non-breakaway obstacles, the reconstruction of the safety hardware device protecting the obstacle shall be replaced within 48 hours of removal or an approved temporary crashworthy device shall be provided, installed and maintained at the contractor's expense until the non-breakaway obstacle is permanently protected. The 48 hour counting period shall start when the first piece of safety hardware is removed.

e) Areas where guardrail and/or end treatments have been removed, but not yet replaced, shall be delineated in accordance with plans or as directed by the Engineer.

3.0 Non-Compliance. Non-compliance with this provision shall result in the immediate suspension of work in accordance with Sec 105.1.2. No work, including but not limited to

additional guardrail removal and grading, shall be allowed to proceed except for work necessary to restore guardrail installation.

4.0 Basis of Payment. No direct payment will be made for compliance with this provision. Guardrail items, grading, and temporary traffic control devices will be paid for as provided in the contract.

Q. Shaping Slopes Class III (Modified Material Requirements) NJSP-20-03B

Delete Sec 215.1.3 and 215.1.3.1 and substitute the following:

215.1.3 Shaping Slopes, Class III, shall consist of providing rock fill material and shaping slopes to construct additional shoulder width for the installation of guardrail and Type A crashworthy end terminals in accordance with Missouri Standard Plans for Highway Construction. The rock fill material used shall meet the requirements specified in Sec 215.1.3.1. The shoulder surface shall be finished smooth such that it is traversable and without significant voids or depressions.

215.1.3.1 Material Requirements. Rock fill material used for Shaping Slopes, Class III, shall consist of a durable crushed stone, shot rock or broken concrete, with a predominant size of 3 inches and a maximum size of 6 inches. Acceptance by the engineer will be made by visual inspection.

215.4 Basis of Payment. The accepted quantity will be paid at the contract unit bid price for 215-99.10 Misc. Shaping Slopes Class III – Modified Material Requirement, per 100F.

R. Vegetative Barrier Pavement JSP-24-04B

1.0 Description. This work shall consist of constructing an asphalt pavement strip at a compacted thickness of 3 inches and width (6 feet minimum) as specified in the contract plans. Placement shall be in accordance with section 400 of the standard specifications.

1.1 Material may need to be added in some locations to provide a stable and uniform subgrade prior to paving at the thickness specified. Prior to paving, the area shall be prepared and compacted with 3 passes of a 10-ton roller or by another method as approved by the engineer.

1.2 Soil sterilant shall be applied to the compacted surface as specified by the manufacturer's requirements and as approved by the engineer.

1.3 A commercial mix meeting the requirements of Sec 401.5.3 may be used in lieu of Plant Mix Bituminous Pavement.

1.4 Slopes shall be blended into the existing slope beyond the limits of the vegetative barrier.

2.0 Method of Measurement. Vegetative barrier pavement will be measured in square yards as constructed.

3.0 Basis of Payment. Vegetative barrier pavement, compaction, soil sterilant, and all other labor and materials will be paid for at the unit price for "Vegetative Barrier 3 in. Depth", item number 401-99.05, per square yard. Preparation of paving areas will be paid at the unit price for

"Linear Grading, Class I", item number 207-10.00, per station. Slope repairs after construction of pavement will be paid at the unit price for "Shaping Slopes, Class II", item number 215-20.00A, per 100 feet.

S. High-Tension Guard Cable Barrier JSP 24-03

1.0 Description. This work shall consist of all labor, equipment, and materials to remove, install, repair, and replace a guard cable barrier system including all hardware and appurtenances as shown on the plans or as directed by the engineer. The cable barrier system shall function in accordance with the requirements of MASH 2016 or NCHRP 350, Test Level 3, and be approved by the Federal Highway Administration. Test Level 3 acceptable products, for use as a cable barrier system, are included in the list of pre-qualified products displayed on MoDOT's website. Acceptable products shall include galvanized high-tension wire ropes and anchorages.

2.0 Construction Requirements. Line posts shall be provided and installed in accordance with the manufacturer's shop drawings and shall be placed plumb. All posts in final position shall be free from any distortion, burring, or other damage. Spacing of the posts shall not exceed 20 feet.

2.1 Anchor Assemblies. An anchor assembly, as specified in the manufacturer's shop drawings, shall be constructed at each end of a cable barrier run. The anchor assembly shall function in accordance with the requirements of MASH 2016 or NCHRP 350, Test Level 3, and be approved by the Federal Highway Administration. Anchors shall be constructed on firm, stable, undisturbed soil to the minimum dimension shown on the shop drawings. Anchor bolts and anchor post slip bases shall be firmly held in position at the top by templates during concrete replacement. Backfill shall be thoroughly compacted with mechanical tampers with care taken to prevent damage to the finished concrete. Backfill shall be brought up level with the finished grade line.

2.2 Cable. The galvanized wire rope shall be $\frac{3}{4}$ " pre-stretched 3 x 7 construction as approved by the Federal Highway Administration during the system's acceptance testing. Threaded terminals (wedge or swaged type) shall be furnished. Swaged terminals may be shop- or field-swaged. Threaded terminals shall be right hand (RH) or left hand (LH) threaded M 24 x 3 pitch to ANSI B 1.13 M. The body of the threaded terminal shall provide a minimum of 5.9" of wire rope penetration depth. Threaded terminals shall be galvanized after threading to ASTM A 151. Turnbuckle or rigging screws shall be of the size and shape shown in the manufacturer's shop drawings. Rigging screws shall be of a solid or closed body type with two inspection holes to determine threaded rope terminal penetration. Rigging screws shall be galvanized to ASTM A 153 after threading.

2.3 Cable Tensioning. The cable height above ground shall be in accordance with the manufacturer's shop drawings. The cable shall be tensioned immediately after initial installation. Tension shall be rechecked and adjusted, if necessary, three to five days after initial tensioning on cable system sections with lengths greater than 2500 feet. A tension log form shall be completed showing: the time, date, location, ambient temperature and final tension reading, signed by the person performing the tensioning, and furnished to the engineer upon completion of the work. This form shall also include the system manufacturer's recommended tension chart.

2.4 Delineators. Delineator spacing and reflector colors shall be in accordance with Sec 606.50.2.

3.0 Method of Measurement. Measurement of the cable barrier will be made from center of line posts, totaled to the nearest linear foot.

3.1 Anchor Assemblies. Measurement of anchor assemblies will be made per each.

4.0 Basis of Payment. The accepted quantities of cable barrier, anchor assemblies, cable barrier to guardrail interfaces will be paid for at the contract unit price with Item No. 606-99.03 High Tension Guard Cable (per linear foot), Item No. 606-99.02 HTGC Anchor Assembly (per each), and Item No. 606-99.02 Cable to Guardrail Transition (per each). Any anchor assembly required for cable to guardrail transition shall be considered included in the contract unit price for cable to guardrail transition. No direct payment will be made for delineators or setting post in rock.

T. Contractor Furnished Borrow

1.0 Description. This project will be constructed with slopes as shown in the contract plans with a significant amount of fill material being borrow provided by the Contractor. The Contractor will be responsible for providing borrow material from an offsite location for this project. All borrow sites must be approved for use by the Engineer prior to being incorporated into the project. In addition to the requirements of Sec 203.3, the Contractor shall test the material from the borrow site and provide the results to the Engineer a minimum of 30 days prior to the start of work. The borrow material must be sufficiently cohesive to prevent erosion of the slopes. The material from the contractor furnished borrow site shall have a Plasticity Index (PI) between 10 and 30. Borrow sites that contain material with over 25% sand content, high organic content, or fall outside the acceptable PI range will not be accepted.

2.0 Basis of Payment. The Contractor will receive no direct compensation for compliance with this provision. All costs associated with this provision shall be considered included in and completely covered by the grading pay item(s) in the contract.

U. Grading Requirements

1.0 Description. Follow grading requirements as specified for Linear Grading, Class 2 except for parts of section 207.1.2 that specify hauling distance of material. This project will require the contractor to supply material from off site to complete some grading requirements. Also, any excavated material from project may be required to be discarded off MoDOT Right of Way. The engineer shall have sole discretion in determining whether excess material may be incorporated with MoDOT Right of Way.

2.0 Basis of Payment. All cost incurred by the contractor to comply with this provision shall be considered completely covered by the contract unit price for Pay Item 207-20.00, Linear Grading Class 2. No direct payment will be made for the contractor furnished material or disposal of excess material.

V. Airport Requirements JSP-15-09

1.0 Description. The project is located near a public use airport or heliport or is more than 200 feet above existing ground level, which requires adherence to Federal Aviation Regulation Part 77 (FAA Reg Part 77). "Near" to a public use airport or heliport is defined as follows:

20,000 feet (4 miles) from an airport with a runway length of at least 3,200 feet
10,000 feet (2 miles) from an airport with runway length less than 3,200 feet
5,000 feet (1 mile) from a public use heliport

2.0 The maximum height of the improvement and the equipment operating while performing the improvements was assumed to be 18.0 feet above the current travelway during the process of evaluating the project for compliance with FAA Reg Part 77.

2.1 If the contractor's height of equipment or if the improvement itself is beyond the assumed height as indicated in Sec 2.0, the contractor will work with the resident engineer to fill out the Form 7460-1, or revise the original Form 7460-1 based upon the proposed height and resubmit, if necessary, for a determination by FAA on compliance with FAA Reg Part 77. Further information can be found in MoDOT's Engineering Policy Guide 235.8 Airports. If the Form 7460-1 must be filed, the associated work shall not be performed prior to the FAA determination, which could take up to 45 days.

2.2 If the contractor's height of equipment and the improvement itself is below the assumed height as indicated in Sec 2.0, no further action is necessary to fulfill the requirements set forth in FAA Reg Part 77.

3.0 Basis of Payment. There will be no direct payment for any work associated with this provision. Contract time extension will be given for the time necessary to obtain or revise the FAA permit. Any delays or costs incurred in obtaining the revised permit will be noncompensable.

W. Type B Concrete Traffic Barrier(Modified Moment Slab)

1.0 Description. A new moment slab will need to be poured at each Type B Concrete Traffic Barrier location.

2.0 Construction Requirements. The existing shoulder will need to be saw cut at each end of the existing Type B Concrete Traffic Barrier and along the edge of pavement for the removal of the shoulder section. The new Type B Concrete Traffic Barrier and the moment slab will need to be poured in conjunction with each other. See standard plans 617.10 for reinforcing steel and additional detail. Construct the new Type B Concrete Traffic Barrier and moment slab to line up with the existing Type B Concrete Traffic Barrier. The new Type B Concrete Traffic Barrier will need to be the same length as the old Type B Concrete Traffic Barrier for reinstallation of the existing guardrail. The moment slab will need to be constructed out of 8 inches of concrete pavement. The widths of the moment slabs will vary at each location due to the shoulder width and the distance between edge of shoulder and the back of the Type B Concrete Traffic Barrier. All work and materials should be in accordance with Missouri Standard Specifications for Highway Construction and Missouri Standard Plans for Highway Construction.

3.0 Basis of Payment. The moment slab will be paid for with pay item number 617-99.05, Concrete Traffic Barrier, Type B (Modified Moment Slab). The saw cuts will be at no direct pay.

X. Truck Mounted Attenuator (TMA) for Stationary Activities JSP-23-04

1.0 Description. Provide and maintain Truck Mounted Attenuators (TMA) in accordance with Sec 612 and as specified herein.

2.0 Construction Requirements. Truck Mounted Attenuators (TMA) shall be used for the work activities indicated in the plans or specified herein.

2.1 TMA's should be used during temporary lane and shoulder drop operations along the length of the project as identified in the Traffic Control plans.

3.0 Method of Measurement. No measurement will be made for Truck Mounted Attenuators (TMA).

4.0 Basis of Payment. Delete Sec 612.5.1 and substitute with the following:

612.5.1 No payment will be made for truck mounted attenuators (TMAs) used in mobile operations or for any TMAs designated as optional.

612.5.1.1 Payment for TMAs required for stationary work activities will be paid for at the contract unit bid price for Item 612-30.01, Truck Mounted Attenuator (TMA), per lump sum. The lump sum payment includes all work activities that require a TMA, regardless of the number of deployments, relocations, or length of time utilized. No payment will be made for repair or replacement of damaged TMAs.

Y. Utilities JSP-93-26F

1.1 The Contractor shall be aware there are numerous utilities present along the routes in this contract. Utility locates were not performed during the design phase of the project; therefore, the extent of conflicts with utilities are unknown. It is the inherent risk of the work under this contract that the contractor may encounter these utilities above and/or below the ground or in the vicinity of any given work item which may interfere with their operations. The contractor expressly acknowledges and assumes this risk even though the nature and extent are unknown to both the contractor and the Commission at the time of bidding and award of the contract.

2.0 Project Specific Provisions: There are several locations of guardrail and guard cable installations along the project. Utility locates shall be completed according to section 105.7 of the Missouri Standard Specifications for Highway Construction.

Z. Tubular Delineator

1.0 Description. Tubular Delineator with embedded anchor cup shall be mounted along center of median crossovers.

2.0 Requirements. Shall have a height of 36 inches, 2 reflective bands. Color of the tubular delineator shall be yellow. The Diameter of the Tubular Delineator shall be 3.25 inches. The anchor cup shall be cored a minimum of 4" into the asphalt pavement. The Delineator shall be installed such that when removed from the anchor cup it will be flush with the pavement once the manufacturer Plug/Cap is installed. The Plug/Cap for each delineator shall be provided. The

Plug/Cap is to prevent/keep the anchor cup free from dirt and debris in the case the Tubular Delineator would be removed.

3.0 Basis of Payment. Payment for all labor, equipment, and materials necessary to install these delineators shall be made and considered completely covered by the contract unit price item No. 616-99.02 Tubular Delineator (per each). The Delineators and embedded anchor cap shall be installed as per manufacturer's recommendations.

AA. Non-Tracking Tack JSP-24-02A

1.0 Description. This work requires application of tack in accordance with Sec 407 and prevention of tack loss from the surface as specified herein. Tack loss prevention shall be accomplished with successful usage of a MoDOT-approved non-tracking tack, or other acceptable non-tracking means, as approved by the engineer.

2.0 MoDOT-Approved Non-Tracking Tack. A list of MoDOT-approved non-tracking tack products is available at MoDOT.org under the Materials Qualified List. Upon request from the contractor, the MoDOT Division of Construction and Materials will consider allowance of other non-tracking products. To be approved, the contractor must successfully demonstrate that the proposed product meets the non-tracking requirements specified in section 3.0. The location of a contractor demonstration will only be allowed in areas approved by the engineer. The engineer will make final determination of product acceptance based on observation of the results of the contractor's demonstration.

2.1 Products on the Qualified List have demonstrated successful non-tracking performance on previous projects; however, the Commission does not endorse nor guarantee success of any of the listed products. Success is dependent on the contractor choosing a product that can achieve the desired results while also taking into consideration all factors, including, but not limited to, cure time, weather conditions, surface prep, surface type, material properties, and adherence to manufacturer's instructions. The contractor is responsible for monitoring adherence of the tack to the pavement surface and shall cease operations when tack first begins to show signs of not meeting the requirements of Section 3.0. Corrective action shall be made prior to resuming tacking operations.

3.0 Non-Tracking Requirements. Non-tracking tack shall remain adhered to the pavement surface when exposed to any wheeled or tracked vehicles. The tack shall not track off the surface within 30 minutes of being applied, and shall not stick to the tires, tracks or other parts of paving equipment or vehicles such that the underlying surface becomes visible or void of tack prior to the placement of the hot mix asphalt. The tack shall not track onto any adjacent lanes, pavement markings, driveways, sideroads, etc.

3.1 The contractor shall be responsible for cleaning all tracked tack from adjacent lanes, driveways, sideroads, etc., and shall replace all pavement markings that become coated with tracked tack. This cleaning and replacement requirement applies to both approved and proposed non-tracking products.

4.0 Basis of Payment. Measurement and payment shall be in accordance with Sec 407. The accepted quantity of non-tracking tack coat will be paid for per gallon at the contract unit price for 407-10.07 Tack Coat – Non-Tracking, per gallon. No additional payment will be made for the cost

to demonstrate proposed products, for cleaning surfaces due to tracking of tack, or for replacement of pavement marking damaged by tracked tack.

BB. Special Consideration of Change Orders and Value Engineering JSP-21-07

1.0 Description. Increased Federal Share has been approved by the FHWA for an innovative technology or practice. The Commission will receive an additional five percent Federal Share of the overall contract value due to innovations within the following pay item(s).

| Pay Item Number | Pay Item Description | Innovation |
|-----------------|----------------------|------------------|
| 401-03.01 | Asphalt Research | Asphalt Research |

Due to the increased Federal Share, the project components related to the innovation(s) described above must be constructed with the materials, quantities, methods and innovations as shown on the project plans and specifications. If the contractor requests materials, quantities, methods or innovations other than those included in the plans and specifications, the request must be reviewed and approved by the Commission and FHWA. Approved changes to the innovation items above shall be at no additional cost to the Commission and shall not increase the contract time.

2.0 Special Consideration of Change Orders and Value Engineering Change Proposals (VECP). Change ordering and/or value engineering the pay item(s) listed in section 1.0 jeopardize the ability for the Commission to receive an additional Federal Share for the overall contract value. Special consideration should be given to the change order value for removing or modifying such item(s) from the contract ensuring the benefit outweighs the cost.

3.0 Contacting Financial Services. If it is determined that the proposed change order and/or VECP outweighs the additional overall five percent Federal Share value, the Engineer shall notify the MoDOT project manager.

CC. Balanced Mix Design Requirements for Sec 403 Asphalt JSP-24-01C

1.0 Description. Balanced Mix Design (BMD) and Paver-Mounted Thermal Profiles (PMTP), as specified herein, are required on this project for all Sec 403 asphaltic concrete pavement surface and base course mixes. BMD shall be in accordance with section 2.0. PMTP shall be in accordance with section 3.0. No additional payment will be made for compliance with these provisions.

1.1 Rapid Penetrating Emulsion. Should use of Rapid Penetrating Emulsion (RPE) be necessary for corrective action of longitudinal joint density, as specified elsewhere in section 2.0, RPE shall be in accordance with MoDOT JSP2303 Rapid Penetrating Emulsion (available at: https://epg.modot.org/index.php/Job_Special_Provisions), except that no payment will be made for use of RPE.

2.0 Delete Sec 403 in its entirety and substitute the following:

403 ASPHALTIC CONCRETE PAVEMENT with Balanced Mix Design

403.1 Description. This work shall consist of providing a bituminous mixture to be placed in one or more courses on a prepared base or underlying course as shown on the plans or as directed by the engineer. The contractor shall be responsible for QC of the bituminous mixture, including the design, and control of the quality of the material incorporated into the project. The engineer will be responsible for QA, including testing, to assure the quality of the material incorporated into the project.

403.1.1 Naming Convention. The nomenclature of Superpave bituminous mixture names, such as SP125CLP, will be as follows. When only the aggregate size is shown, such as SP125, the specifications shall apply to all variations of that size, such as SP125B, SP125C, SP125CLP, etc. When "x" is indicated, such as SP125xLP, specifications shall apply to all variations of mixture designs. Stone Matrix Asphalt will be generally referred to as SMA and designated by SM or SMR.

| Superpave Nomenclature | |
|-------------------------------|--|
| SP | Superpave |
| 048 | 4.75mm (No. 4) nominal aggregate size |
| 095 | 9.5 mm (3/8 inch) nominal aggregate size |
| 125 | 12.5 mm (1/2 inch) nominal aggregate size |
| 190 | 19.0 mm (3/4 inch) nominal aggregate size |
| 250 | 25.0 mm (1 inch) nominal aggregate size |
| x | Mixture design: B, C, E or F (as described below) |
| LP | Limestone porphyry (when designated) |
| SM | Stone Matrix Asphalt (when designated) |
| SMR | Stone Matrix Asphalt limestone/non-carbonate (when designated) |

403.1.2 Design Levels. The following cumulative equivalent single axle loads (ESALs) shall be used for the specified mix design. The same size aggregate mix design at a higher design traffic may be substituted at the contractor's expense for the contract specified mixture design with the approval from the engineer. Substitutions shall be done uniformly and project mixing of various designs for the same work will not be permitted. For example, an SP125B mixture may be substituted for an SP125C mixture, or SP190C for SP190E, etc. Mixture design substitution will be limited to one design level higher than that specified in the contract.

| Design Traffic (ESALs) | Design |
|-------------------------------|---------------|
| < 300,000 | F |
| 300,000 to < 3,000,000 | E |
| 3,000,000 to < 30,000,000 | C |
| ≥ 30,000,000 | B |

403.2 Material. All material shall be in accordance with Division 1000, Material Details, and specifically as follows:

| Item | Section |
|--|----------------|
| Aggregate | 1002 |
| Asphalt Binder, Performance Graded (PG)* | 1015 |
| Fiber Additive | 1071 |
| Anti-Strip Additive | 1071 |

*The grade of asphalt binder will be specified in the contract.

403.2.1 Stone Matrix Asphalt. In addition to other requirements, material for SMA mixtures shall meet the following. Coarse aggregate shall consist of crushed limestone and either porphyry or steel slag in accordance with the quality requirements of Sec 1002, except as follows. The Los Angeles (LA) abrasion, when tested in accordance with AASHTO T 96, shall not exceed 40 percent based on initial ledge approval and source approval. The percent absorption, when tested in accordance with AASHTO T 85, shall not exceed 3.5 percent based on the individual fractions. The amount of flat and elongated particles, measured on material retained on a No. 4 sieve, of the blended aggregate shall not exceed 20 percent based on a 3:1 ratio or 5 percent based on a 5:1 ratio.

403.2.2 Filler Restriction. Rigden void content determined in accordance with MoDOT Test Method TM-73 shall be no greater than 50 percent.

403.2.3 Fibers. A fiber additive shall be used as a stabilizer in SMA Mixtures. Fibers shall be uniformly distributed by the end of the plant mixing process. The dosage rate for fibers shall be no less than 0.3 percent by weight of the total mixture for cellulose and no less than 0.4 percent by weight for mineral fibers.

403.2.4 Reclaimed Asphalt. A maximum of 30 percent virgin effective binder replacement may be used in mixtures without changing the grade of binder. The asphalt binder content of recycled asphalt materials shall be determined in accordance with AASHTO T 164, ASTM D 2172 or other approved method of solvent extraction. A correction factor for use during production may be determined for binder ignition by burning a sample in accordance with AASHTO T 308 and subtracting from the binder content determined by extraction. The aggregate specific gravity shall be determined by performing AASHTO T 209 in accordance with Sec 403.19.3.1.2 and calculating the G_{se} to which a 0.98 correction factor will be applied to obtain the G_{sb} as follows:

$$G_{se} = \frac{\frac{100 - P_b}{100}}{\frac{G_{mm}}{G_b}} - \frac{P_b}{G_b}$$

RAP G_{sb} = RAP G_{se} X 0.98

403.2.5 Reclaimed Asphalt Pavement. Reclaimed Asphalt Pavement (RAP) may be used in any mixture, except SMA mixtures. Mixtures may be used with more than 30 percent virgin effective binder replacement provided testing according to AASHTO M 323 is included with the job mix formula that ensures the combined binder meets the grade specified in the contract. All RAP material, except as noted below, shall be tested in accordance with AASHTO T 327, *Method of Resistance of Coarse Aggregate Degradation by Abrasion in the Micro-Deval Apparatus*. Aggregate shall have the asphalt coating removed either by extraction or binder ignition during production. The material shall be tested in the Micro-Deval apparatus at a frequency of once per 1500 tons. The percent loss shall not exceed the Micro-Deval loss of the combined virgin material by more than five percent. Micro-Deval testing will be waived for RAP material obtained from MoDOT roadways. All RAP material shall be in accordance with Sec 1002 for deleterious and other foreign material.

403.2.6 Reclaimed Asphalt Shingles. Reclaimed Asphalt Shingles (RAS) may be used in any mixture specified to use PG 64-22 in accordance with AASHTO PP 53 except as follows: When the ratio of virgin effective binder to total binder in the mixture is between 60 and 70 percent, the grade of the virgin binder shall be PG 52-28 or PG 58-28. Shingles shall be ground to 3/8-inch minus. Waste, manufacturer or new, shingles shall be essential free of deleterious materials. Post-consumer RAS shall not contain more than 1.5 percent wood by weight or more than 3.0

percent total deleterious by weight. Post-consumer RAS shall be certified to contain less than the maximum allowable amount of asbestos as defined by national or local standards. The gradation of the aggregate may be determined by solvent extraction of the binder or using the following as a standard gradation:

| Shingle Aggregate Gradation | |
|-----------------------------|---------------------------|
| Sieve Size | Percent Passing by Weight |
| 3/8 in. | 100 |
| No. 4 | 95 |
| No. 8 | 85 |
| No. 16 | 70 |
| No. 30 | 50 |
| No. 50 | 45 |
| No. 100 | 35 |
| No. 200 | 25 |

403.3 Composition of Mixtures.

403.3.1 Gradation. Prior to mixing with asphalt binder, the combined aggregate gradation, including filler if needed, shall meet the following gradation for the type of mixture specified in the contract. A job mix formula may be approved which permits the combined aggregate gradation during mixture production to be outside the limits of the master range when the full tolerances specified in Sec 403.5 are applied.

| Percent Passing by Weight | | | | | | | |
|---------------------------|----------|----------|----------|---------|--------|-------------|-------------|
| Sieve Size | SP250 | SP190 | SP125 | SP095 | SP048 | SP125xSM(R) | SP095xSM(R) |
| 1 1/2 in. | 100 | --- | --- | --- | --- | --- | --- |
| 1 in. | 90 - 100 | 100 | --- | --- | --- | --- | --- |
| 3/4 in. | 90 max. | 90 - 100 | 100 | --- | --- | 100 | --- |
| 1/2 in. | --- | 90 max. | 90 - 100 | 100 | --- | 90-100 | 100 |
| 3/8 in. | --- | --- | 90 max. | 90-100 | 100 | 50-80 | 70-95 |
| No. 4 | --- | --- | --- | 90 max. | 90-100 | 20 - 35 | 30-50 |
| No. 8 | 19 - 45 | 23 - 49 | 28 - 58 | 32-67 | --- | 16 - 24 | 20-30 |
| No. 16 | --- | --- | --- | --- | 30-60 | --- | 21 max. |
| No. 30 | --- | --- | --- | --- | --- | --- | 18 max. |
| No. 50 | --- | --- | --- | --- | --- | --- | 15 max. |
| No. 100 | --- | --- | --- | --- | --- | --- | --- |
| No. 200 | 1 - 7 | 2 - 8 | 2 - 10 | 2-10 | 7-12 | 8.0-11.0 | 8.0-12.0 |

403.3.2 Anti-Strip Agent. An anti-strip will be allowed by the engineer to improve resistance to stripping. Anti-strip agents and application rates shall be from a list approved in accordance with Sec 1071.

403.3.3 Porphyry Mixtures. For LP and SMA mixtures, at least 50 percent by volume of the aggregate shall be crushed porphyry retained on the following sieves: No. 30 for SP048, No. 16 for SP095 and No. 8 for SP125. Depending on the actual gradation of porphyry aggregate furnished, the amount of crushed porphyry required may vary, however at least 40 percent by weight of crushed porphyry will be required. Steel slag may be substituted for porphyry in LP and SM mixtures, except at least 45 percent by weight of crushed porphyry and/or slag will be

required. The engineer may approve the use of other hard, durable aggregate in addition to porphyry and steel slag. When an SMR mixture is designated, the mixture shall contain aggregate blends with at least 30 percent non-carbonate material in accordance with Sec 403.3.5.

403.3.4 Minimum Stone Matrix Asphalt Binder. The percent asphalt binder for SMA mixtures shall not be less than 6.0 percent unless otherwise allowed by the engineer.

403.3.5 Surface Mixtures. Design level B surface mixtures and SP048NC, except as described in Sec 403.15.3, containing limestone coarse aggregate shall contain a minimum amount of non-carbonate aggregate. The LA abrasion values, AASHTO T 96, of the limestone will determine the type and amount of non-carbonate aggregate required as shown in the table below. The LA abrasion value will be determined from the most recent source approval sample. In lieu of the above requirements, the aggregate blend shall have an acid insoluble residue (AIR), MoDOT Test Method TM 76, meeting the plus No. 4 criteria of crushed non-carbonate material. Non-carbonate aggregate shall have an AIR of at least 85 percent insoluble residue.

| Coarse Aggregate (+ No. 4) | Minimum Non-Carbonate by Volume |
|----------------------------|---------------------------------|
| Limestone, LA \leq 30 | 30% Plus No. 4 |
| Limestone, LA $>$ 30 | 20% Minus No. 4* |
| Dolomite | No Requirement |

*Use for all SP095 and SP048NC containing limestone.

403.4 Job Mix Formula. At least 30 days prior to placing any mixture on the project, the contractor shall submit a mix design for approval to Construction and Materials. The mixture shall be designed in accordance with AASHTO R 35 or R 46 and shall be tested in accordance with AASHTO T 312 except as noted herein. A detailed description of the mix design process shall be included with the job mix formula (JMF). Representative samples of each ingredient for the mixture shall be submitted with the mix design.

403.4.1 Proficiency Sample Program. Laboratories that participate in and achieve a score of three or greater in the AASHTO proficiency sample program for T 11, T 27, T 84, T 85, T 166, T 176, T 209, T 304 (ASTM C 1252), T 308 and T 312 will have the mixture verification process waived. The mix design shall be submitted to Construction and Materials for approval at least seven days prior to mixture production.

403.4.2 Required Information. The mix design shall include raw data from the design process and contain the following information:

- (a) All possible sources intended for use, and grade and specific gravity of asphalt binder.
- (b) Source, type (formation, etc.), ledge number if applicable, gradation, and deleterious content of each aggregate fraction.
- (c) Bulk and apparent specific gravities and absorption of each aggregate fraction in accordance with AASHTO T 85 for coarse aggregate and AASHTO T 84 for fine aggregate including all raw data.
- (d) Specific gravity of hydrated lime, mineral filler or baghouse fines, if used, in accordance with AASHTO T 100.
- (e) Percentage of each aggregate component.

- (f) Combined gradation of the job mix.
- (g) Percent asphalt binder, by weight, based on the total mixture and percent asphalt binder contributed by reclaimed asphalt materials.
- (h) Bulk specific gravity (G_{mb}) by AASHTO T 166 Method A of a laboratory compacted mixture compacted at N_{design} gyrations.
- (i) Percent air voids (V_a) of the laboratory compacted specimen compacted to N_{design} gyrations.
- (j) Voids in the mineral aggregate (VMA) and volume of Effective Asphalt (V_{be}) at N_{design} gyrations.
- (k) Theoretical maximum specific gravity (G_{mm}) as determined by AASHTO T 209, in accordance with Sec 403.19.3, after the sample has been short term aged in accordance with AASHTO R 30.
- (l) The tensile strength ratio as determined by AASHTO T 283 including all raw data.
- (m) The gyratory sample weight to produce a 115 mm minimum height specimen.
- (n) Mixing temperature and gyratory molding temperature.
- (o) Number of gyrations at N_{design} .
- (p) Dust proportion ratio ($-200/P_{be}$).
- (q) Bulk specific gravity (G_{sb}) of the combined aggregate.
- (r) Percent chert contained in each aggregate fraction.
- (s) Percent of G_{mm} at $N_{initial}$ and $N_{maximum}$.
- (t) Voids in coarse aggregate (VCA) for both the mixture and dry-rod condition for SMA mixtures.
- (u) Drainage for SMA mixtures.
- (v) Performance testing results for Cracking Tolerance Index (CT_{Index}), Long-Term aged Cracking Tolerance Index ($CT_{Index, Long-Term Aged}$), Hamburg Wheel Tracking Test (HWTT), and Rutting Tolerance Index (RT_{Index}).
- (w) Baghouse fines added for design.
 - (i) Batch and continuous mix plants – Indicate which aggregate fraction to add baghouse percentage during production.
 - (ii) Drum mix plants – Provide cold feed settings with and without baghouse percentage.

403.4.3 Approval. No mixture will be accepted for use until the JMF for the project is approved by Construction and Materials.

403.4.4 Mix Formula Modification. The JMF approved for each mixture shall be in effect until modified in writing by the engineer. When unsatisfactory results occur or should a source of material be changed, a new JMF may be required.

403.4.4.1 Asphalt Binder Source Change. When an asphalt binder source change includes a binder grading that differs from the original grade on the JMF, new performance testing values (CT_{Index} and RT_{Index}) shall be provided prior to use.

403.4.4.2 Additive Source Change. When rejuvenators, warm mix additives, anti-strip additive, or other additives sources change; new performance testing values (CT_{Index} and RT_{Index}) shall be provided.

403.4.5 Design Gyrations. The minimum number (N) of gyrations required for gyratory compaction shall be as follows:

| Design | N_{design}^a |
|--------|----------------|
| F | 35 |
| E | 50 |
| C | 60 |
| B | 65 |

^a SMA mixtures shall have N_{design} equal to 100.

403.4.6 Mixture Characteristics. When compacted in accordance with AASHTO T 312, the mixture shall meet the following criteria.

403.4.6.1 Air Voids (V_a). Design air voids for SuperPave mixtures at all traffic levels shall be between 3.0 and 5.0 percent. SMA mixtures shall have a design air void of 4.0 percent.

403.4.6.2 Voids in the Mineral Aggregate (VMA). SuperPave mixtures shall have a minimum volume of effective asphalt, equal to the VMA minus the air voids, as shown in the chart below, with design air voids between 3.0 to 5.0 percent for SuperPave and shall be 4.0 percent for SMA. The minimum VMA shall be equal to the minimum volume of effective binder (V_{be}) plus design air voids.

| Mixture | V_{be} Minimum (percent) |
|------------------------|----------------------------|
| SP250 | 9.0 |
| SP190 | 10.0 |
| SP125 (except for SMA) | 11.0 |
| SP095 (except for SMA) | 12.0 |
| SP048 | 13.0 |
| SMA | 13.0 |

403.4.7 Dust to Binder Ratio. For all mixtures except SMA and SP048, the ratio of minus No. 200 material to effective asphalt binder (P_{be}) shall be between 0.8 and 1.6. For SP048, the ratio of minus No. 200 material to effective asphalt binder (P_{be}) shall be between 0.9 and 2.0.

403.4.8 Moisture Susceptibility. For all mixtures except SMA, the mixture shall have a tensile strength ratio (TSR) greater than 85 percent (80 percent if an approved anti-strip agent is used) when compacted to 3.7 inches with 7 ± 0.5 percent air voids and tested in accordance with AASHTO T 283. SMA mixtures shall have a TSR greater than 85 (80 percent if an approved anti-

strip agent is used) percent when compacted to 3.7 inches with 6 ± 0.5 percent air voids and tested in accordance with AASHTO T 283.

403.4.8.1 Minimum Tensile Strength. All mixtures shall have a minimum allowable conditioned tensile strength of 60 psi.

403.4.8.2 Liquid Anti-Strip Dosage. The liquid anti-strip dosage shall be in the range recommended by the manufacturer and provided on the JMF.

403.4.9 Draindown. AASHTO T 305, Draindown Test, shall be performed on all SMA mixtures prior to job mix approval. The mixture shall be stabilized in such a way that the draindown of the asphalt binder shall not exceed 0.3 percent by weight of mixture.

403.4.10 Voids in Coarse Aggregate. The percent VCA_{MIX} of SMA mixtures shall be less than or equal to the VCA_{DRC} as determined using AASHTO T 19. This may be calculated using the following equations:

$$VCA_{DRC} = 100 \times (G_{CA}\gamma_w - \gamma_s) / G_{CA}\gamma_w$$

$$VCA_{MIX} = 100 - (P_{bp} \times G_{mb} / G_{CA})$$

$$P_{bp} = P_s \times PA_{bp}$$

Where: G_{CA} = bulk specific gravity of the combined coarse aggregate (AASHTO T 85),

γ_s = unit weight of coarse aggregate in the dry-rod condition (DRC) (lb/ft^3) (AASHTO T 19),

γ_w = unit weight of water ($62.34 \text{ lb}/\text{ft}^3$),

P_{bp} = percent aggregate by total mixture weight retained on No. 4 sieve and

PA_{bp} = percent aggregate by total aggregate weight retained on No. 4 sieve*.

*Use No. 8 sieve for SP095xSM

403.4.11 Mix Design Performance Testing. Acceptable test results meeting the criteria for the following performance tests shall be submitted with the mix design for approval. Test specimens shall be compacted to an air void content of 7.0 ± 0.5 percent or 6.0 ± 0.5 percent for SMA mixtures.

403.4.11.1 Cracking Tolerance Index (CT_{Index}) Testing. The CT_{Index} testing shall be completed in accordance with ASTM D8225 and at a test temperature of $25 \pm 0.5 \text{ C}$.

| Mix Type | Minimum CT_{Index} | $CT_{Index, (Long-Term Aged)*}$ |
|----------|----------------------|---------------------------------|
| Non-SMA | 50 | Informational Only |
| SMA | 135 | Informational Only |

*Long-Term Aged defined as loose mix aging for 20 hours at 115 C .

403.4.11.2 Rutting Tolerance Index (RT_{Index}) Testing. The RT_{Index} testing shall be completed in accordance with ASTM D8360 and at a test temperature of $50 \pm 1 \text{ C}$.

| PG Grade High Temperature* | Minimum RT _{Index} |
|----------------------------|-----------------------------|
| 58-28H / 64-22 | 50 |
| 64-22H / 70-22 | 65 |
| 64-22V / 76-22 | 80 |

*Determined by the binder grade specified in the contract.

403.4.11.3 Hamburg Wheel Track (HWT). HWT testing will be completed in accordance with AASHTO T324 at test temperature of 50 ± 1 C and 2.44 inch specimen height.

| PG Grade High Temperature * | Minimum Wheel Passes | Maximum Rut Depth (in.) |
|-----------------------------|----------------------|-------------------------|
| 58-28H / 64-22 | 7,500 | 0.38 |
| 64-22H / 70-22 | 15,000 | 0.38 |
| 64-22V / 76-22 | 20,000 | 0.38 |

*Determined by the binder grade specified in the contract.

403.5 Mixture Production Specification Limits.

403.5.1 Gradation and Deleterious Content Control. The gradation of the aggregate shall be determined from samples taken from the hot bins on batch-type or continuous mixing plants or from the composite cold feed belt on drum mix plants. The gradation may also be obtained by sampling the mixture and testing the residual aggregate. The deleterious content of the aggregate shall be determined from samples taken from the composite cold feed belt. Aggregate samples shall be taken in accordance with AASHTO R 90. The RAP shall be sampled from the RAP feeding system on the asphalt plant. Gradation and deleterious shall be taken when directed by the engineer.

403.5.1.1 Stone Matrix Asphalt Tolerances. In producing mixtures for the project, the plant shall be operated such that no intentional deviations from the job mix formula are made. The maximum deviation from the approved job mix formula shall be as follows for SMA mixtures:

| Sieve | Max. Tolerance | |
|---------|----------------|---------|
| | SP095 | SP125 |
| 3/4 in. | --- | --- |
| 1/2 in. | --- | ± 4 |
| 3/8 in. | ± 4 | ± 4 |
| No. 4 | ± 3 | ± 3 |
| No. 8 | ± 3 | ± 3 |
| No. 200 | ± 2 | ± 2 |

403.5.1.2 Mixture Tolerance. For all other SP mixtures, the percent passing the first sieve size smaller than the nominal maximum size shall not exceed 92.0 percent, a tolerance not to exceed 2.0 percent on the No. 8 sieve from the table in Sec 403.3.1, and within the range listed in Sec 403.3.1 for the No. 200 sieve. The deleterious content of the material retained on the No. 4 sieve shall not exceed the limits specified in Sec 1002.2.

403.5.2 Density. The final, in-place density of the mixture shall be 92.5 to 98.0 percent of the theoretical maximum specific gravity for all mixtures except SMA. SMA mixtures shall have a minimum density of 94.0 percent of the theoretical maximum specific gravity. The theoretical

maximum specific gravity shall be determined from a sample representing the material being tested. Tests shall be taken not later than the day following placement of the mixture. The engineer will randomly determine test locations.

403.5.2.1 Shoulder Density. Density on non-integral shoulders shall be in accordance with Sec 403.15.3.

403.5.2.2 Integral Shoulder. When shoulders are placed integrally with the traveled way, tests shall be taken on the traveled way.

403.5.2.3 Longitudinal Joint Density. Density along longitudinal joints shall be in accordance with Sec 403.16.1. Pay shall be in accordance with Sec 403.23.4.1.

403.5.3 Asphalt Content. The asphalt content (AC) shall be within ± 0.3 percent of the approved mix design.

403.5.4 Air Voids. Air voids shall be within ± 1.0 percent of the approved mix design at N_{des} gyrations.

403.5.5 Cracking Tolerance Index. Minimum CT_{Index} shall be 50 for all mixtures except SMA. SMA mixtures shall have a minimum CT_{Index} of 135.

403.5.6 Rutting Tolerance Index. Minimum RT_{Index} shall be based upon the high temperature asphalt binder grade in the contract in accordance with the following:

| PG Grade | High Temperature* | Minimum $RT_{Index}^{(a)}$ |
|----------------|-------------------|----------------------------|
| 58-28H / 64-22 | 50 | |
| 64-22H / 70-22 | 65 | |
| 64-22V / 76-22 | 80 | |

*Determined by the binder grade specified in the contract.

^(a)Mixtures not meeting the minimum RT_{Index} shall be tested by the Hamburg Wheel Track Test and meet a minimum of $\frac{1}{2}$ " rutting at the number of wheel passes required by the contract grade of the mixture.

403.5.7 Tensile Strength Ratio (TSR). The TSR shall be greater than or equal to 75 percent as determined from loose mixture taken from the plant and tested in accordance with AASHTO T 283. The minimum allowable conditioned tensile strength of the mixture shall be 60 psi. The liquid anti-strip dosage during production shall match the dosage listed on the JMF.

403.5.8 Fibers. The fiber proportioning and delivery system for SMA mixtures shall have an accuracy of 10 percent by weight of the material actually being measured in any given period of time.

403.5.9 Moisture Content. The asphaltic concrete mixture, when sampled and tested in accordance with AASHTO T 329, shall not contain more than 0.5 percent moisture by weight of the mixture.

403.5.10 Contamination. The asphaltic concrete mixture shall not be contaminated with deleterious agents such as unburned fuel, objectionable fuel residue or any other material not inherent to the job mix formula.

403.6 Field Laboratory. The contractor shall provide a Type 3 field laboratory in accordance with Sec 601. The contractor shall furnish the bituminous mixture equipment to perform all required test methods for QC and QA work. The gyratory compactor shall be evaluated in accordance with AASHTO PP 35. An approved list will be maintained by Construction and Materials. All other equipment shall be capable of performing tests in accordance with the approved test methods.

403.7 Bituminous Mixing Plants. Bituminous mixing plants and preparation of material and mixtures shall be in accordance with Sec 404.

403.8 Hauling Equipment. Trucks used for hauling bituminous mixtures shall be in accordance with Sec 404.

403.9 Pavers. Bituminous pavers shall be self-contained units, provided with an activated screed or strike-off assembly, heated if necessary, and capable of spreading and finishing asphaltic concrete in lane widths applicable to the specified typical sections and thicknesses shown on the plans.

403.10 Construction Requirements.

403.10.1 Weather Limitations. No mixture shall be placed on any wet or frozen surface. No mixture shall be placed when either the air temperature or the temperature of the surface on which the mixture is to be placed is below 40 F. Temperatures shall be obtained in accordance with MoDOT Test Method TM 20.

403.10.2 Substitutions. With approval from the engineer, the contractor may substitute a smaller nominal maximum size mixture for a larger sized mixture. Specifications governing the substitute mixture shall apply. Except for a single surface layer, the total pavement thickness shall be maintained when the substitute mixture layer is reduced as allowed in Sec 403.13 by increasing the thickness of other layers or courses. The contract unit price for the original mixture shall be used.

403.11 Field Adjustments of Job Mix Formulas. When test results indicate the mixture produced does not meet the specification requirements, the contractor may field adjust the job mix formula as noted herein. Field adjustments may consist of changing the percent binder as listed on the original approved job mix by no more than 0.3 percent. Additional fractions of material or new material will not be permitted as field adjustments. The engineer shall be notified immediately when any change is made in the cold feed settings, the hot bin settings or the binder content. A new G_{sb} shall be calculated using the new aggregate percentages. The gradation of the adjusted mixture shall meet the requirements of the mixture type specified in the contract. When the binder content is adjusted more than 0.3 percent, the mixture will be considered out of specification, and a new mix design shall be established.

403.11.1 Field Mix Redesign. When a new mix design will be required, the contractor will be permitted to establish the new mix design in the field. The mixture shall be designed in accordance with AASHTO R 35 or AASHTO R 46 and shall meet the mix design requirements, including performance testing and TSR requirements. A representative sample of the mixture shall be submitted with the new mix design to the Central Laboratory for mixture verification. The amount of mixture submitted for verification shall weigh at least 50 pounds.

403.11.1.1 Approval. New mix designs established in the field shall be submitted for approval to Construction and Materials. Upon approval, Construction and Materials will assign a new mix number to the mixture.

403.11.1.2 Resume Production. No mixture shall be placed on the project until the new field mix design is approved.

403.12 Application of Prime or Tack. The prime coat, if specified, shall be applied in accordance with Sec 408. A tack coat is required on all existing pavement and shoulder surfaces that will be overlaid with a bituminous mixture. A tack coat is also required between all lifts of bituminous pavements placed within the driving and turn lanes, unless otherwise specified in the contract. All construction requirements of a tacked surface shall be in accordance with Sec 407, and specified herein. The tack coat shall be applied uniformly and shall completely cover the surface upon which the bituminous mixture is to be placed. Placement of a bituminous mixture shall not be placed upon a tacked surface that is not uniformly covered or surfaces that have experienced excessive loss of tack due to tracking. Re-application of tack due to excess tracking or non-uniform coverage shall be at the contractor's expense.

403.13 Spreading and Finishing. The base course, primed or tacked surface, or preceding course or layer shall be cleaned of all dirt, packed soil or any other foreign material prior to spreading the asphaltic mixture. If lumps are present or a crust of mixture has formed, the entire load will be rejected. The thickness and width of each course shall conform to the typical section in the contract. The contractor may elect to construct each course in multiple layers. The minimum compacted thickness shall be 0.75 inches for SP048, 1.25 inches for SP095, 1.75 inches for SP125, 2 inches for SP190, and 3 inches for SP250.

403.13.1 Paving Widths. The following shall apply for roadways constructed under traffic. For pavements having a width of 16 to 24 feet, inclusive, the asphaltic concrete pavement shall be laid in lanes approximately one half the full width of the completed pavement, and the full width shall be completed as soon as practical. Unless otherwise permitted, a single lane of any course shall not be constructed to a length that cannot be completed to full width of the pavement the succeeding operating day. For pavements greater than 24 feet wide, single lane width construction shall be limited to one day's production and completion to full width shall be accomplished as soon as practical. Uneven pavement shall be left in place for no more than seven days, unless approved by the engineer. Removal of pavement to be in accordance with this specification shall be at the contractor's expense.

403.13.2 Segregation. No thermal or physical mix segregation will be permitted in handling the mixture at the plant, from the truck or during spreading operations on the roadbed.

Paver Mounted Thermal Profiling (PMTP) shall be conducted in accordance with Sec 406.

All layers shall be feathered out, by hand raking, if necessary, in transitioning the depth of the surface to meet present grades at bridges or ends of projects, to provide a uniform, smooth riding surface free of irregularities. Where only the top layer of the surfacing continues across a bridge, the bottom layers shall be feathered out.

Any visual/physical segregation shall be tested in accordance with MoDOT Test Method TM 75. Mixture production shall immediately cease if either criteria of MoDOT Test Method TM 75 fail. Segregated mixture shall be removed and replaced to the limits determined by the engineer.

403.13.3 Release to Traffic. If the asphaltic concrete construction consists of more than a single layer, each layer shall be compacted as specified and allowed to cool to the ambient temperature before the next layer is placed. The contractor shall keep traffic off the asphaltic concrete until the surface of the asphaltic concrete is 140 F or below and the asphaltic concrete has cooled sufficiently to prevent flushing of the asphalt binder to the surface, marking or distorting the surface or breaking down the edges.

403.13.4 Drainage. Evidence of asphalt binder separation or drainage at delivery will be cause for rejection.

403.13.5 Shoulder Substitution. When a Sec 403 mixture is specified for traffic lanes, the same mixture may be used for the adjacent shoulder, subject to the density requirements in Sec 403.5.2.

403.14 Spot Wedging and Leveling Course. The engineer will specify the locations and thickness of spot wedging and the thickness of leveling course to obtain the smoothest possible riding surface. This procedure may result in spot wedging operations over small areas with feather-edging at high points and ends of wedge areas. Rigid control of the placement thickness of the leveling course shall be required. Leveling course, consisting of a layer of asphaltic concrete of variable thickness used to superelevate curves and eliminate irregularities in the existing base, shall be spread uniformly to the specified profile grade and cross section. The mixture shall be uniformly spread and compacted, with only minor segregation as accepted by the engineer. Type SP125 or finer mixtures, as applicable, shall be used for the spot wedging and for the leveling course. Mixtures used as spot wedging and leveling courses shall be accepted in accordance with Sec 403.23.8.3.

403.15 Compaction. After the asphaltic mixture has been spread, struck off and surface irregularities adjusted, the asphaltic mixture shall be compacted thoroughly and uniformly by rolling to obtain the required compaction while the mixture is in a workable condition. Excessive rolling, to the extent of aggregate degradation, will not be permitted. Rollers shall not be used in the vibratory mode when the mixture temperature is below 225 F. When warm mix technology is used, as approved by the engineer, rollers shall not be used in the vibratory mode when the mixture temperature is below 200 F.

403.15.1 Rolling. Any displacement occurring as a result of starting, stopping or changing direction of a roller, or from other causes, shall be avoided. Excess liquid, to prevent adhesion of the mixture to the rollers, will not be permitted. Diesel fuel, fuel oil or other detrimental products shall not be used as wetting agents. Along forms, curbs, headers, walls, and other places not accessible to the roller, the mixture shall be thoroughly compacted with hot hand tampers, smoothing irons or with mechanical tampers.

403.15.2 Defective Mixture. Any mixture that becomes loose and broken, mixed with dirt or is in any way defective shall be removed and replaced with fresh, hot mixture, which shall be compacted to conform with the surrounding area. Any area showing an excess or deficiency of asphalt binder shall be removed and replaced.

403.15.3 Non-Traffic Areas. Sec 403 mixtures used for surfacing medians and similar areas, shoulders adjacent to rigid or flexible pavement and shoulders adjacent to resurfaced pavement shall be compacted to the specified densities for the mixture. Once an established rolling pattern has been demonstrated to provide the required density for shoulders, at the engineer's discretion, the pattern may be used in lieu of density tests provided no changes in the material, typical location or temperatures are made. Regardless of the method, density will still be required and

subject to testing as deemed necessary by the engineer. In lieu of roller and density requirements, temporary bypasses to be maintained at the expense of the contractor shall be thoroughly compacted. The rolling shall be performed at proper time intervals and shall be continued until there is no visible evidence of further consolidation.

403.15.4 Density Measurement. Measurements for determining the in-place density of the mixture shall be taken no later than the day following placement. Measurements not obtained within the prescribed time limits shall be subject to the requirements of Sec 403.22.

403.15.4.1 Density Cores. If a core is taken, material from underlying layers that remain adhered to the core shall be removed in a manner that does not harm the integrity of the specimen. If the contractor elects to place a lift of mixture greater than six times the nominal maximum aggregate size, cores shall be cut in half and the density of each half determined separately.

403.15.4.2 Nuclear/Alternative Methods. In-place asphalt density may be obtained by nuclear or alternative methods in accordance with MoDOT TM-41. The nuclear/alternative calibration locations shall be conducted within a trial section in accordance with Sec 405.4.8.

403.15.5 Intelligent Compaction. Intelligent Compaction requirements in accordance with Section 405 shall not apply unless required by job special provision. Intelligent compaction shall be conducted on the traveled way to monitor the optimum roller passes at a mean temperature above 180 F in accordance with Sec 405. Passing Segments shall have a minimum of 85 percent coverage at or above the optimum number of passes. Segments with between 85 percent and 70 percent coverage will be called moderate segments. Any segment with less than 70 percent coverage at the optimum number of passes shall be a Deficient Segment. If 70 percent of the target IC-MV is not obtained, the segment shall be flagged accordingly in the Veta project file. All segments with a mean temperature of less than 180 F at the optimum pass shall be considered deficient.

403.15.6 Surface Smoothness. The finish of the pavement surface shall be substantially free from waves or irregularities and shall be true to the established crown and grade. The pavement surface shall be thoroughly tested for smoothness by profiling or straight edging in accordance with Sec 610.

403.16 Joints. Transverse joints shall be formed by any method that will produce a dense, vertical section for use when laying is resumed. When a transverse vertical edge is to be left and opened to traffic, a temporary depth transition shall be built as approved by the engineer. The joint formed when the fresh mixture is placed shall be dense, well sealed, and the grade, line and surface texture of the succeeding surface shall conform to that of the joined surface. If directed by the engineer, the transverse joint shall be painted with a light coating of liquid asphalt. Hand manipulation of the mixture shall be minimized to avoid unsightly surface texture.

403.16.1 Joint Composition. Longitudinal joints shall be formed by the use of an edging plate fixed on both sides of the finishing machine. Care shall be taken to obtain a well bonded and sealed longitudinal joint by placing the hot mixture in a manner ensuring maximum compaction at this point. If directed by the engineer for properly sealing the longitudinal joint, a light coating of bituminous material shall be applied to the exposed edge before the joint is made. Each side of the joint shall be flush and along true lines.

403.16.2 Joint Offset. The longitudinal joint in any layer shall offset that in the layer immediately below by a minimum of 6 inches; except, the joints in the completed surfacing shall be at the lane

lines of the traveled way or other required placement width outside the travel lane. The placement width shall be adjusted such that pavement marking shall not fall on a longitudinal joint.

403.17 Quality Control.

403.17.1 Quality Control Operations. The contractor shall maintain equipment and qualified personnel to perform all QC field inspection, sampling and testing as required by this specification. All contractor personnel included in the QC operation shall be qualified by the MoDOT Technician Certification Program. Under no circumstances will unqualified personnel be allowed to perform QC sampling or testing. Personnel will be disqualified if acceptable methods and procedures are not followed.

403.17.1.1 Asphalt Test Results. The contractor shall record all test results and furnish a copy, including all raw data, to the engineer no later than the beginning of the day following the test. The contractor shall maintain all test results in an organized format and shall be available to the QA inspector at all times. Scale readings and other measurements not directly recorded by electronic media shall be recorded in an organized format. Printouts from gyratory compactors and asphalt content devices shall be retained as part of the testing records.

403.17.2 Bituminous Quality Control Plan. Prior to approval of the trial mix design by the engineer, the contractor shall submit a QC Plan to Construction and Materials for approval. The QC Plan shall include:

- (a) The contractor representative in charge of QC and the project level representative if different from the contractor representative. Contact information should be recorded for these individuals.
- (b) Lot and subplot sizes and how they will be designated.
- (c) Performance testing, volumetrics, and asphalt content sampling, fabrication, and testing plan.
- (d) The test method for determining asphalt content and density determination. If cores are to be cut, the number of cores shall be specified.
- (e) Intelligent Compaction (if included in contract) and Paver Mounted Thermal Profiler base station and cellular reception plan.
- (f) A proposed independent third party name, contact, address, and phone number for dispute resolution.

403.17.2.1 Third Party. The third party shall be independent of the contractor, MoDOT consultants and all project subcontractors or suppliers on each specific project. All testing of material for dispute resolution shall be performed by an approved laboratory. Approved laboratories shall be AASHTO Accreditation Program certified in the areas of the material being tested.

403.17.2.2 Plant Calibration. Plant calibration shall be performed by the contractor in accordance with Sec 404, and records shall be made available to the engineer.

403.17.2.3 Retained Samples. All samples taken by the contractor, including but not limited to tested aggregate, volumetric and density samples, shall be retained for the engineer until the contractor's and engineer's tests are complete and accepted unless otherwise instructed. This

includes CT_{Index} and RT_{Index} results. These samples shall be maintained in clean covered containers, without contamination, readily accessible to the engineer. The retained sample's identification shall consist of, but is not limited to:

- (a) Time and date sampled.
- (b) Product specification number.
- (c) Type of sample, i.e. belt, bin, stockpile.
- (d) Lot and subplot designation.
- (e) Sampler/Tester.
- (f) Project Job Number.

403.17.2.3.1 Retained Loose Mix Material. All loose mix samples for determination of volumetrics, performance tests, asphalt binder content and TSR shall be taken from the plant at random as designated by the engineer. Loose mix material shall be taken, identified, and retained for the engineer.

403.17.2.4 Performance Test Specimens and Loose Mix Sample. All loose mix samples for determination of performance tests, volumetrics, asphalt binder content and TSR shall be taken at the plant at random intervals as designated by the engineer. All QC/QA loose mix samples shall be taken by the contractor. Non-TSR performance test specimens shall be fabricated by the contractor. The engineer shall be present when taking loose mix samples and fabricating specimens for QA testing. Companion samples shall be identified and retained for the engineer.

403.17.3 Quality Control Laboratory. All QC mixture testing shall be performed in an approved laboratory.

403.17.3.1 Calibration Schedule. The contractor shall calibrate or verify all significant test equipment associated with tests covered in this specification. Intervals as set by the contractor shall not exceed the following limits:

| Equipment - Test Method (AASHTO) | Requirement | Interval (Month) |
|---|---|---------------------|
| Performance Testing Load Frames – R 18 | Calibrate | 12 |
| Hamburg Wheel Track Test - R 18 | Calibrate | 12 |
| Gyratory Compactor - T 312 | Calibrate – $1.16 \pm .02^\circ$ internal angle | 12 ^a |
| Gyratory Compactor - T 312 | Verify | 1 ^c |
| Gyratory Molds - T 312 | Check Critical Dimensions | 12 |
| Thermometers - T 209, T 166, T 312 | Calibrate | 12 |
| Vacuum System - T 209 | Check Pressure | 12 |
| Pycnometer (Flask) - T 209 | Calibrate | Daily |
| Binder Ignition Oven - T 308 | Verify | 12 ^b |
| Nuclear Content Gauge – T 287 or MoDOT TM 54 | Drift & Stability – Manuf. Recommendation | 1 |
| Mechanical Shakers - T 27 | Check Sieving Thoroughness | 12 |
| Sieves | Check Physical Condition | 6 |
| Weighted Foot Assembly - T 176 | Check Weight | 12 |

| | | |
|----------------------------|----------------------------------|-----------------|
| Mechanical Shaker - T 176 | Check Rate & Length of Throw | 12 |
| Liquid Limit Device - T 89 | Check Wear & Critical Dimensions | 12 |
| Grooving Tool - T 89 | Check Critical Dimensions | 12 |
| Ovens | Verify Temp. Settings | 12 |
| Balances | Verify | 12 ^b |
| Timers | Check Accuracy | 12 |

^aCalibrate and/or verify after each move.

^bVerify after each move.

^cIncludes ram pressure, LVDT, frequency of gyration, and external angle.

403.17.3.1.1 Inventory. An inventory of all major sampling, testing, calibration, and verification equipment, including the serial number or other identifying number shall be maintained.

403.17.3.1.2 Calibration Records. Calibration and verification records shall include but are not limited to:

- (a) Detailed results of the work performed (dimensions, mass, force, temperature, etc.)
- (b) Description of the equipment calibrated including identifying number.
- (c) Date the work was performed.
- (d) Identification of the individual performing the work.
- (e) Identification of the calibration or verification procedure used.
- (f) The previous calibration or verification date and next due date.
- (g) Identification of any in-house calibration or verification device used (including identification to establish traceability of items such as standard masses, proving rings, standard thermometers, balances, etc.).

403.17.3.2 Record Retention. Test records shall be maintained to permit verification of any test report. Records pertaining to testing, equipment calibration and verification, test reports, internal quality systems review, proficiency sample testing, test technician training and evaluation and personnel shall be retained in a secure location for a minimum of three years.

403.17.3.3 Test Method Availability. A current copy of all test methods and procedures shall be maintained in the QC laboratory at all times for reference by the technicians. Examples of report formats and procedures may be found in AASHTO R 18.

403.18 Quality Assurance. All QA field inspection, sampling and testing will be performed by a qualified MoDOT technician. The QA inspector shall have free access to any and all testing equipment used by the mixture producer and any workbooks, records or control charts maintained by the mixture producer for the QC process. The QA inspector shall also have sufficient access to the plant grounds to assure compliance with the approved QC Plan.

403.18.1 Assurance Testing. The engineer will independently test the specimens and/or mixture from the roadway or plant at the frequency listed in Sec 403.19.3. The independent samples shall be of sufficient size to retain half for possible disputes. Further testing of this sample will be under the direction of the engineer. The retained portion of the QC samples for mixture properties,

gradation, and deleterious content will be tested as directed by the engineer. The engineer's test results, including all raw data, will be made available to the contractor when completed and no later than the next working day.

403.18.2 Chain of Custody. QA density cores shall be sealed in approved tamper-evident containers immediately after extraction in the presence of the engineer. At the plant, the contractor shall provide loose mix material and test specimens at the frequency listed in Sec 403.19.3 for all QA testing at the provided random tonnage in the presence of the engineer.

403.18.3 Aggregate Comparison. Comparison for aggregate will be considered favorable when the contractor's QC results and engineer's QA test results of a retained sample compare within the following limits.

403.18.3.1 Gradation.

| Sieve Size | Percentage Points |
|---------------------|-------------------|
| 3/4 inch and larger | 5.0 |
| 1/2 inch | 5.0 |
| 3/8 inch | 4.0 |
| No. 4 | 4.0 |
| No. 8 | 3.0 |
| No. 10 | 3.0 |
| No. 16 | 3.0 |
| No. 20 | 3.0 |
| No. 30 | 3.0 |
| No. 40 | 2.0 |
| No. 50 | 2.0 |
| No. 100 | 2.0 |
| No. 200 | 1.0 |

403.18.3.2 Deleterious. The total and individual deleterious content shall not exceed the specification limits.

403.18.4 Federal Highway Administration Requirements. Performance and acceptance of QC/QA testing under these specifications shall not eliminate any FHWA requirements for acceptance of the material.

403.19 Acceptance of Material. Acceptance of bituminous mixture will be based on lots. With the exception of density, asphalt material will be sampled at the asphalt plant in lots or sublots on a random basis through the use of a random number system and evaluated using a Quality Level Analysis (QLA). A QLA will determine payment based on a combination of the total PWL (PWL_t) determined for each pay factor item for each lot of material produced.

403.19.1 Random Numbers. The engineer will generate random numbers. Random numbers will be based upon tonnage.

403.19.2 A lot shall consist of a maximum of 6,000 tons. The maximum subplot size shall be 1500 tons and each lot shall contain no less than 4 sublots. Sublots from incomplete lots shall be combined with the previous complete lot for determination of pay factors. When no previous lot exists, the mixture shall be treated in accordance with Sec 403.23.8.1. A new lot shall begin when

the asphalt content of a mixture is adjusted in accordance with Sec 403.11 or if there is an asphalt binder grade change or an additive source change.

403.19.3 Test and Pay Factor Items. As a minimum, the contractor and engineer shall test in accordance with the following table. The number of random tests per subplot may be increased per the contractor's QC plan. The QC plan shall state the test and testing frequency. All random tests shall be used in the pay factor determination. Where multiple test methods are allowed, the contractor shall designate the test method to be used in the QC Plan. Final payment will be based on the indicated pay factor items.

| Tested Property | Test Method | Contractor Frequency | Engineer Frequency |
|--|--|--------------------------|--------------------------------|
| Pay Factors | | | |
| Mat Density (% of theoretical maximum density) ^(a) | MoDOT TM 41, AASHTO T 166 or AASHTO T 331 | 1 Sample / Sublot | 1 Sample / Lot |
| Asphalt content | AASHTO T 164, or MoDOT Test Method TM-54, or AASHTO T 287, or AASHTO T 308 | 1 / Sublot | 1 / Lot |
| V _a , N _{des} | AASHTO T 312 and R 35 | 1 / Sublot | 1 / Lot |
| C _T _{Index} | ASTM D 8225 | 1 / 3000 tons | 1 / 12000 tons |
| Pay Factor Adjustments | | | |
| Unconfined Longitudinal Joint Density ^(a) | MoDOT TM 41, AASHTO T 166 or AASHTO T 331 | 1 Sample / Sublot | 1 Sample / Lot |
| Intelligent Compaction | Sec 405 | Continuous | 10% of travelway of one roller |
| R _T _{Index} | ASTM D 8360 | 1 / 3000 tons | 1 / 12000 tons |
| Tensile Strength and TSR | AASHTO T 283 | 1 / 12000 tons (maximum) | 1 / Project |
| Other Testing | | | |
| Cold feed or hot bin gradation and deleterious content | AASHTO T 27 and AASHTO T 11 | As Needed | As Needed |
| Mix Temperature at Plant | ---- | 1 / Sublot | 1 / Day |
| Temperature of Base and Air | ---- | As Needed | As Needed |

(a) Core samples shall consist of one core. Up to two additional cores, as stated in the QC Plan, may be obtained at the same offset within one foot of the randomly selected location. If more than one core is obtained, all cores shall be combined into one sample.

403.19.3.1 Test Method Modification.

403.19.3.1.1 Binder Ignition Modification. Asphalt content determination in accordance with AASHTO T 308, Section 6.9.1 shall be modified by adding the following: If the calibration factor exceeds 1.0 percent, lower the test temperature to 800 ± 8 F and repeat test. Use the calibration

factor obtained at 800 F even if it exceeds 1.0 percent. If RAP is used, the binder ignition oven shall be calibrated in accordance with MoDOT Test Method TM 77. At the engineer's discretion, testing may be waived when production does not exceed 200 tons per day. The contractor shall certify the proper proportions of a previously proven mixture were used.

403.19.3.1.2 Rice Test. When the water absorption of any aggregate fraction is greater than 2.0 percent, the test method for determining theoretical maximum specific gravity, AASHTO T 209, shall be modified as follows: After completing the procedure in accordance with Section 9.5.1 or 9.5.2, drain water from the sample. To prevent loss of fine particles, decant the water through a paper towel held over the top of the container. Spread the sample before an electric fan to remove surface moisture. Weigh at 15-minute intervals, and when the loss in mass is less than 0.05 percent for this interval, the sample may be considered to be surface dry. This procedure requires about 2 hours and shall be accompanied by intermittent stirring of the sample. Break conglomerations of mixture by hand. Take care to prevent loss of particles of mixture. Calculate the specific gravity of the sample by substituting the final surface-dry mass for A in denominator of Equations 2 or 3.

403.19.3.1.3 Mixture Bulk Specific Gravity. Determining bulk specific gravity using paraffin-coated specimens, AASHTO T 275, shall not be used when required by AASHTO T 166. Alternate methods are AASHTO T 331 and ASTM D1188. The surface of specimens prepared for testing by these methods may have the surface texture removed by sawing a minimal amount. Specimens shall be securely held in a jig or other clamping device to eliminate distortion and retain a face parallel to the original surface. Measurements for lift thickness shall be made prior to sawing.

403.19.3.1.4 QC and QA Mix Sampling and Preparation. All loose mix shall be sampled at the plant by the contractor during production in accordance with AASHTO R 97 and split to the appropriate size in accordance with AASHTO R 47. After QC has been notified of the random sample, the first truck shall be sampled as directed by the engineer. If the random number for multiple tests overlap, the contractor shall complete the first testing requirements and then immediate proceed with the second testing requirements. The contractor shall wait 30 minutes after sampling loose mix before fabricating specimens for CT_{Index} and RT_{Index} testing. Loose mix temperatures shall not drop below the molding temperature. The 30 minutes shall start when all the material for the loose mix sample has been obtained and the time this occurs shall be recorded. All specimens shall be fabricated as soon as possible after the 30-minute delay. QC and QA samples shall be taken and fabricated by the contractor at separate random times.

The following table details the minimum number of specimens required for QC or QA testing:

| Test Method | Minimum Number of Specimens | Molded Specimen Height (mm) |
|---|-----------------------------|---------------------------------|
| Required Fabrication for CT_{Index} and RT_{Index} | | |
| QC Frequency: 1 Set per 3000 tons | | |
| QA Frequency 1 Set per 12000 tons | | |
| Cracking Tolerance Index (CT_{Index}) | 5 Compacted Specimens | 62 (± 1 mm) ^(b) |
| Rutting Tolerance Index (RT_{Index}) | 3 Compacted Specimens | 62 (± 1 mm) ^(b) |
| Retained Loose Mix ^(a) (QA sample only) | 125 lbs | N/A |

| Required Fabrication for Volumetrics and % Asphalt Content QC Frequency: 1 Set per subplot QA Frequency 1 Set per Lot | | |
|--|-----------------------|--------------|
| % Asphalt Content | 1 Sample | N/A |
| Theo. Max SG of mixture, Gmm | 1 Sample | N/A |
| % Air Voids | 2 Compacted Specimens | N_{Design} |
| Retained Loose Mix ^(c) | 30 lbs | N/A |
| Required Sampling for TSR QC Frequency: 1 Sample per 12,000 tons QA Frequency: 1 Sample per Project | | |
| Tensile Strength Ratio (TSR) | 250 lbs | N/A |

- (a) Retained loose mix for Hamburg verification of mixture not meeting minimum RT_{Index} thresholds
- (b) 95 mm specimen height for SP250 mixes
- (c) Retain at least 30 pounds of loose mix material for dispute resolution.

The CT_{Index} test shall be based upon five compacted specimens tested, discard the single highest and lowest values, and average the three remaining values.

The RT_{Index} test shall be based upon the average of three compacted specimens.

Volumetric testing shall be based upon the average of two compacted specimens.

403.19.3.1.5 Molding Performance Samples. The specimens shall be compacted to an air void content of 7.0 ± 0.5 percent or 6.0 ± 0.5 percent for SMA mixtures. The compacted test specimens shall be allowed to cool to 77 ± 5 F prior to determining the air void content.

403.19.3.1.6 Records. Compaction temperature, times in and out of the oven, gyratory specimen weights and times, and sample identification shall be recorded.

403.20 Miscellaneous Applications.

403.20.1 Small Quantities. Small quantities are less than 6000 tons for the pay item quantities of each separate mixture and the following shall apply:

- (a) A field laboratory will not be required for monitoring mixtures. All required QC and QA testing shall be performed in an approved laboratory.
- (b) No Performance Testing is required and acceptance shall be in accordance with Sec 403.23.8.1. Density, % AC, and % Air Voids shall be performed at a frequency of no less than one per day if production does not exceed 1000 tons and at a frequency of no less than two per day if production exceeds 1000 tons. Independent or retained sample QA tests shall be performed at least once per project, as indicated.

403.20.2 Base Widening and Entrances. For base widening mixture and entrance work, the following will apply:

- (a) All base widening shall be constructed in accordance with Sec 401.7 and subsections.
- (b) The minimum density of these mixtures shall be attained as specified herein, except, compaction may be performed in accordance with Sec 403.15.3.

403.20.3 Dispute Resolution. When there are significant discrepancies between the engineer's and the contractor's test results, dispute resolution procedures will be used.

403.20.3.1 Cease Work. The contractor's operations may be required to cease until the dispute is resolved if the test results indicate the mixture is subject to failure.

403.20.3.2 Third Party Resolution. The first step in dispute resolution will be to identify differences in procedures and correcting inappropriate procedures before moving to third party resolution. If that does not resolve the dispute, either the contractor or the engineer may request the approved QC Plan third party involvement. The recommendations of the approved third party shall be binding on both the engineer and contractor.

403.20.3.3 Third Party Payment. The contractor shall be responsible for the cost associated with the third party testing and resolution if the final result indicates the engineer's test results were correct. Likewise the Commission will be responsible for the cost associated with the third party testing and resolution when the final result indicates the contractor's results were correct.

403.20.3.4 Other Adjustments. The contractor shall not be entitled to any additional payment for costs incurred due to use of the dispute resolution procedures such as, but not limited to, those for delay, cessation of operations, costs to subcontractors, etc. The engineer may give consideration to adjustment of working days if warranted.

403.20.3.5 Dispute with CT_{Index} and RT_{Index} Results. If QA and QC results for CT_{Index} or RT_{Index} do not compare favorably, the first step will be to identify differences in procedures, including specimen aging. If that does not resolve the dispute, the QA CT_{Index} result shall be averaged with the QC CT_{Index} result to determine pay. If RT_{Index} results are in dispute, QC shall fabricate specimens for Hamburg testing in the presence of the Engineer using the retained loose mix material. Retained loose mix material from the QC sample shall be used to fabricate specimens unless otherwise directed by the Engineer. Specimens shall be sent to the Engineer for Hamburg testing to determine specification compliance.

403.21 General Requirements.

403.21.1 Sequence of Operations. To reduce inconvenience to the traveling public during widening or surfacing, the contractor will not be permitted to place any final surface course until the base widening, the leveling course and the binder course have been completed throughout the entire combination of sections, unless otherwise authorized by the engineer. The proper condition of the base widening, the leveling course, and the binder course, at the time of placing the surface course, shall be the contractor's responsibility.

403.21.2 Pavement Marking. If the contractor's work has obliterated the existing pavement marking on resurfacing projects open to through traffic, the pavement marking shall be replaced in accordance with Sec 620.

403.21.3 Surfaced Approaches. At locations designated in the contract or as specified by the engineer, approaches shall be primed in accordance with Sec 408 and surfaced with Type SP125 asphaltic concrete. The asphaltic concrete surface shall be placed in accordance with the details shown on the plans or as specified by the engineer. Approaches shall not be surfaced until after the surface course adjacent to the entrance is completed. Any work required to condition and prepare the subgrade on the approaches will be at the contractor's expense.

403.21.4 Filling Drain Basins. If shown on the plans, existing drain basins shall be filled to the top of the lip with plant mix bituminous base course or asphaltic concrete from the pavement edge to the edge of the shoulder. Any difficulty or delay created by this requirement will be at the contractor's expense.

403.21.5 Pavement Repairs (Blow-Ups). A blow-up will be considered that area where excessive expansion has resulted in distress to the existing pavement. Blow-ups occurring prior to the application of the tack coat on the existing surface will normally be repaired by the Commission. Blow-ups occurring after the application of the tack coat shall be repaired by the contractor by removing the distressed concrete and replacing the pavement in accordance with Sec 613.

403.22 Method of Measurement.

403.22.1 Weight Determination. The weight of the mixture will be determined from the batch weights if a batch-type plant is used, and will be determined by weighing each truck load on scales in accordance with Sec 310 if other types of plants are used. Measurement will be made to the nearest 0.1 ton for the total tonnage of material accepted.

403.22.2 Full Depth.

403.22.2.1 The final driving surface area, for the full depth of the pavement, will be used as the area for all underlying bituminous lifts and will not include the additional quantity needed to construct the 1:1 slope.

403.22.2.2 Final measurement of the completed pavement will not be made except for authorized changes during construction, or where appreciable errors are found in the contract quantity. Where required, measurement of the pavement complete in place will be made to the nearest 0.1 square yard. The revision or correction will be computed and added to or deducted from the contract quantity.

403.22.3 Alternate Overlay.

403.22.3.1 Field Established Quantity. When bid as an alternate to a Portland cement concrete overlay, the contractor shall establish the existing roadway profile and set the final overlay profile. The engineer may adjust the final profile as needed. The tons of hot mix asphalt required will be determined by the engineer from the set or adjusted profile. This quantity will be the field established plan quantity.

403.22.3.2 Overlay Measurement. Final measurement of the completed pavement will be based on the field established plan quantity except for authorized changes during construction. The revision or correction will be computed and added to or deducted from the contract quantity. Measurement of the pavement complete in place will be made to the nearest 0.1 ton.

403.22.4 Pavement Testing. The finished courses shall have the nominal thickness shown on the plans. Tests will be conducted to ensure that each course is being constructed to proper thickness, composition, and density. The contractor shall cut samples from any layer of the compacted mixture at locations designated by the engineer. QA samples shall be cut and delivered to the engineer no later than the end of the next day following the laydown operation. If the samples are not cut and delivered as stated, the asphaltic laydown operation may be suspended and a deduction of 5 percent per day of the contract unit price of the representative material may be applied, until samples are cut and delivered to the engineer. Samples may be obtained by either sawing or drilling 4-inch minimum diameter cores. Each sawed sample shall consist of a single piece of the pavement of the size designated by the engineer, but no larger than 12 inches square.

403.22.4.1 Pavement Thickness. Lift thickness may be determined by the average thickness of cores taken for density measurements for each lot. Total thickness samples for new full depth asphalt pavements shall be obtained after all bituminous construction is completed on the project and shall be taken at locations specified by the engineer. For the purpose of determining the constructed thickness of full depth pavement, cores shall be taken at random intervals in each traffic lane at the rate of one core per 1000 feet or increment thereof, or at any other locations as may be determined by the engineer and measured in accordance with AASHTO T 148. Sections of any asphaltic concrete determined to be 0.5 inches or more, less than the thickness shown on the plans, shall be corrected by the contractor. No payment will be made for any costs incurred by the contractor in correcting pavement deficient in thickness. Each core is representative of the pavement thickness for a distance extending one-half the distance to the next core, measured along centerline, or in the case of a beginning or ending core, the distance will extend to the end of the pavement.

403.22.4.2 Surface Restoration. The surface from which samples have been taken, including those for density measurements, shall be restored by the contractor with the mixture then being produced no later than the next day of plant operation, if construction is still active. If bituminous construction has been completed, the surface from which samples have been taken shall be restored within 48 hours with an approved commercial mixture or with cold patch mixtures acceptable to the engineer.

403.23 Basis of Payment.

403.23.1 Percent Within Limits. PWL will be based on the mean, standard deviation and quality index of each lot's test results. The upper PWL (PWL_u) and lower PWL (PWL_1) is determined from the table in Sec 502.15.8. For Upper or Lower Quality Index values less than zero, the value in the Table shall be subtracted from 100. Total percent within limits, PWL_t , is: $PWL_t = (PWL_u + PWL_1) - 100$. For Density of SMA mixes the PWL_u shall be 100.

The mean is: $x_a = (\Sigma x_i)/n$

Where: x_a = Average of the individual values being considered

Σx_i = The summation of all the individual values being considered

n = The number of individual values under consideration

The Standard Deviation is: $s = (\Sigma (x_i - x_a)^2/(n - 1))^{1/2}$

The Upper Quality Index is: $Q_u = (USL - x_a)/s$

The Lower Quality Index is: $Q_1 = (x_a - LSL)/s$

Where: Q_u = Upper Quality Index
 Q_l = Lower Quality Index
USL = Pay Factor Item Upper Spec Limit
LSL = Pay Factor Item Lower Spec Limit

403.23.1.1 Quality Level Analysis. The engineer will make the QLA no more than 24 hours after receipt of the contractor's test results, by determining the PWL_t for each designated pay factor item.

403.23.1.1.1 Acceptance. The contractor's test results will be used when applicable to determine the PWL, provided the contractor's QC tests and the engineer's QA tests compare favorably, and provided the engineer's inspection and monitoring activities indicate the contractor is following the approved QC Plan.

403.23.1.1.2 Comparison. Favorable comparison will be obtained when the engineer's QA test results on a production sample are within two standard deviations or the comparison limit, whichever is greater, of the mean of the contractor's test results for that particular lot. Comparison limits for QC average results are as follows: air voids within ± 0.5 percent, asphalt content within ± 0.2 percent, and density within ± 1.3 percent. QA CT_{Index} results shall be within ± 30 of the QC testing that falls nearest result for SuperPave and ± 60 for SMA. For the CT_{Index} test, if all QC and QA are greater than 80 for SuperPave mixes and greater than 190 for SMA mixes, then results are considered comparable. QA RT_{Index} results shall be within ± 15 percent of the QC testing that falls nearest. Further comparisons may be made by using F & t testing at a significance level of 1 percent as directed by the engineer.

403.23.1.1.3 Outliers. No test result shall be discarded, except individual test results on a lot basis may be checked for an outlier in accordance with the statistic T in ASTM E 178, at a significance level of 5 percent. If an outlier is found, material from the retained QA sample may be tested, in the presence of the engineer, to determine a replacement test value. The replacement test value shall be used in the PWL determination.

403.23.1.1.4 Roadway/Shoulder Lots. For the purpose of QLA, mixture placed on the traveled way and placed on the traveled way and shoulders integrally, shall be accounted for in a regular lot/sublot routine. Mixture placed on shoulders only shall be accounted for in a shoulder lot/sublot routine.

403.23.1.1.5 Random Sampling. For the purpose of QLA, all mixture produced at the plant and placed on the roadway shall be subject to random testing. Mainline density measurements at the roadway shall not be taken within 6 inches of an unconfined longitudinal joint. Random samples taken in the same day may be separated by 200 tons.

403.23.2 Pay Factors. The total pay factor (PF_T) for each lot will be equal to the weighted sum of the pay factors (PF) for each pay factor item for each lot, and is determined as follows:

$$PF_T = + (0.5) PF_{Density} + (0.25) PF_{Va} + (0.25) PF_{AC}$$

The PF_T for each lot, on the shoulder or otherwise when the density pay factor is not directly included, will be equal to the weighted sum of the PF for each pay factor item for each lot, and will be determined as follows:

$$PF_T = (0.5) PF_{Va} + (0.5) PF_{AC}$$

The PF for each pay factor item for each lot will be based on the PWL_t of each pay factor item of each lot and will be determined as follows:

When PWL_t is greater than or equal to 90: PF = 0.3 PWL_t + 73;

When PWL_t is greater than or equal to 70 and PWL_t is less than 90: PF = 0.5 PWL_t + 55;

When PWL_t is less than 70: PF = 2 PWL_t - 50;

403.23.2.1 Density Pay Factor. The theoretical maximum specific gravity of the mixture, as determined for each subplot and the bulk specific gravity of no less than one core from each subplot, will be used to perform the QLA for the percent of theoretical maximum density. Thick cores required to be cut in half in accordance with Sec 403.15.4 shall effectively double the number of sublots for cores. When density is not used as a pay factor, additional adjustment of the contract unit price will be based on the table in Sec 403.23.8.1.

403.23.2.2 Asphalt Content Pay Factor. The QLA will be performed using the asphalt content test results from each lot.

403.23.2.3 Air Voids Pay Factor. Two gyratory specimens shall be compacted for each subplot and the average of the two specimens will be used to calculate the volumetrics of the subplot. The air voids shall be determined from the gyratory compacted specimens. The air voids for the QLA shall be those calculated using the average bulk specific gravity of the gyratory compacted specimens and the theoretical maximum specific gravity of the mixture determined for the subplot of material.

403.23.2.4 CT_{Index} and TSR Pay Factor. The contract unit price for each 3,000 tons or fraction thereof for all mixtures shall be adjusted based on the average CT_{Index} results for the tonnage according to the following table provided that acceptable RT_{Index} or Hamburg and TSR results are obtained. The lower adjusted contract unit price from the CT_{Index} and TSR results shall apply.

| SuperPave Mixtures | | | |
|--|---|----------------------------------|--|
| Cracking Tolerance Index (CT_{Index}) | Tensile Strength Ratio (TSR)^(a) | Percent of Contract Price | |
| 40 – 49 | 70 – 74 % | 97% | |
| 50 – 99 | 75 – 84 % | 100% | |
| 100 or Greater | 85 % or Greater | 103% | |
| SMA Mixtures | | | |
| Cracking Tolerance Index (CT_{Index}) | Tensile Strength Ratio (TSR)^(a) | Percent of Contract Price | |
| 80 – 134 | 70 – 74 % | 97% | |
| 135 – 239 | 75 – 84 % | 100% | |
| 240 or Greater | 85 % or Greater | 103% | |

(a) If an approved liquid anti-strip is used, the TSR limit to receive full incentive is 80 percent.

The QLA shall be performed using each Density, % Air Void, and % Asphalt Content result within the lot.

403.23.3 Removal of Material. All lots of material with a PF_T less than 50.0 shall be removed and replaced with acceptable material by the contractor.

Any subplot of material with a percent of theoretical maximum density of less than 90.5 percent or greater than 98.5 percent shall be removed and replaced with acceptable material by the contractor. For SMA mixtures, any subplot of material with a percent of theoretical maximum density of less than 92.0 percent shall be removed and replaced with acceptable material by the contractor.

Any material with a CT_{Index} less than 40 shall be considered unacceptable material. For SMA mixtures, any material with a CT_{Index} less than 80 shall be considered unacceptable material.

Any subplot of material with air voids in the compacted specimens less than 1.5 percent or tonnage of material not meeting the minimum RT_{Index} shall be evaluated with Hamburg testing and removed and replaced with acceptable material by the contractor if the rut depth is greater than 1/2 inch at the designated number of wheel passes.

Any material with TSR results below 70 percent or minimum conditioned tensile strength below 60 psi are considered unacceptable and will be subject to removal, production shall cease, the mixture reverified, and other payfactors incentives shall not be applied.

No additional payment will be made for such removal and replacement. The replaced material will be tested at the frequencies listed in Sec 403.19. Pay for the material will be determined in accordance with the applicable portions of Sec 403.23 based on the replacement material.

403.23.4 Pay Factor Adjustments. Pay factor adjustments are as follows:

403.23.4.1 Unconfined Longitudinal Joint Density Adjustment. The minimum density of all traveled way pavement within 6 inches of a longitudinal joint, including the pavement on the traveled way side of the shoulder joint, shall not be less than 90.5 percent of the theoretical maximum specific gravity for SuperPave mixtures and above 92.0 percent of the theoretical maximum specific gravity for SMA mixtures. The density of the longitudinal joint when confined will be included in the evaluation of the remainder of the mat. Pay adjustments will be in accordance with the following table and will be applied to the corresponding tonnage represented by the core(s).

Pay adjustments due to longitudinal joint density will apply to the full width of the lane paved. The average of joint cores from each subplot will determine specification compliance. If payment reductions are necessary, the lowest PF_{Total} shall apply. Adjustments due to joint density will apply to the subplot from which the cores are obtained.

| Longitudinal Joint Density | |
|---|---|
| Field Density (Percent of Laboratory Max. Theoretical Specific Gravity) | Percent of Contract Unit Price |
| SuperPave Mixtures | |
| ≥ 90.5 | PF_{Total} not changed by longitudinal joint density |
| 89.5 – 90.4 | Maximum PF_{Total} = 100%; Correction Required ^(a) |
| < 89.5 | Remove and Replace |

| SMA Mixtures | |
|--------------|---|
| ≥ 92.0 | PF _{Total} not changed by longitudinal joint density |
| 90.0 – 91.9 | Maximum PF _{Total} = 100%; Correction Required ^(a) |
| < 90.0 | Remove and Replace |

(a) Correction requires spraying rapid penetrating emulsion on deficient density areas in accordance with JSP2303. All costs associated with correction shall be at the contractor's expense with no additional payment.

403.23.4.2 Smoothness Adjustment. The contract unit price for all mixes, except wedge or level course, will be adjusted in accordance with Sec 610.5. The contract unit prices for asphaltic concrete pavement will be considered full compensation for all materials entering into the construction of the pavement and for the cost of the smoothness testing and correction.

403.23.4.3 Paver Mounted Thermal Profiler. The contract unit price for all mixes, except wedge or level course, will be adjusted in accordance with Sec 406. The contract unit prices for asphaltic concrete pavement will be considered full compensation for all materials entering into the construction of the pavement and for the cost of the PMTP testing and correction.

403.23.4.4 Intelligent Compaction. If Intelligent compaction is not included as a pay item in the contract, then all specification requirements and pay adjustments pertaining to Intelligent Compaction will not apply. If pay items for Intelligent Compaction are included in the contract, then all specification requirements and pay adjustments pertaining to Intelligent Compaction shall apply.

403.23.5 Aggregate Variation. Due to possible variations in the specific gravity of the aggregates, the tonnage of mixture used may vary from the proposal quantities. No adjustment in contract unit price will be made because of such variation.

403.23.6 Compacted Samples. Payment for obtaining and delivering samples of compacted mixture from the pavement and replacing the surface will be made per sample at the fixed price specified in Sec 109. No direct payment will be made for samples taken for QC and QA testing.

403.23.7 Payment for Pavement Repairs (Blow-ups). Payment for repairing blow-ups will be made in accordance with Sec 104.

403.23.8 Miscellaneous Applications.

403.23.8.1 Small Quantities. Small quantities are defined in Sec 403.20.1. Unless the contractor has elected to use the normal evaluation in the Bituminous QC Plan for small quantities, the following shall apply for each separate mixture qualifying as a small quantity

(a) QLA and PWL shall not apply.

(b) Mixtures shall be within the specified limits for % Air Voids, % AC, and density. In addition to any adjustments in pay due to profile, the contract unit price for the mixture represented by each set of cores will be adjusted based on actual field density above or below the specified density using the following schedule:

| Field Density (Percent of Laboratory Theoretical Density) | Max. | Pay Factor (Percent of Contract Unit Price) |
|---|------|---|
| For all SP mixtures other than SMA: | | |
| 92.5 to 98.0 inclusive | | 100 |
| 90.5 to 92.4 inclusive | | Correction ^(a) |
| Above 98.0 or Below 90.5 | | Remove and Replace |
| For SMA mixtures: | | |
| >94.0 | | 100 |
| 92.0 to 93.9 inclusive | | Correction ^(a) |
| Above 98.0 or Below 92.0 | | Remove and Replace |

(a) Correction requires spraying rapid penetrating emulsion on deficient density areas in accordance with JSP2303. All costs associated with correction shall be at the contractor's expense with no additional payment.

403.23.8.2 Base Widening and Entrances. For base widening mixtures and entrance work, QLA and PWL will not be required. Payment for these mixtures will be made at 100 percent of contract unit price for material that otherwise meets the specifications.

403.23.8.3 Single Lift on Unmilled Surface or Leveling Course Work. For resurfacing projects specifying a single lift on an unmilled surface, surface mixture of 3,000 tons or more, or for leveling course work, the following shall apply to the traveled way mixture. All bituminous mixture QC/QA requirements shall apply, except the density pay factor designated in Sec 403.23.2 will not be directly included in the total pay factor. In lieu of that, one density sample shall be taken per subplot and the pay adjustment for density will be made using the table in Sec 403.23.8.1.

3.0 *Insert Sec 406 Paver-Mounted Thermal Profiles:*

406 Paver-Mounted Thermal Profiles

406.1 Description. This work shall consist of continuous thermal profiling of the asphalt mat temperature behind the trailing edge of the paver screed plate during placement operations using a Paver-Mounted Thermal Profile System (PMTPS). This work shall be completed in accordance with the general principles set forth in AASHTO R 110 "Standard Practice for Continuous Thermal Profile of Asphalt Mixture Construction", and specifically as stated in the following sections.

406.2 Required Measurements. PMTPS measurements are required on the full width of paving of each asphalt lift. Collection of data shall include shoulder pavement when placed simultaneously with the mainline. The shoulder paving data will be filtered out using Veta during data processing. PMTPS data collection is not required in the following exceptions:

- (1) PMTPS measurements are not required on auxiliary lane tapers, ramps, shoulders (not paved simultaneously with mainline), cross-overs, non-continuous turn lanes, loops, bypass lanes, acceleration/deceleration lanes, intersecting streets, roundabouts, and partial lane width widenings.
- (2) PMTPS measurements are not required for a total net paving length less than 2 lane miles.

(3) PMTPS measurements are not required on asphalt lift thicknesses less than 1 inch.

406.3 Equipment Requirements. The PMTPS shall consist of the following components listed.

- (1) Temperature sensor to continuously monitor surface temperature of mat.
 - a. Longitudinal and lateral surface temperature readings shall be collected at 12-inch or less intervals at all paving speeds with an X-Y accuracy of plus or minus 1 inch.
 - b. Surface temperatures shall be collected for the full width paved in one pass (including any shoulders paved simultaneously with mainline).
 - c. Surface temperature sensors(s) shall have a temperature range of at least 140 F to 480 F. Sensory accuracy shall be plus or minus 3.6 F, or plus or minus 2.0 percent of sensor reading, whichever is greater.
- (2) Global Navigation Satellite System (GNSS) receiver to capture coordinates of the surface temperature readings. GNSS accuracy shall be plus or minus 2 inches or less in X and Y directions when intelligent compaction is being used. A base station shall be required at any locations having poor cellular reception to obtain required accuracy. When intelligent compaction is not being used GNSS accuracy shall be plus or minus 4 feet or less in the X and Y directions and ground distance sensor shall be within plus or minus 1/1000 feet.
- (3) Onboard data acquisition with a minimum of the following capabilities:
 - a. Displays (in real-time) map of the surface temperature readings.
 - b. Displays total distance, paver speed and location.
 - c. Reports surface temperature readings and GNSS status.
 - d. Provides real-time statistical summaries of surface temperature readings.
 - e. Allows operator to define data lot currently being placed per AASHTO PP 114.
 - f. Stores data internally until data transfer.
 - g. Automatically transfers data to cloud storage or other approved methods.

406.3.1 System Setup on Pavers. Pavers shall be instrumented with the PMTP system for the full paving width and shall collect measurements no less than 3 feet and no greater than 12 feet from the trailing edge of the screed plate. Other objects shall not obstruct surface temperature measurements and GNSS accuracy.

406.4 Construction Requirements.

406.4.1 Temperature Verification. Temperature verification shall follow AASHTO R110-22, Section 6 Calibration. A record of each verification shall be submitted to the SharePoint prior to the start of the project.

406.4.2 Data Management. PMTP data files shall be compatible with the Veta software. The contractor shall supply the engineer with the manufacturer's PMTPS Computer Software 14 days prior to beginning work and until ninety days after completion of all work. If Cloud Storage or Cloud Computing is used, the engineer shall be supplied one user ID with full access for the same time-period specified. If cloud storage is not used Raw PMTP data files shall be downloaded once per day and uploaded to the appropriate MoDOT IC-PMTP SharePoint site before the start of the next day's production. The following data management requirements shall apply:

- (1) The PMTP data files should be directly transferred from cloud storage to Veta. Other methods shall be approved by the engineer.
- (2) The PMTP Veta files shall be appropriately formatted and filtered in accordance with MoDOT IC-PMTP protocol.
- (3) Date and time stamp of PMTP shall be checked and verified to reflect the local time zone for both mapped and exported data.

406.4.3 Quality Control. The following shall apply to the Contractor's Quality Control for PMTP.

- (1) The contractor shall have a properly trained person listed in the QC Plan that has completed a Veta training course within the last 2 years to perform the PMTP data collection and file management for the project.
- (2) The PMTP system shall have a documented annual calibration before beginning construction.
- (3) For each run, the thermal profile shall be divided into 150-foot sublots at the full paving width and partial data sublots as follows:
 - (a) Combine partial data sublots less than 75 feet with the previous data subplot.
 - (b) Treat partial sublots greater than 75 feet as one data subplot.
 - (c) Sublots shall not extend over multiple days, different lifts, or paving directions.
- (4) Veta files shall be completed and uploaded with the appropriate naming convention in accordance with MoDOT IC-PMTPS Protocol. Appropriate naming convention can be found in the IC-PMTP Document Helper. The completed Veta files shall have the appropriate filters applied with the summary data transferred to the Summary Report. An up-to-date Summary Report shall be provided to the engineer two days prior to the 1st and 15th of each month.
- (5) **PMTP Quality Control Plan.** A pre-activity meeting shall be required prior to mainline paving. The PMTP Quality Control Plan shall be submitted to the engineer at least 2 weeks prior to the mainline paving pre-activity meeting. The plan at minimum shall include the following:
 - (a) A list of personnel previously trained
 - (b) Detailed daily verification procedure for checking the RTK-GNSS of PMTP
 - (c) Procedure for downloading PMTP data from the instrument
 - (c) The procedure for training operators or other project staff
 - (e) Detailed daily verification procedure for checking the temperature sensor on the PMTP

- (f) The name of the designated PMTP Quality Control Technician
- (g) Procedure for submitting data
- (h) Contact information for technical support staff
- (i) Anticipated cellular service and GNSS coverage throughout entire project
- (j) A list of the control points with either UTM or State Plane Coordinates established by the contractor if a base station is required.

406.4.4 Quality Assurance (QA) Testing. The Engineer will use a Forward Looking InfraRed (FLIR) camera to verify the contractor's PMTP system. QA tests shall be taken at random locations twice per day. The contractor shall assist the engineer with the placement of the event marker.

The QA tests using the FLIR data QA tool shall compare favorably, according to the instructions found in the IC-PMTP Document Helper. If results do not compare favorably, the contractor's PMTPS shall be verified by the manufacturer. In the case that the PMTPS is required to be sent off to the manufacturer and the contractor is not able to provide a replacement, the contractor will be allowed to continue paving with the verification by the engineer using a FLIR camera for acceptance only.

406.4.5 Thermal Segregation. Thermal segregation will be calculated by using the Differential Range Statistics (DRS) under the parameters of AASHTO R110 in each 150-foot subplot.

The Veta analysis with the appropriate filters applied shall exclude the following surface temperature readings from each subplot:

- (1) Surface temperature readings less than 180 F.
- (2) Surface temperature readings within 2 feet. prior to and 8 feet. after paver stops that are greater than 1 minute in length.

The thermal segregation categories are based on the Differential Range Statistics (DRS), as shown in the table below.

| Differential Range Statistics (DRS) | Thermal Segregation Category |
|-------------------------------------|------------------------------|
| DRS \leq 25.0°F | Low |
| 25°F < DRS \leq 35°F | Moderate |
| 35°F < DRS \leq 50°F | Moderate-High |
| DRS \geq 50°F | Severe |

406.4.6.1 Incentive/Disincentive. Incentive/disincentive adjustments shall be made for each subplot in accordance with the following:

| Thermal Segregation Category | Adjustment per 150 ft. Sublot |
|------------------------------|---|
| Low | \$40 Incentive |
| Moderate | \$40 to \$0 Incentive (Linear) |
| Moderate-High | \$0 to -\$40 Disincentive (Linear) |
| Severe | -\$40 Disincentive and Reviewed by Engineer |

406.5 Loss of Data. If data collection ceases as a result of circumstances reasonably beyond the control of the contractor, the contractor will be allowed to continue the days paving, but the paved sublots will not be eligible for 406 PMTP Incentive. The engineer must be notified

immediately of the issue and shall determine if the contractor has made a reasonable effort to resolve the issue. A meeting with the engineer shall be held to determine how to proceed if the issue is expected to extend into the next day's paving. Failure to notify the engineer of the issue at hand will result in the paved sublots to receive a minus \$40 deduct.

406.5.1 GNSS Obstructions. Isolated areas of GNSS obstruction may be filtered out of Veta at the contractor's choice. These areas shall be identified in Veta and brought to the attention of the Engineer. Areas excluded from GPS obstruction shall not exceed approximately 5 percent of the total day's production. It is at the discretion of the engineer to determine if the area exceeds an approximate 5 percent.

406.6 Basis of Payment. No direct payment will be made for compliance with this provision.

DD. HiMod Asphalt Mixture Requirements JSP-25-02

1.0 Description. This work shall consist of the design and placement of an asphalt mixture in accordance with Sec 403 that meets the minimum Highly Modified Asphalt Mixture (HiMod Asphalt) requirements as described herein. The nominal aggregate size shall be either 095 or 125, as defined in Sec 403.1.

2.0 Binder Requirements. The binder shall be in accordance with AASHTO M 332 Grade MSCR PG 76E-28 with a minimum 90 percent Recovery, and shall meet the requirements in Table 1:

Table 1. Binder Requirements

| Property | Test Method: AASHTO (T) | | 76E-28 (HiMod) | |
|--|----------------------------|----------|----------------|--|
| Original | | | | |
| Flash Point, ° C | T48 | 230 min. | | |
| Rotational Viscosity, Pa-s | 135° C | T316 | 3.5 | |
| Dynamic Shear, kPa (G*/sin δ, 10 rad./sec) | At Grade Temperature | T315 | 1.00 min. | |
| RTFO Residue | | T240 | | |
| Mass Change, % | | T240 | 1.00 max. | |
| MSCR Test Temperature | | T350 | 76° C | |
| MSCR, J _{nr} @ 3.2kPa, max. | | | 0.1 | |
| MSCR, % Recovery @ 3.2kPa. Min | | | 90 | |

Job No.: J9I3838
 Route: I-55
 County: Cape Girardeau/Scott

| | | | |
|--|---------------------|------|----------------------------|
| PAV Residue | | R28 | 100° C, 20 hrs., 300psi |
| Dynamic Shear, kPa (G* x sinδ, 10 rad./sec) | At Test Temperature | T315 | 28° C |
| | | | 6,000 max. |
| Creep Stiffness, Mpa | At Test Temperature | T313 | -18° C |
| | | | 300 max. |
| M-Value | | | 0.300 min. |

3.0 Mix Design Requirements. The mix design shall be in accordance with Sec 403 except as otherwise stated herein. The mix design shall be 65 gyrations with air voids in the range of 1 to 1.5 percent. Use a minimum total asphalt binder content in accordance with Table 2.

Table 2. Minimum Total Asphalt Binder Content

| Minimum Asphalt Binder Content | |
|---|-----------------------------------|
| Combined Aggregate Bulk Specific Gravity Gsb | Minimum Asphalt Binder Content %* |
| 2.375 - 2.424 | 6.8 |
| 2.425 - 2.474 | 6.7 |
| 2.475 - 2.524 | 6.6 |
| 2.525 - 2.574 | 6.5 |
| 2.575 - 2.624 | 6.3 |
| 2.625 - 2.674 | 6.2 |
| 2.675 - 2.724 | 6.1 |
| > 2.724 | 6.0 |

* Percent of total mix.

3.3 Binder Replacement. A maximum of 15 percent virgin binder replacement may be used in the mixture. Recycled asphalt shingles are prohibited.

3.4 Aggregate. Virgin material containing river gravel or natural sands shall not be used in the mixture.

3.5 Performance Testing for Mix Design. Acceptable test results meeting the performance requirements for CTindex and Hamburg Wheel Track (HWT) shall be submitted with the mix design for approval. RTIndex test results shall be submitted with the mix design as informational only. All performance test specimens shall be compacted to an air content of 4.0 ± 0.5 percent.

3.5.1 Hamburg Wheel Track (HWT) Testing. HWT testing will be completed in accordance with AASHTO T324 at a test temperature of 50 ± 1 C and 2.44-inch specimen height. The maximum rut depth shall be 7.0 mm after 20,000 passes.

3.5.2 Rutting Tolerance Index (RTIndex) Testing. The RTIndex testing shall be completed in accordance with ASTM D8360 and at a test temperature of 50 ± 1 C, and shall be provided for information only.

3.5.3 Cracking Tolerance Index (CTIndex) Testing. The CTIndex testing shall be completed in accordance with ASTM D8225 and at a test temperature of 25 ± 0.5 C. The minimum CTIndex shall be 135.

4.0 Construction Requirements. Construction requirements shall be in accordance with Sec 403 except as otherwise stated herein.

4.1 Density. The target in-place density of the mat shall be 96.5 ± 2.5 percent of Theoretical Maximum Specific Gravity. The target for in-place longitudinal joints is 94.0 percent of Theoretical Maximum Specific Gravity.

4.2 Voids in Mineral Aggregate (VMA). The VMA shall be within -0.5 and +2.0 percent of the approved mix design at N_{des} gyrations

4.3 Air Voids. Air voids shall be within 0.5 to 2.5 percent at N_{des} gyrations.

4.4 Hamburg Wheel Track (HWT). HWT testing will be completed in accordance with AASHTO T324 at test temperature of 50 ± 1 C and 2.44-inch specimen height. HWT test specimens shall be compacted to an air content of 4.0 ± 0.5 percent. The maximum rut depth shall be 9.5 mm after 20,000 passes. HWT shall be sampled once at one every 10,000 tons.

4.5 Informational Performance Testing. The CTIndex testing shall be completed in accordance with ASTM D8225, at a test temperature of 25 ± 0.5 C. The RTIndex testing shall be completed in accordance with ASTM D8360, at a test temperature of 50 ± 1 C. CTIndex and RTIndex Test specimens shall be compacted to an air content of 4.0 ± 0.5 percent. This testing shall be completed every 10,000 tons for informational purposes only.

5.0 Thick Lift Paving. Any smoothness corrections to the surface course of the pavement shall be by diamond grinding only. Micro-milling, as approved by the engineer, will only be allowable on base courses. Coldmilling of any course of new pavement to correct smoothness shall not be allowed.

5.1 Micro-Milling. Equipment for Micro-milling shall be in accordance with [Sec 622.10.2](#); except as modified herein.

- (a) The milling operation shall establish profile grades along each edge of the machine within 1/8-inch.
- (b) The maximum spacing between the cutting bits on the mill drum shall be 5/16-inch.
- (c) The accuracy on depth of milling shall be within 1.6 mm or less.
- (d) The maximum Ridge-To-Valley Depth (RTD) shall be 3.2 mm.
- (e) The maximum milling speed shall be 20 feet per minute.

6.0 Removal of Material. All lots of material with a PFT less than 50.0 shall be removed and replaced with acceptable material by the contractor. Any subplot of material with a percent of theoretical maximum density of less than 93.0 percent or greater than 99.5 percent shall be removed and replaced with acceptable material by the contractor. Any subplot of material with air voids in the compacted specimens less than 0.5 percent shall be evaluated with Hamburg testing and removed and replaced with acceptable material by the contractor if the rut depth is greater than 9.5 mm at 20,000 passes. No additional payment will be made for such removal and replacement. The replaced material will be tested at the frequencies listed in [Sec 403.19](#). Pay for

the material will be determined in accordance with the applicable portions of [Sec 403.23](#) based on the replacement material.

7.0 Small Quantities. Small quantities are defined in [Sec 403.19.3.2.1](#). Unless the contractor has elected to use the normal evaluation in the Bituminous QC Plan for small quantities, the following shall apply for each separate mixture qualifying as a small quantity:

(a) QLA and PWL shall not apply.
(b) Mixtures shall be within the specified limits for VMA, Va, AC and density. In addition to any adjustments in pay due to profile, the contract unit price for the mixture represented by each set of cores will be adjusted based on actual field density above or below the specified density using the following schedule:

| Field Density (Percent of Laboratory Max. Theoretical Density) | Pay Factor (Percent of Contract Unit Price) |
|---|--|
| For all SP mixtures other than SMA: | |
| 93.5 to 99.5 inclusive | 100 |
| 93.0 to 93.4 | 10% Deduction |
| Above 99.5 or Below 93.0 | Remove and Replace |

8.0 Method of Measurement. HiMod Asphalt Mixture shall be measured to the nearest 0.1 ton.

9.0 Basis of Payment. Payment for HiMod Asphalt Mixture will be made at the contract unit price for 403-00.06, Asphaltic Concrete Mixture PG 76-22 (SP095B Mix).

EE. Additional Research JSP-25-06

1.0 Description. This contract requires additional research work that shall be completed in accordance with this special provision. The additional research work along with the associated fixed cost bid item is described herein. The contractor shall be responsible for performing all tasks identified in Section 2.0.

2.0 Research Workplan. This research workplan includes the contractor sampling, fabricating, handling, and shipping asphalt specimens at the asphalt plant during production to be used for the Asphalt Mixture Performance Tester (AMPT) research. It is imperative that the contractor follows all protocols since AMPT test data will be used to determine future design thicknesses and performance of asphalt pavements. In addition, the asphalt plant shall be operating at the production capacity to minimize silo storage time and obtain a representative asphalt sample. The AASHTO specifications and protocols used for this research are listed as follows:

- AASHTO PP 99 – Preparation of Small Cylindrical Performance Test Specimens Using the SuperPave Gyratory Compactor (SCG) or Field Cores
- AASTHO T 312 – Preparing and Determining the Density of Asphalt Mixture Specimens by Means of the SuperPave Gyratory Compactor
- AASTHO T 166 – Bulk Specific Gravity (Gmb) of Compacted Asphalt Mixtures Using Saturated Surface Dry Specimens

- AASHTO T 331 – Bulk Specific Gravity (Gmb) and Density of Compacted Asphalt Mixtures using Automatic Vacuum Sealing Method
- AASHTO T 209 – Theoretical Maximum Specific Gravity (Gmm) and Density of Asphalt Mixtures
- AASHTO T 269 – Percent Air Voids in Compacted Dense and Open Asphalt Mixtures
- AASHTO R 97 – Sampling Asphalt Mixtures
- AASHTO R 47 – Reducing Samples of Asphalt Mixtures to Testing Size

The contractor is responsible for fabricating three (3) 150-mm diameter by 180-mm tall SGC AMPT specimens, verifying and recording the air voids of these specimens, and shipping the specimens to the location provided by the engineer. Additional SGC specimens will be fabricated to establish acceptable air void parameters. Acceptable air voids shall be determined by coring out smaller (100-mm diameter by 150-mm diameter) specimens out of the SGC specimens that meets the target air void content for AMPT testing. Once the smaller sized specimens meet the required air voids then the specimen heights of the larger SGC specimens can be fabricated accordingly.

The contractor shall follow AASHTO PP 99-3, Sections 9.1 – 9.3 of Procedure A (Fabrication from SGC Specimens), for making the SGC specimens. These tasks are summarized as follows:

1. Prepare asphalt mixture for the 150-mm diameter by 180-mm tall SGC specimens in accordance with AASHTO 312 and prepare a companion mixture sample for determining the Theoretical Maximum Specific Gravity (Gmm) in accordance with AASHTO T 209.
2. The mass of the asphalt mixture needed for each SGC specimen will be determined by Appendix X2 in AASTO PP 99-3 where a 100-mm diameter by 150-mm diameter specimen is cored and sawn from the center of the larger SGC specimen. The air voids of the smaller specimen shall be 7.0 ± 0.5 percent for dense graded asphalt, 6.0 ± 0.5 percent for SMA mixtures, or 3.0 ± 0.5 percent for HiMod asphalt mixtures. Once the air voids of the small test specimens are within the correct tolerance, the mass of the SGC specimens shall be recorded so that the SGC test specimens can then be replicated.
3. After sampling of all loose mix material, splitting and breakdown, condition the material at the molding temperature for a minimum of 30 minutes before fabricating SGC specimens. The loose mix shall be at molding/compaction temperature prior to specimen fabrication.
4. Compact the SGC specimens to a height of 180 mm (minimum) in accordance with AASHTO T 312, carefully following Sections 9.2.2 through 9.2.4 of AASHTO PP 99-3 as summarized below. Once the target mass of the SGC specimens has been established in Step 2, the SGC heights shall not vary by more than +1 mm (must be 180 mm or greater) of the target height without reevaluating the air voids within the smaller test specimens.
 - a. A mixture transfer funnel centered over the specimen mold shall be required for pouring the mixture into the specimen mold. (See AASHTO PP-99, Note 5, for acceptable transfer funnels).
 - b. Pour the mixture into the center of the mixture transfer funnel to minimize air void variation between test specimens.

- c. Charge the mold in two equal lifts. After each lift, use the spatula to scrape the walls of the mold, inserting the spatula 8-10 times around the circumference of the mold. Insert the spatula into the center of the mixture 10-12 times in an evenly distributed pattern. Insert the spatula as far as possible into the mixture without damaging aggregates.
- d. Allow the compacted SGC specimen to cool before extracting out of the mold to minimize any deformation of the specimen.
- e. Compaction temperature, times in and out of the oven, gyratory specimen weight and sample identification shall be recorded.

5. Determine and record the Gmb of the SGC specimen in accordance with AASHTO T 166.
6. Determine and record the Gmm of the asphalt mixture in accordance with AASHTO T 209.
7. Compute the air void content of SGC specimen in accordance with AASHTO T 269 and record percent air void content for each specimen. This percent air void content should be higher compared to the acceptable air void content of the smaller specimens established in Step 2.
8. Research tasks are complete when three (3) 150 mm x 180 mm (minimum) SGC specimens are fabricated with acceptable air voids established in Step 2.
9. Specimen Storage Instructions – After fabrication, the SGC specimen shall be stored in a refrigerator between 34 F and 40 F, until shipping. The samples shall be shipped within 3 days of fabrication.
10. Specimen Shipping Instructions - The SGC specimens shall be packaged in 6" x 12" cylinder molds with wrapping/filler as needed. The cylinder molds shall be shipped in a cooler with dry ice or other cooling agents to the address provided by the engineer. Expedited shipping methods shall be used.
11. The template attached to this JSP shall be completely filled out along with all raw data and calculations.

3.0 Basis of Payment. The accepted lump sum quantity of SGC specimens will be paid for at the fixed unit price for the pay item number found below. Failure to produce the research work items in the workplan or an invalid AMPT sample will result in a contract deduction equal to that of the fixed unit cost.

| Pay Item | Unit | Fixed Unit Cost |
|------------------------------|----------|-----------------|
| 401-03.01 – Asphalt Research | Lump Sum | \$ 6,500 |

Job No.: J913838
 Route: I-55
 County: Cape Girardeau/Scott

| Data Template for Additional Research | | | |
|---|-----------------|---|---------------|
| Date of Fabrication | | Asphalt Plant | |
| Contract ID | | Contractor | |
| Job Number | | Contact Name | |
| Mix ID | | Phone Number | |
| Plant Mixing Temp. | | Email Address | |
| Target Compaction Temp. | | | |
| Sampling and Splitting of Asphalt Loose Mix | | | |
| Ensure plant is running at production rate to minimize silo storage time | | | |
| Proper sampling protocols in accordance with AASHTO R 97 and R 47 to minimize segregation | | | |
| Mix Temperature | | Air Voids for Specific Mix Types | |
| Gmm (AASHTO T 209) | | SuperPave | 7.0 +/- 0.5 % |
| Mix Type | | SMA | 6.0 +/- 0.5 % |
| | | Hi-Mod | 3.0 +/- 0.5 % |
| Air Void Validation (Repeat as necessary - Cored/Sawn Specimen meets air voids per mix type) | | | |
| Trial Specimens | SGC Specimens | Cored/Sawn Specimen | |
| Dimensions | 150-mm x 180-mm | 100-mm x 150-mm | |
| Trial Weights | | | |
| Gmb (AASTHTO T 166) | | | |
| Air Void % | | (Shall meet air void range) | |
| Absorption % check* | | | |
| * Note: Absorptions greater than 2.0% shall be tested in accordance with AASHTO T 331) | | | |
| (Repeat Trials as necessary until air voids meet criteria per mix type) | | | |
| Final Specimen Fabrication (3 - 150-mm x 180 mm SCG specimens) | | | |
| Final Specimens | SCG 1 | SCG 2 | SCG 3 |
| Oven Set Temperature | | | |
| Time In Oven | | | |
| Time Out of Oven | | | |
| Total Oven Time (minutes) | | | |
| Mix Temp prior to Compaction | | | |
| # of Gyration | | | |
| Final Weight | | | |
| Final Height (>180 mm) | | | |
| Gmb (AASTHTO T 166/T331) | | | |
| Air Voids % | | | |
| Absorption % check | | | |