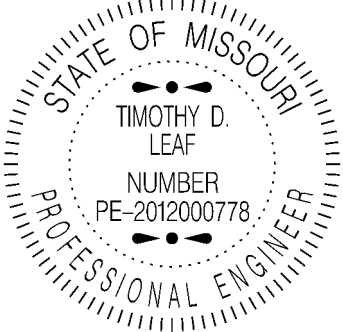


TABLE OF CONTENTS

- A. Construction Requirements
- B. Rapid Set Concrete Patching Material – Horizontal Repairs
- C. Rapid Set Concrete Patching Material – Vertical And Overhead Repairs

 07/23/2026 7:28:25 AM TIMOTHY D. LEAF - CIVIL MO-PE-2012000778	MISSOURI HIGHWAYS AND TRANSPORTATION COMMISSION 105 W. CAPITOL AVE. JEFFERSON CITY, MO 65101 Phone (888) 275-6636
	If a seal is present on this sheet, JSP's has been electronically sealed and dated.
	JOB NO. JCD0229 Moniteau County, MO Date Prepared: 7/6/2026
Only the following items of the Job Special Provisions (Bridge) are authenticated by this seal: All	

A. CONSTRUCTION REQUIREMENTS

1.0 Description. This provision contains general construction requirements for this project.

2.0 Construction Requirements. The plans and the asbestos and lead inspection report(s) for the existing structure(s) are included in the contract in the bridge electronic deliverables zip file for informational purposes only.

2.1 In order to assure the least traffic interference, the work shall be scheduled so that the bridge closure is for the absolute minimum amount of time required to complete the work. The bridge shall not be closed until material is available for continuous construction and the contractor is prepared to diligently pursue the work until the closed bridge is opened to traffic.

2.2 Qualified special mortar shall be a qualified rapid set concrete patching material in accordance with [Sec 704](#). A qualified rapid set concrete patching material will not be permitted for half-sole repair, deck repair with void tube replacement, full depth repair, modified deck repair and substructure repair (formed) unless a note on the bridge plans specifies that a qualified special mortar may be used.

2.3 Provisions shall be made to prevent any debris and material from falling into the waterway. If determined necessary by the engineer, any debris and material that falls below the bridge outside the previously specified limits shall be removed as approved by the engineer at the contractor's expense.

2.4 Any damage sustained to the remaining structure as a result of the contractor's operations shall be repaired or the material replaced as approved by the engineer at the contractor's expense.

2.5 Provisions shall be made to prevent damage to any existing utilities. Any damage sustained to the utilities as a result of the contractor's operations shall be the responsibility of the contractor. All costs of repair and disruption of service shall be as determined by the utility owners and as approved by the engineer.

3.0 Coating Information.

3.1 Environmental Contact. Environmental Section may be contacted at the below address or phone number. The Missouri Department of Health may be contacted at (573) 751-6102.

MoDOT - Design Division - Environmental Section
P.O. Box 270
105 W. Capitol Ave., Jefferson City, MO 65102
Telephone: (573) 526-4778

3.2 Approved Smelter and Hazardous Waste Treatment, Storage and Disposal Facility. The following is the approved smelter and hazardous waste treatment, storage and disposal facility:

Doe Run Company - Resource Recycling Division - Buick Facility
Highway KK
Boss, MO 65440
Telephone: (573) 626-4813

4.0 Method of Measurement. No measurement will be made.

5.0 Basis of Payment. Payment for the above described work will be considered completely covered by the contract unit price for other items included in the contract.

B. RAPID SET CONCRETE PATCHING MATERIAL – HORIZONTAL REPAIRS

1.0 Description. This specification covers cementitious concrete, polymer-modified concrete and polymer concrete that are suitable for repairing concrete surfaces on bridges or roadways, particularly under fast setting or special conditions. The repairs would involve horizontal applications. The work shall consist of removing, furnishing, preparing, and placing materials at locations as shown on the plans or as directed by the engineer.

2.0 Material. All materials shall be in accordance with MoDOT specifications and as noted herein.

2.1 Aggregate For Extending Commercial Mixture. Coarse and fine aggregates shall be in accordance with [Sec 1005](#), except the requirements for gradation and percent passing the No. 200 sieve shall not apply. Coarse aggregate meeting Gradation E requirements shall be used for repairs greater than one inch (25 mm) in depth. Fine aggregate will be allowed for repairs less than one inch (25 mm). Aggregate specified, bagged, labeled and furnished by the rapid set concrete patching material manufacturer may also be used for mortar extension.

2.2 Material Applications. The contractor shall select and use the product most suitable for the work and field conditions in accordance with these specifications.

2.3 Curing. Rapid set concrete patching material shall be cured until the minimum compressive strength 3200 psi is attained using standard curing specifications, unless otherwise specified by the manufacturer.

2.4 Qualification and Project Acceptance.

2.4.1 Inspection. All materials shall be subject to inspection and sampling by MoDOT at the source of manufacture, intermediate shipping terminal or destination. MoDOT will be allowed free access to all facilities and records as required to conduct inspection and sampling.

2.4.2 Qualification. Prior to use, rapid set concrete patching material shall be qualified. In order to become qualified, a material shall have completed testing through AASHTO's National Transportation Product Evaluation Program (NTPEP). The manufacturer shall contact the AASHTO/NTPEP coordinator to obtain the testing location for the rapid setting concrete patching material.

2.4.2.1 Requested Information. The manufacturer shall submit with samples of the materials, a written request to Construction and Materials with the following information:

- (a) Brand name of the product.
- (b) Certification that the material meets this specification.
- (c) NTPEP test results showing compliance with this special provision.

- (d) Specific mixing, handling and curing instructions.
- (e) Application type (i.e., bridge or roadway).

2.4.2.2 Qualified List. Upon approval by the engineer, the brand name and manufacturer will be placed on a qualified list of rapid set concrete patching materials. The listing of qualified materials is available from Construction and Materials or on MoDOT's web site. New certified test results and samples shall be submitted any time the manufacturing process or the material formulation is changed. The material will be subject to removal from the qualified list if there is evidence of unsatisfactory performance or a change in manufacturing process or formulation, or when random sampling and testing of material offered for use indicates nonconformity with any of the requirements herein specified.

2.4.3 Provisional Approval. Provisional approval may be granted provided the following requirements have been met:

- (a) New Products Evaluation Form
- (b) Certified test results from an independent laboratory showing compliance with this special provision.
- (c) Documentation prepared by MoDOT covering two years of field performance on MoDOT's system. MoDOT will need to approve the location of the test site. Documentation will contain the placement date, field observations (semi annual), description of field performance and photographs of in-place material.
- (d) During placement the manufacturer's representative shall be present on the project to provide technical expertise.

2.4.3.1 Disqualification. If during the two year observation period the repair area(s) fails provisional approval will not be granted. Repair area(s) experiencing any cracking, debonding or spalling will be considered a failure.

2.4.3.2 Length of Provisional Approval. Provisional approval will be granted for three years or until NTPEP testing is completed.

2.5 Certification. The contractor shall supply a manufacturer's certification to the engineer for each lot of material furnished. The certification shall include the name of the manufacturer, a manufacturer certification statement that the material supplied is the same as that qualified and listing the date of qualification.

2.6 Acceptance. Acceptance of the material will be based on the use of a qualified or provisionally approved material, the manufacturer's certification that the material supplied is the same as that approved and upon the results of such tests as may be performed by the engineer.

3.0 Mixture. Unless otherwise specified, rapid set concrete patching material shall be approved commercial mixtures meeting [Sections 3.1 – 3.1.3](#) or deck repair cementitious mortar meeting [Section 3.2](#). Rapid set concrete patching materials shall be specifically designed for the application needed.

3.1 Commercial Mixtures. Rapid set concrete patching material in its sacked form and mixtures when properly prepared in accordance with the manufacturer's specifications, shall meet the

JOB SPECIAL PROVISIONS (BRIDGE)

minimum test requirements given in Table 1. Mixtures may be supplied, as required, as a patching mortar or as a patching mortar with aggregate extension. If the material is to be supplied with extender aggregate, this shall also pass the required tests in Table 1 using the maximum allowed amount of extender aggregate.

3.1.1 Mixture Requirements. Rapid set concrete patching material shall be single packaged dry mix requiring the addition of water or other liquid component just prior to mixing. The material shall be capable of 1/2 inch (13 mm) to full depth repair and require no bonding agent. The material shall not contain soluble chlorides as an ingredient of manufacture. The material shall be placed in accordance to the manufacturer's recommendations.

Table 1 (English Unit)				
Physical Test Property	Specification	Requirement for cementitious concrete	Requirement for polymer-modified concrete	Requirement for polymer concrete
Bond Strength by Slant Shear ¹	ASTM C 882/C 928 ³	min. 1000 psi @ 24hrs.& min. 1500 psi @ 7 days	n/a	min. 1000 psi @ 24hrs.& min. 1500 psi @ 7 days
Linear Coefficient of Thermal Expansion ^{1, 2} (for bagged mortar only, without extension aggregate)	ASTM C 531	n/a	n/a	4 – 8 X 10-6 in/in/deg F
Resistance to Rapid Freezing & Thawing ¹	AASHTO T 161 or ASTM C 666	80% min. using Procedure B ⁵ (300 Cycles)	80% min. using Procedure B ⁵ (300 Cycles)	n/a
Compressive Strength ¹	AASHTO T 22 or ASTM C 39	3200 psi @ 3 hr & 4000 psi @ 7 days	3200 psi @ 3 hr & 4000 psi @ 7 days	n/a
Rapid Chloride Permeability ¹	AASHTO T 277 or ASTM C 1202	<u>Bridge Decks</u> 1000 coulombs @ 28 days <u>Roadway</u> 2000 coulombs @ 28 days	<u>Bridge Deck</u> 1000 coulombs @ 28 days <u>Roadway</u> 2000 coulombs @ 28 days	<u>Bridge Deck</u> 1000 coulombs @ 28 days <u>Roadway</u> 2000 coulombs @ 28 days
Length Change ^{1, 4}	AASHTO T 160 or ASTM C 157	In water Storage (+0.15) In air storage (-0.15)	In water storage (+0.15) In air storage (-0.15)	n/a
Color		gray	gray	gray

JOB SPECIAL PROVISIONS (BRIDGE)

¹ The commercial mix test values can be located in the AASHTO's National Transportation Product Evaluation Program (NTPEP) reports for Laboratory Evaluations of Rapid Set Concrete Patching Materials. Data for provisionally approved materials is located at the Construction and Materials Division.

² Not required for extended mixtures if the mortar passes this requirement.

³ ASTM C 882 shall be performed on non-water based materials. ASTM C 928 shall be performed on water-based materials.

⁴ As modified by ASTM C 928.

⁵ Procedure A may be used in lieu of Procedure B.

3.1.2 Construction Requirements. The manufacturer shall provide with the bagged mixture, specifications for the mixing procedure, amount and kind of liquid to be added, and the amount of aggregate extension allowed, if any. All mixing, handling and curing practices recommended by the manufacturer shall be followed and will be considered a part of these specifications.

3.1.3 Removal from Qualified List. All mixtures shall be approved before use. Reoccurring failures of any mixture for any reason will be cause for removal from the qualified list.

3.2 Deck Repair Concrete. A qualified rapid set concrete patching material indicated for horizontal use and intended for patching concrete bridge decks may be used when specified on the plans and as approved by the engineer. If this option is selected, the contractor shall provide a trial mix to determine the total cure time needed to achieve a compressive strength of 3200 psi (22 MPa). Compressive specimens shall be prepared in accordance with current MoDOT test methods and cured to simulate actual field conditions. Testing of compressive specimens shall be performed by methods and at facilities acceptable to the engineer. The repaired deck shall not be opened to traffic until at least 4 hours after the last placement of deck repair concrete, the established cure time has elapsed and until such concrete has achieved a compressive strength of 3200 psi (22 MPa). A new trial mix may be required if the engineer determines the field conditions vary substantially from trial mix conditions. The engineer will make field cylinders to verify the 3200 psi (22 MPa) minimum strength.

4.0 Construction Requirements.

4.1 Mixing. Rapid set concrete patching material shall be mixed and finished according to the manufacturer's recommendation.

4.2 Preparation of Repair Area. Deteriorated, damaged or defective concrete as shown on the plans, required by the specifications or as directed by the engineer, shall be removed. All exposed reinforcement shall be thoroughly cleaned as shown on the plans, required by the specifications or as directed by the engineer. Unless otherwise specified by the commercial mixture manufacturer, the existing surface shall be damp and all free water shall be removed prior to placement of the required material.

4.3 Bonding Agent. A bonding agent may be used if recommended by the rapid set concrete patching material manufacturer.

5.0 Method of Measurement. No measurement will be made for rapid set concrete patching material.

6.0 Basis of Payment. Rapid set concrete patching material will be paid for at the contract unit price for other items and will be considered full compensation for all labor, equipment and material to complete the described work.

C. RAPID SET CONCRETE PATCHING MATERIAL – VERTICAL AND OVERHEAD REPAIRS

1.0 Description. This specification covers cementitious concrete, polymer-modified concrete and polymer concrete that are suitable for repairing concrete surfaces on bridges or concrete structures, particularly under fast setting or special conditions. The repairs would involve vertical or overhead applications. The work shall consist of removing, furnishing, preparing, and placing materials at locations as shown on the plans or as directed by the engineer.

2.0 Material. All materials shall be in accordance with MoDOT specifications and as noted herein.

2.1 Aggregate. For Extending Commercial Mixture. Coarse and fine aggregates shall be in accordance with [Sec 1005](#), except the requirements for gradation and percent passing the No. 200 sieve shall not apply. Coarse aggregate meeting Gradation E requirements shall be used for repairs greater than one inch (25 mm) in depth. Fine aggregate will be allowed for repairs less than one inch (25 mm). Aggregate specified, bagged, labeled and furnished by the rapid set concrete patching material manufacturer may also be used for mortar extension.

2.2 Material Applications. The contractor shall select and use the product most suitable for the work and field conditions in accordance with these specifications.

2.3 Curing. Rapid set concrete patching material shall be cured until the minimum compressive strength 1500 psi is attained using standard curing specifications, unless otherwise specified by the manufacturer.

2.4 Qualification and Project Acceptance.

2.4.1 Inspection. All materials shall be subject to inspection and sampling by MoDOT at the source of manufacture, intermediate shipping terminal or destination. MoDOT will be allowed free access to all facilities and records as required to conduct inspection and sampling.

2.4.2 Qualification. Prior to use, rapid set concrete patching materials need to be qualified.

2.4.2.1 Requested Information. The manufacturer shall submit with samples of the materials, a written request to Construction and Materials with the following information:

- (a) New Products Evaluation Form
- (b) Brand name of the product.
- (c) Certification that the material meets this specification.
- (d) Certified test results from an independent laboratory showing compliance with this specification.
- (e) Specific preparation instructions of repair area.
- (f) Specific mixing, handling and curing instructions.
- (g) Application type (i.e., vertical or overhead).

2.4.2.2 Field Evaluation. Final approval will be granted when the following requirements are met:

- (a) MoDOT report documenting two years of field performance on MoDOT system. The report will contain the placement date, field observations (semi annual), description of field performance and photographs of in-place material.
- (b) A manufacturer's representative shall be present during placement of the material to provide technical expertise.

2.4.2.3 Disqualification. If during the two year observation period the repair area(s) fails the product will not be added to the qualified list.

2.5 Qualified List. The listing of qualified products are available from Construction and Materials or on MoDOT's web site. New certified test results and samples shall be submitted any time the manufacturing process or the material formulation is changed. The material will be subject to removal from the qualified list if there is evidence of unsatisfactory performance or a change in manufacturing process or formulation, or when random sampling and testing of material offered for use indicates nonconformity with any of the requirements herein specified.

2.6 Certification. The contractor shall supply a manufacturer's certification to the engineer for each lot of material furnished. The certification shall include the name of the manufacturer, a manufacturer certification statement that the material supplied is the same as that qualified and listing the date of qualification.

2.7 Acceptance. Acceptance of the material will be based on the use of a qualified product, the manufacturer's certification that the material supplied is the same as that approved and upon the results of such tests as may be performed by the engineer.

3.0 Mixture. Unless otherwise specified, rapid set concrete patching material shall be approved commercial mixtures meeting [Sections 3.1 – 3.1.3](#). Rapid set concrete patching materials shall be specifically designed for the application needed.

3.1 Commercial Mixtures. Rapid set concrete patching material in its sacked form and mixtures when properly prepared in accordance with the manufacturer's specifications, shall meet the minimum test requirements given in Table 1. Mixtures may be supplied, as required, as a patching mortar or as a patching mortar with aggregate extension. If the material is to be supplied with extender aggregate, this shall also pass the required tests in Table 1 using the maximum allowed amount of extender aggregate.

3.1.2 Mixture Requirements. Rapid set concrete patching material shall be single packaged dry mix requiring the addition of water or other liquid component just prior to mixing. The material shall not contain soluble chlorides as an ingredient of manufacture. The material shall be placed in accordance to the manufacturer's recommendations.

Table 1 (English Unit)				
Physical Test Property	Specification	Requirement for cementitious concrete	Requirement for polymer-modified concrete	Requirement for polymer concrete
Bond Strength by Slant Shear	ASTM C 882/C 928 ²	min. 1000 psi @ 24hrs. & min. 1500 psi @ 7 days	n/a	min. 1000 psi @ 24hrs. & min. 1500 psi @ 7 days
Linear Coefficient of Thermal Expansion ¹ (for bagged mortar only, without extension aggregate)	ASTM C 531	n/a	n/a	4 – 8 X 10 ⁻⁶ in/in/deg F
Resistance to Rapid Freezing & Thawing	AASHTO T 161 or ASTM C 666	80% min. using Procedure B ³ (300 Cycles)	80% min. using Procedure B ³ (300 Cycles)	n/a
Compressive Strength	AASHTO T 22 or ASTM C 39	1500 psi @ 3 hr & 3000 psi @ 24 hr	1500 psi @ 3 hr & 3000 psi @ 24 hr	n/a
Rapid Chloride Permeability	AASHTO T 277 or ASTM C 1202	1000 coulombs @ 28 days	1000 coulombs @ 28 days	1000 coulombs @ 28 days
Length Change	AASHTO T 160 or ASTM C 157	In water Storage (+0.15) In air storage (-0.15)	In water storage (+0.15) In air storage (-0.15)	n/a
Color		gray	gray	gray

¹ Not required for extended mixtures if the mortar passes this requirement.

² ASTM C 882 shall be performed on non-water based materials. ASTM C 928 shall be performed on water-based materials.

³ Procedure A may be used in lieu of Procedure B.

3.1.2 Construction Requirements. The manufacturer shall provide with the bagged mixture, specifications for the mixing procedure, amount and kind of liquid to be added, and the amount of aggregate extension allowed, if any. All mixing, handling and curing practices recommended by the manufacturer shall be followed and will be considered a part of these specifications.

3.1.3 Removal from Qualified List. All mixtures shall be approved before use. Reoccurring failures of any mixture for any reason will be cause for removal from the qualified list.

3.2 Vertical Repair. A qualified rapid set concrete patching material approved for vertical use may be used when specified on the plans and as approved by the engineer. The engineer will make field cylinders to verify the 1500 psi (10 MPa) minimum strength. The material shall adhere to the concrete surface without sagging.

3.3 Overhead Repair. A qualified rapid set concrete patching material approved for overhead use may be used when specified on the plans and as approved by the engineer. The material

shall be placeable in layers of at least 1 inch on overhead applications without the use of formwork or anchoring devices. The material shall adhere to the concrete surface without sagging. The engineer will make field cylinders to verify the 1500 psi (10 MPa) minimum strength.

4.0 Construction Requirements.

4.1 Mixing. Rapid set concrete patching material shall be mixed and finished according to the manufacturer's recommendation.

4.2 Preparation of Repair Area. Deteriorated, damaged or defective concrete as shown on the plans, required by the specifications or as directed by the engineer, shall be removed. All exposed reinforcement shall be thoroughly cleaned as shown on the plans, required by the specifications or as directed by the engineer. Unless otherwise specified by the commercial mixture manufacturer, the existing surface shall be damp and all free water shall be removed prior to placement of the required material.


4.3 Bonding Agent. A bonding agent may be used if recommended by the rapid set concrete patching material manufacturer.

5.0 Method of Measurement. No measurement will be made for rapid set concrete patching material.

6.0 Basis of Payment. Rapid set concrete patching material will be paid for at the contract unit price for other items and will be considered full compensation for all labor, equipment and material to complete the described work.

TABLE OF CONTENTS

- A. Construction Requirements.
- B. Rapid Set Concrete Patching Material – Vertical and Overhead Repairs.
- C. Rapid Set Concrete Patching Material – Horizontal Repairs.
- D. Steel Repairs
- E. Rapid Set Concrete

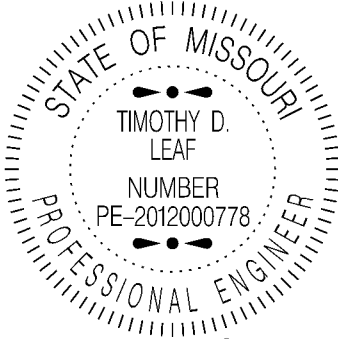 08/05/2026 11:37:01 AM TIMOTHY D. LEAF - CIVIL MO-PE-2012000778	MISSOURI HIGHWAYS AND TRANSPORTATION COMMISSION 105 W. CAPITOL AVE. JEFFERSON CITY, MO 65101 Phone (888) 275-6636
	If a seal is present on this sheet, JSP's has been electronically sealed and dated.
	JOB NO. JCD0302 Moniteau County, MO Date Prepared: 8/5/2026
Only the following items of the Job Special Provisions (Bridge) are authenticated by this seal: All	

JOB SPECIAL PROVISIONS (BRIDGE)

A. CONSTRUCTION REQUIREMENTS

1.0 Description. This provision contains general construction requirements for this project.

2.0 Construction Requirements. The plans and the asbestos and lead inspection report(s) for the existing structure(s) are included in the contract in the bridge electronic deliverables zip file for informational purposes only.

2.1 In order to assure the least traffic interference, the work shall be scheduled so that a lane closure is for the absolute minimum amount of time required to complete the work. A lane shall not be closed until material is available for continuous construction and the contractor is prepared to diligently pursue the work until the closed lane is opened to traffic.

2.2 Bridge work by contractor forces, including erection, rehabilitation or demolition, shall not be allowed over traffic unless a bridge platform protection system is installed below the work area except for work performed above a deck that is intact. The protection system shall be capable of catching all falling objects such as tools, overhang brackets or materials. Lifting of objects that are heavier than the capacity of the bridge protection system shall not be permitted.

2.3 Qualified special mortar shall be a qualified rapid set concrete patching material in accordance with [Sec 704](#). A qualified rapid set concrete patching material will not be permitted for half-sole repair, deck repair with void tube replacement, full depth repair, modified deck repair and substructure repair (formed) unless a note on the bridge plans specifies that a qualified special mortar may be used.

2.4 Provisions shall be made to prevent any debris and material from falling into the waterway. If determined necessary by the engineer, any debris and material that falls below the bridge outside the previously specified limits shall be removed as approved by the engineer at the contractor's expense.

2.5 Any damage sustained to the remaining structure as a result of the contractor's operations shall be repaired or the material replaced as approved by the engineer at the contractor's expense.

2.6 Provisions shall be made to prevent damage to any existing utilities. Any damage sustained to the utilities as a result of the contractor's operations shall be the responsibility of the contractor. All costs of repair and disruption of service shall be as determined by the utility owners and as approved by the engineer.

2.7 The contractor shall provide steel plates over any unprotected open excavation in the bridge deck during non-working hours and in areas where work is not active. The plates shall be 3/4 inch thick. The plates shall extend 12 to 18 inches each side of the opening and cover the full width of work. The contractor shall bevel all edges to a slope no steeper than 3H:1V. The driving surface shall be treated for skid resistance either by surface deformation or direct application of a friction course and delineated as shown in the plans. The plates shall be securely affixed to the deck using concrete anchors or through bolts. The contractor may also secure the plate by attaching it to the superstructure or substructure. However, nothing shall be welded or bolted to these elements. The method of attachment shall be approved by the engineer. Any damage to the deck, superstructure, or substructure as a result of this work shall be repaired as approved by the engineer at the contractor's expense.

JOB SPECIAL PROVISIONS (BRIDGE)

2.8 A washer shall be required under head and nut when any reaming is performed for bolt installation.

2.9 SSPC-SP2 and SSPC-SP3 surface preparation shall be in accordance with the environmental regulations in [Sec 1081](#), and collection of residue shall be in accordance with [Sec 1081](#) for collection of blast residue. SSPC-SP6, SSPC-SP10 and SSPC-SP11 surface preparation shall be in accordance with the approved blast media and environmental regulations in [Sec 1081](#), and collection of blast residue shall be in accordance with [Sec 1081](#).

3.0 Coating Information.

3.1 Straps Removal. Exposed portions of straps for stay-in-place forms shall be removed prior to surface preparation. Straps need not be removed in areas that are not being painted. Flame cutting will not be permitted. The contractor shall exercise care not to damage the existing structure during removal. Any damage sustained to the remaining structure as a result of the contractor's operations shall be repaired or the material replaced as approved by the engineer at the contractor's expense.

3.2 Slab Drains and Stay-In-Place Forms. The stay-in-place forms, slab drains and slab drain brackets shall not be recoated, overcoated or damaged during the painting operation. Any portion of the slab drain bracket that is blast cleaned shall be recoated with System G. Any damage sustained as a result of the contractor's operations shall be repaired or the material replaced as approved by the engineer at the contractor's expense.

3.3 Existing Bridge Information. The informational plans may be used by bidders in determining the amount of steel to be cleaned and recoated or overcoated with the full understanding that the State accepts no responsibility for accuracy of the estimated tons of existing steel shown in the table below. The bidder's acceptance and use of the estimate shown below shall be no cause for claim for any final adjustment in the contract unit price for the work involved in repainting. Each bidder is expected to carefully examine the structure(s), investigate the condition of existing paint and prepare an estimate of quantities involved before submitting a bid. Surface preparation and application of field coatings to the structural steel shall be based on the contract plan quantities. No final measurements will be made.

Bridge No.	Estimated Tons			Existing Paint System	Lead Based?
	Coating System		Total		
	System L Recoat	System L Overcoat			
A1204	117	0	117	S over A	Yes

3.4 Environmental Contact. Environmental Section may be contacted at the below address or phone number. The Missouri Department of Health may be contacted at (573) 751-6102.

MoDOT - Design Division - Environmental Section
P.O. Box 270
105 W. Capitol Ave., Jefferson City, MO 65102
Telephone: (573) 526-4778

3.5 Approved Smelter and Hazardous Waste Treatment, Storage and Disposal Facility. The following is the approved smelter and hazardous waste treatment, storage and disposal facility:

Doe Run Company - Resource Recycling Division - Buick Facility
Highway KK
Boss, MO 65440
Telephone: (573) 626-4813

4.0 Method of Measurement. No measurement will be made.

5.0 Basis of Payment. Payment for the above described work will be considered completely covered by the contract unit price for other items included in the contract.

B. RAPID SET CONCRETE PATCHING MATERIAL – VERTICAL AND OVERHEAD REPAIRS

1.0 Description. This specification covers cementitious concrete, polymer-modified concrete and polymer concrete that are suitable for repairing concrete surfaces on bridges or concrete structures, particularly under fast setting or special conditions. The repairs would involve vertical or overhead applications. The work shall consist of removing, furnishing, preparing, and placing materials at locations as shown on the plans or as directed by the engineer.

2.0 Material. All materials shall be in accordance with MoDOT specifications and as noted herein.

2.1 Aggregate. For Extending Commercial Mixture. Coarse and fine aggregates shall be in accordance with [Sec 1005](#), except the requirements for gradation and percent passing the No. 200 sieve shall not apply. Coarse aggregate meeting Gradation E requirements shall be used for repairs greater than one inch (25 mm) in depth. Fine aggregate will be allowed for repairs less than one inch (25 mm). Aggregate specified, bagged, labeled and furnished by the rapid set concrete patching material manufacturer may also be used for mortar extension.

2.2 Material Applications. The contractor shall select and use the product most suitable for the work and field conditions in accordance with these specifications.

2.3 Curing. Rapid set concrete patching material shall be cured until the minimum compressive strength 1500 psi is attained using standard curing specifications, unless otherwise specified by the manufacturer.

2.4 Qualification and Project Acceptance.

2.4.1 Inspection. All materials shall be subject to inspection and sampling by MoDOT at the source of manufacture, intermediate shipping terminal or destination. MoDOT will be allowed free access to all facilities and records as required to conduct inspection and sampling.

2.4.2 Qualification. Prior to use, rapid set concrete patching materials need to be qualified.

2.4.2.1 Requested Information. The manufacturer shall submit with samples of the materials, a written request to Construction and Materials with the following information:

- (a) New Products Evaluation Form
- (b) Brand name of the product.

- (c) Certification that the material meets this specification.
- (d) Certified test results from an independent laboratory showing compliance with this specification.
- (e) Specific preparation instructions of repair area.
- (f) Specific mixing, handling and curing instructions.
- (g) Application type (i.e., vertical or overhead).

2.4.2.2 Field Evaluation. Final approval will be granted when the following requirements are met:

- (a) MoDOT report documenting two years of field performance on MoDOT system. The report will contain the placement date, field observations (semi annual), description of field performance and photographs of in-place material.
- (b) A manufacturer's representative shall be present during placement of the material to provide technical expertise.

2.4.2.3 Disqualification. If during the two year observation period the repair area(s) fails the product will not be added to the qualified list.

2.5 Qualified List. The listing of qualified products are available from Construction and Materials or on MoDOT's web site. New certified test results and samples shall be submitted any time the manufacturing process or the material formulation is changed. The material will be subject to removal from the qualified list if there is evidence of unsatisfactory performance or a change in manufacturing process or formulation, or when random sampling and testing of material offered for use indicates nonconformity with any of the requirements herein specified.

2.6 Certification. The contractor shall supply a manufacturer's certification to the engineer for each lot of material furnished. The certification shall include the name of the manufacturer, a manufacturer certification statement that the material supplied is the same as that qualified and listing the date of qualification.

2.7 Acceptance. Acceptance of the material will be based on the use of a qualified product, the manufacturer's certification that the material supplied is the same as that approved and upon the results of such tests as may be performed by the engineer.

3.0 Mixture. Unless otherwise specified, rapid set concrete patching material shall be approved commercial mixtures meeting [Sections 3.1 – 3.1.3](#). Rapid set concrete patching materials shall be specifically designed for the application needed.

3.1 Commercial Mixtures. Rapid set concrete patching material in its sacked form and mixtures when properly prepared in accordance with the manufacturer's specifications, shall meet the minimum test requirements given in Table 1. Mixtures may be supplied, as required, as a patching mortar or as a patching mortar with aggregate extension. If the material is to be supplied with extender aggregate, this shall also pass the required tests in Table 1 using the maximum allowed amount of extender aggregate.

3.1.1 Mixture Requirements. Rapid set concrete patching material shall be single packaged dry mix requiring the addition of water or other liquid component just prior to mixing. The material shall not contain soluble chlorides as an ingredient of manufacture. The material shall be placed in accordance to the manufacturer's recommendations.

Table 1 (English Unit)				
Physical Test Property	Specification	Requirement for cementitious concrete	Requirement for polymer-modified concrete	Requirement for polymer concrete
Bond Strength by Slant Shear	ASTM C 882/C 928 ²	min. 1000 psi @ 24hrs. & min. 1500 psi @ 7 days	n/a	min. 1000 psi @ 24hrs. & min. 1500 psi @ 7 days
Linear Coefficient of Thermal Expansion ¹ (for bagged mortar only, without extension aggregate)	ASTM C 531	n/a	n/a	4 – 8 X 10-6 in/in/deg F
Resistance to Rapid Freezing & Thawing	AASHTO T 161 or ASTM C 666	80% min. using Procedure B ³ (300 Cycles)	80% min. using Procedure B ³ (300 Cycles)	n/a
Compressive Strength	AASHTO T 22 or ASTM C 39	1500 psi @ 3 hr & 3000 psi @ 24 hr	1500 psi @ 3 hr & 3000 psi @ 24 hr	n/a
Rapid Chloride Permeability	AASHTO T 277 or ASTM C 1202	1000 coulombs @ 28 days	1000 coulombs @ 28 days	1000 coulombs @ 28 days
Length Change	AASHTO T 160 or ASTM C 157	In water Storage (+0.15) In air storage (-0.15)	In water storage (+0.15) In air storage (-0.15)	n/a
Color		gray	gray	gray

¹ Not required for extended mixtures if the mortar passes this requirement.

² ASTM C 882 shall be performed on non-water based materials. ASTM C 928 shall be performed on water-based materials.

³ Procedure A may be used in lieu of Procedure B.

3.1.2 Construction Requirements. The manufacturer shall provide with the bagged mixture, specifications for the mixing procedure, amount and kind of liquid to be added, and the amount of aggregate extension allowed, if any. All mixing, handling and curing practices recommended by the manufacturer shall be followed and will be considered a part of these specifications.

3.1.3 Removal from Qualified List. All mixtures shall be approved before use. Reoccurring failures of any mixture for any reason will be cause for removal from the qualified list.

3.2 Vertical Repair. A qualified rapid set concrete patching material approved for vertical use may be used when specified on the plans and as approved by the engineer. The engineer will

JOB SPECIAL PROVISIONS (BRIDGE)

make field cylinders to verify the 1500 psi (10 MPa) minimum strength. The material shall adhere to the concrete surface without sagging.

3.3 Overhead Repair. A qualified rapid set concrete patching material approved for overhead use may be used when specified on the plans and as approved by the engineer. The material shall be placeable in layers of at least 1 inch on overhead applications without the use of formwork or anchoring devices. The material shall adhere to the concrete surface without sagging. The engineer will make field cylinders to verify the 1500 psi (10 MPa) minimum strength.

4.0 Construction Requirements.

4.1 Mixing. Rapid set concrete patching material shall be mixed and finished according to the manufacturer's recommendation.

4.2 Preparation of Repair Area. Deteriorated, damaged or defective concrete as shown on the plans, required by the specifications or as directed by the engineer, shall be removed. All exposed reinforcement shall be thoroughly cleaned as shown on the plans, required by the specifications or as directed by the engineer. Unless otherwise specified by the commercial mixture manufacturer, the existing surface shall be damp and all free water shall be removed prior to placement of the required material.

4.3 Bonding Agent. A bonding agent may be used if recommended by the rapid set concrete patching material manufacturer.

5.0 Method of Measurement. No measurement will be made for rapid set concrete patching material.

6.0 Basis of Payment. Rapid set concrete patching material will be paid for at the contract unit price for other items and will be considered full compensation for all labor, equipment and material to complete the described work.

C. RAPID SET CONCRETE PATCHING MATERIAL – HORIZONTAL REPAIRS

1.0 Description. This specification covers cementitious concrete, polymer-modified concrete and polymer concrete that are suitable for repairing concrete surfaces on bridges or roadways, particularly under fast setting or special conditions. The repairs would involve horizontal applications. The work shall consist of removing, furnishing, preparing, and placing materials at locations as shown on the plans or as directed by the engineer.

2.0 Material. All materials shall be in accordance with MoDOT specifications and as noted herein.

2.1 Aggregate For Extending Commercial Mixture. Coarse and fine aggregates shall be in accordance with [Sec 1005](#), except the requirements for gradation and percent passing the No. 200 sieve shall not apply. Coarse aggregate meeting Gradation E requirements shall be used for repairs greater than one inch (25 mm) in depth. Fine aggregate will be allowed for repairs less than one inch (25 mm). Aggregate specified, bagged, labeled and furnished by the rapid set concrete patching material manufacturer may also be used for mortar extension.

2.2 Material Applications. The contractor shall select and use the product most suitable for the work and field conditions in accordance with these specifications.

2.3 Curing. Rapid set concrete patching material shall be cured until the minimum compressive strength 3200 psi is attained using standard curing specifications, unless otherwise specified by the manufacturer.

2.4 Qualification and Project Acceptance.

2.4.1 Inspection. All materials shall be subject to inspection and sampling by MoDOT at the source of manufacture, intermediate shipping terminal or destination. MoDOT will be allowed free access to all facilities and records as required to conduct inspection and sampling.

2.4.2 Qualification. Prior to use, rapid set concrete patching material shall be qualified. In order to become qualified, a material shall have completed testing through AASHTO's National Transportation Product Evaluation Program (NTPEP). The manufacturer shall contact the AASHTO/NTPEP coordinator to obtain the testing location for the rapid setting concrete patching material.

2.4.2.1 Requested Information. The manufacturer shall submit with samples of the materials, a written request to Construction and Materials with the following information:

- (a) Brand name of the product.
- (b) Certification that the material meets this specification.
- (c) NTPEP test results showing compliance with this special provision.
- (d) Specific mixing, handling and curing instructions.
- (e) Application type (i.e., bridge or roadway).

2.4.2.2 Qualified List. Upon approval by the engineer, the brand name and manufacturer will be placed on a qualified list of rapid set concrete patching materials. The listing of qualified materials is available from Construction and Materials or on MoDOT's web site. New certified test results and samples shall be submitted any time the manufacturing process or the material formulation is changed. The material will be subject to removal from the qualified list if there is evidence of unsatisfactory performance or a change in manufacturing process or formulation, or when random sampling and testing of material offered for use indicates nonconformity with any of the requirements herein specified.

2.4.3 Provisional Approval. Provisional approval may be granted provided the following requirements have been met:

- (a) New Products Evaluation Form
- (b) Certified test results from an independent laboratory showing compliance with this special provision.
- (c) Documentation prepared by MoDOT covering two years of field performance on MoDOT's system. MoDOT will need to approve the location of the test site.

Documentation will contain the placement date, field observations (semi annual), description of field performance and photographs of in-place material.

- (d) During placement the manufacturer's representative shall be present on the project to provide technical expertise.

2.4.3.1 Disqualification. If during the two year observation period the repair area(s) fails provisional approval will not be granted. Repair area(s) experiencing any cracking, debonding or spalling will be considered a failure.

2.4.3.2 Length of Provisional Approval. Provisional approval will be granted for three years or until NTPEP testing is completed.

2.5 Certification. The contractor shall supply a manufacturer's certification to the engineer for each lot of material furnished. The certification shall include the name of the manufacturer, a manufacturer certification statement that the material supplied is the same as that qualified and listing the date of qualification.

2.6 Acceptance. Acceptance of the material will be based on the use of a qualified or provisionally approved material, the manufacturer's certification that the material supplied is the same as that approved and upon the results of such tests as may be performed by the engineer.

3.0 Mixture. Unless otherwise specified, rapid set concrete patching material shall be approved commercial mixtures meeting [Sections 3.1 – 3.1.3](#) or deck repair cementitious mortar meeting [Section 3.2](#). Rapid set concrete patching materials shall be specifically designed for the application needed.

3.1 Commercial Mixtures. Rapid set concrete patching material in its sacked form and mixtures when properly prepared in accordance with the manufacturer's specifications, shall meet the minimum test requirements given in Table 1. Mixtures may be supplied, as required, as a patching mortar or as a patching mortar with aggregate extension. If the material is to be supplied with extender aggregate, this shall also pass the required tests in Table 1 using the maximum allowed amount of extender aggregate.

3.1.2 Mixture Requirements. Rapid set concrete patching material shall be single packaged dry mix requiring the addition of water or other liquid component just prior to mixing. The material shall be capable of 1/2 inch (13 mm) to full depth repair and require no bonding agent. The material shall not contain soluble chlorides as an ingredient of manufacture. The material shall be placed in accordance to the manufacturer's recommendations.

Table 1 (English Unit)				
Physical Test Property	Specification	Requirement for cementitious concrete	Requirement for polymer-modified concrete	Requirement for polymer concrete
Bond Strength by Slant Shear ¹	ASTM C 882/C 928 ³	min. 1000 psi @ 24hrs.& min. 1500 psi @ 7 days	n/a	min. 1000 psi @ 24hrs.& min. 1500 psi @ 7 days

JOB SPECIAL PROVISIONS (BRIDGE)

Linear Coefficient of Thermal Expansion ^{1, 2} (for bagged mortar only, without extension aggregate)	ASTM C 531	n/a	n/a	4 – 8 X 10-6 in/in/deg F
Resistance to Rapid Freezing & Thawing ¹	AASHTO T 161 or ASTM C 666	80% min. using Procedure B ⁵ (300 Cycles)	80% min. using Procedure B ⁵ (300 Cycles)	n/a
Compressive Strength ¹	AASHTO T 22 or ASTM C 39	3200 psi @ 3 hr & 4000 psi @ 7 days	3200 psi @ 3 hr & 4000 psi @ 7 days	n/a
Rapid Chloride Permeability ¹	AASHTO T 277 or ASTM C 1202	<u>Bridge Decks</u> 1000 coulombs @ 28 days <u>Roadway</u> 2000 coulombs @ 28 days	<u>Bridge Deck</u> 1000 coulombs @ 28 days <u>Roadway</u> 2000 coulombs @ 28 days	<u>Bridge Deck</u> 1000 coulombs @ 28 days <u>Roadway</u> 2000 coulombs @ 28 days
Length Change ^{1, 4}	AASHTO T 160 or ASTM C 157	In water Storage (+0.15) In air storage (-0.15)	In water storage (+0.15) In air storage (-0.15)	n/a
Color		gray	gray	gray

¹ The commercial mix test values can be located in the AASHTO's National Transportation Product Evaluation Program (NTPEP) reports for Laboratory Evaluations of Rapid Set Concrete Patching Materials. Data for provisionally approved materials is located at the Construction and Materials Division.

² Not required for extended mixtures if the mortar passes this requirement.

³ ASTM C 882 shall be performed on non-water based materials. ASTM C 928 shall be performed on water-based materials.

⁴ As modified by ASTM C 928.

⁵ Procedure A may be used in lieu of Procedure B.

3.1.2 Construction Requirements. The manufacturer shall provide with the bagged mixture, specifications for the mixing procedure, amount and kind of liquid to be added, and the amount of aggregate extension allowed, if any. All mixing, handling and curing practices recommended by the manufacturer shall be followed and will be considered a part of these specifications.

3.1.3 Removal from Qualified List. All mixtures shall be approved before use. Reoccurring failures of any mixture for any reason will be cause for removal from the qualified list.

3.2 Deck Repair Concrete. A qualified rapid set concrete patching material indicated for horizontal use and intended for patching concrete bridge decks may be used when specified on the plans and as approved by the engineer. If this option is selected, the contractor shall provide a trial mix to determine the total cure time needed to achieve a compressive strength of 3200 psi (22 MPa). Compressive specimens shall be prepared in accordance with current MoDOT test methods and cured to simulate actual field conditions. Testing of compressive

JOB SPECIAL PROVISIONS (BRIDGE)

specimens shall be performed by methods and at facilities acceptable to the engineer. The repaired deck shall not be opened to traffic until at least 4 hours after the last placement of deck repair concrete, the established cure time has elapsed and until such concrete has achieved a compressive strength of 3200 psi (22 MPa). A new trial mix may be required if the engineer determines the field conditions vary substantially from trial mix conditions. The engineer will make field cylinders to verify the 3200 psi (22 MPa) minimum strength.

4.0 Construction Requirements.

4.1 Mixing. Rapid set concrete patching material shall be mixed and finished according to the manufacturer's recommendation.

4.2 Preparation of Repair Area. Deteriorated, damaged or defective concrete as shown on the plans, required by the specifications or as directed by the engineer, shall be removed. All exposed reinforcement shall be thoroughly cleaned as shown on the plans, required by the specifications or as directed by the engineer. Unless otherwise specified by the commercial mixture manufacturer, the existing surface shall be damp and all free water shall be removed prior to placement of the required material.

4.3 Bonding Agent. A bonding agent may be used if recommended by the rapid set concrete patching material manufacturer.

5.0 Method of Measurement. No measurement will be made for rapid set concrete patching material.

6.0 Basis of Payment. Rapid set concrete patching material will be paid for at the contract unit price for other items and will be considered full compensation for all labor, equipment and material to complete the described work.

D. STEEL REPAIRS

1.0 Description. This work shall consist of furnishing the necessary materials, labor, and equipment for repairing existing plate girders as shown on the plans. This work shall be in accordance with this job special provision and the bridge plans.

2.0 Materials. No shop drawings will be required.

3.0 Construction Requirements. Structural steel construction shall be in accordance with [Sec 712](#). Before fabrication of new metalwork, the contractor shall make the necessary measurements in the field to verify dimensions of the existing structure where new members are affected. Any deviation of the dimensions shown on the plans shall be called to the engineer's attention. The contractor shall be responsible for developing all required dimensional adjustments and coordinating the implementation of the dimensional adjustments with all involved fabricators and subcontractors. Prior to installation of the new structural steel, the existing steel shall be carefully inspected for irregularities. Any irregularities shall be brought to the attention of the engineer.

3.1 Traffic. These repairs shall be performed in the same stage as the work on the deck above is being performed to ensure that traffic is shifted away from the repair area. A reduced speed limit as shown in the traffic control plans shall be applied during the welding process to reduce impact vibrations.

3.2 Supporting Existing Members. When the plans require supporting the existing steel framing, the following shall be required.

(a) The safe load per member indicated on the plans for the temporary supports does not include a factor of safety. The contractor shall provide an adequate factor of safety when selecting the temporary support members.

(b) Method of temporarily supporting the structure for the web notch repair shall be the responsibility of the Contractor. All welding shall be completed prior to removing the temporary supports.

3.3 Contact Surfaces. The surface of the existing steel that will come in contact with the new steel plates shall be cleaned to a SSPC-SP2 degree of cleanliness. The surfaces of new steel shall be cleaned to SSPC-SP6 degree of cleanliness. The existing and new plates contact surfaces shall be coated with one coat of gray epoxy-mastic primer (non-aluminum) in accordance with [Sec 1081](#).

3.4 Welding Requirements. The areas to be welded shall be cleaned to an SSPC-SP11 degree of cleanliness. A MoDOT certified welder shall perform all welding. E7018 welding electrode or self shielded welding process from the MoDOT approved electrode list shall be used.

3.5 System L (Gray). The new installed steel, any surrounding touch up areas and any existing paint damaged by the repair work shall be cleaned and coated with one coat of gray epoxy-mastic primer (non-aluminum) in accordance with [Sec 1081](#). The new steel shall be recoated with System L in accordance with [Sec 1081](#) when recoating the existing structural steel as noted on the plans.

4.0 Method of Measurement. Measurement for the Steel Repair will be made per each.

5.0 Basis of Payment. Payment for the above described work, including all material, equipment, labor and any other incidental work necessary to complete these items, will be considered completely covered by the contract unit prices for "Steel Repair".

E. **RAPID SET CONCRETE**

1.0 Description. This specification covers the requirements of rapid strength concrete that is suitable for full depth bridge deck repairs and vertical construction. The work shall be in accordance with Sec 613.10 and Sec 703, unless otherwise specified with this special provision.

2.0 Materials. All materials shall be in accordance with MoDOT specifications and as noted herein.

2.1 Aggregate For Extending Commercial Mixture. Coarse and fine aggregates shall be in accordance with Sec 1005, except the requirements for gradation and percent passing the No. 200 sieve shall not apply. Coarse aggregate meeting Gradation E requirements shall be used for repairs greater than one inch (25 mm) in depth. Fine aggregate will be allowed for repairs less than one inch (25 mm). Aggregate specified, bagged, labeled and furnished by the rapid setting concrete material manufacturer may also be used for mortar extension.

JOB SPECIAL PROVISIONS (BRIDGE)

2.2 Cement. The cement shall meet the requirements of ASTM C1600 for Type VRH or Type URH. Type III cement and soluble chloride accelerators are not allowed.

2.3 Admixtures. The use of chemical admixtures is allowed and shall be in accordance with AASHTO M 194.

2.4 Material Applications. The contractor shall select and use the product most suitable for the work and field conditions in accordance with these specifications.

2.5 Qualification and Project Acceptance.

2.5.1 General Inspection. All materials shall be subject to inspection and sampling by MoDOT at the source of manufacture, intermediate shipping terminal or destination. MoDOT will be allowed free access to all facilities and records as required to conduct inspection and sampling.

2.5.2 Qualification. Prior to use, rapid set concrete materials need to be qualified.

2.5.2.1 Requested Information. The manufacturer shall submit with samples of the materials, a written request to Construction and Materials with the following information:

- (a) New Products Evaluation Form
- (b) Brand name of the product.
- (c) Certification that the material meets this specification.
- (d) Certified test results from an independent laboratory showing compliance with this specification.
- (e) Specific preparation instructions of repair area.
- (f) Specific mixing, handling and curing instructions.
- (g) Application type (i.e., pavement, vertical)

2.5.2.2 Field Evaluation. Final approval will be granted when the following requirements are met:

- (a) MoDOT report documenting two years of field performance on MoDOT system. The report will contain the placement date, field observations (semi-annual), description of field performance and photographs of in-place material.
- (b) A manufacturer's representative shall be present during placement of the material to provide technical expertise.

2.5.2.3 Disqualification. If during the two year observation period the repair area(s) fails the product will not be added to the qualified list.

2.6 Qualified List. The listing of qualified products are available from Construction and Materials or on MoDOT's web site. New certified test results and samples shall be submitted any time the manufacturing process or the material formulation is changed. The material will be subject to removal from the qualified list if there is evidence of unsatisfactory performance or a change in manufacturing process or formulation, or when random sampling and testing of material offered for use indicates nonconformity with any of the requirements herein specified.

2.7 Acceptance. Acceptance of the material will be based on the use of a qualified product, the manufacturer's certification that the material supplied is the same as that approved and upon the results of such tests as may be performed by the engineer.

JOB SPECIAL PROVISIONS (BRIDGE)

3.0 Mixture. Unless otherwise specified, rapid setting concrete shall be approved commercial mixtures meeting Sections 3.1-3.5. Rapid setting concrete materials shall be specifically designed for the application needed.

3.1 Commercial Mixtures. Rapid setting concrete material in its sacked form and mixtures when properly prepared in accordance with the manufacturer's specifications, shall meet the minimum test requirements given in Section 3.3 and Table 1. Mixtures may be supplied, as required, as a patching mortar or as a patching mortar with aggregate extension. If the material is to be supplied with extender aggregate, this shall also pass the required tests in Section 3.3 and Table 1 using the maximum allowed amount of extender aggregate.

3.2 Mixture Requirements. Rapid setting concrete material shall be single packaged dry mix requiring the addition of water or other liquid component just prior to mixing. The material shall not contain soluble chlorides as an ingredient of manufacture. The material shall be placed in accordance with the manufacturer's recommendations.

3.3 Mix Design Requirements. The concrete mix design shall meet a minimum compressive strength of 4000 psi within 4-hours; while maintaining initial workability to effectively place the concrete and meet the requirements of this specification.

The concrete mix design shall not exceed 700 lb/yd³ of cement.

The concrete mix design shall not exceed 0.04% shrinkage at 28 days in accordance with ASTM C 157 with the following modifications.

1. The demold time shall be determined by ASTM C 403 Final Set plus 25% of that time.
2. Initial measurement shall be taken immediately after demolding.
3. The shrinkage specimens shall be air cured until 28 days.

In addition to the mix design information required in Sec 501.3; the contractor shall submit ASTM C 666 – Standard Test Method for Resistance of Concrete to Rapid Freezing and Thawing test results from an independent laboratory with a concrete mixture containing similar cement type and amount in comparison to the approved mix design. For acceptance, the concrete mixture tested shall meet a minimum durability factor of 80 percent.

Table 1 (English Unit)				
Physical Test Property	Specification	Requirement for cementitious concrete	Requirement for polymer-modified concrete	Requirement for polymer concrete
Bond Strength by Slant Shear	ASTM C882/C928 ²	min. 1500 psi @ 4 hours	n/a	min. 1500 psi @ 4 hours
Linear Coefficient of Thermal Expansion ¹ (for bagged mortar only, without extension aggregate)	ASTM C531	n/a	n/a	4 – 8 X 10 ⁻⁶ in/in/deg F
Rapid Chloride Permeability	AASHTO T277 or ASTM C1202	1000 coulombs @ 28 days	1000 coulombs @ 28 days	1000 coulombs @ 28 days
Color		gray	gray	gray

¹ Not required for extended mixtures if the mortar passes this requirement.

² ASTM C882 shall be performed on non-water based materials. ASTM C928 shall be performed on water-based materials.

3.4 Construction Requirements. The manufacturer shall provide with the bagged mixture, specifications for the mixing procedure, amount and kind of liquid to be added, and the amount of aggregate extension allowed, if any. All mixing, handling and curing practices recommended by the manufacturer shall be followed and will be considered a part of these specifications.

3.5 Removal from Qualified List. All mixtures shall be approved before use. Reoccurring failures of any mixture for any reason will be cause for removal from the qualified list.

3.6 Certification. The contractor shall supply a manufacturer's certification to the engineer for each lot of material furnished. The certification shall include the name of the manufacturer, a manufacturer certification statement that the material supplied is the same as that qualified and listing the date of qualification.

4.0 Construction. All construction requirements shall be in accordance with Sec 502 and Sec 703 except as follows:

4.1 Compressive Strength Requirements. The concrete opening strength to all traffic shall be a minimum compressive strength of 4000 psi. Light construction traffic is allowed when the concrete achieves a minimum compressive strength of 2000 psi. The opening strength shall be verified by the maturity method in accordance with Sec 507, except the strength-maturity relationship shall be developed using 2-hour, 4-hour, 1-day, and 28-day time intervals.

4.2 Vertical Repair. A qualified rapid setting concrete material approved for vertical use may be used when specified on the plans and as approved by the engineer. The engineer will make field cylinders to verify the 1500 psi (10 MPa) minimum strength. The material shall adhere to the concrete surface without sagging.

4.3 Mixing. Rapid set concrete patching material shall be mixed and finished according to the manufacturer's recommendation.

4.4 Preparation of Repair Area. Deteriorated, damaged or defective concrete as shown on the plans, required by the specifications or as directed by the engineer, shall be removed. All exposed reinforcement shall be thoroughly cleaned as shown on the plans, required by the specifications or as directed by the engineer. Unless otherwise specified by the commercial mixture manufacturer, the existing surface shall be damp and all free water shall be removed prior to placement of the required material.

4.5 Bonding Agent. A bonding agent may be used if recommended by the rapid setting concrete material manufacturer.

4.6 Curing. After placing the concrete and the surface irregularities have been removed, the concrete surface shall be given a uniform roughened finish by a broom, wire combined tine, wet burlap drag, or other methods approved by the engineer. After applying the uniform roughened finish, and the concrete surface can support the curing mat without marring or distorting the finish, the concrete shall immediately have a wet burlap cure applied until the concrete has achieved a minimum compressive strength of 2000 psi. When the wet burlap is removed, the concrete shall have a white pigmented membrane applied in accordance with Sec 502.

4.7 Testing. The concrete mixture shall be within the specified limits for compressive strength, pavement thickness and air content. The QC and QA test frequencies shall follow Sec 613.10.

5.0 Method of Measurement. The method of measurement shall be in accordance with Sec 704.6.

6.0 Basis of Payment. Payment for the above-described work, including all material, equipment, labor and any other incidental work necessary to complete these items, will be considered completely covered by the contract unit prices for Half-Sole Repair or Full Depth Repair as indicated on the plans.